


TENDER SPECIFICATIONS

MR 54/2015

TENDER FOR THE SUPPLY OF HEAVY DUTY PVC CONDUITS FOR UNDERGROUND CABLING WORKS

1. Product must categorically meet all physical and mechanical requirements of the AS/NZS-2053.2:2001 and AS/NZS-2053.2:2009 Standard for Heavy Duty (HD) Conduits for electrical applications. Bidders must submit a copy of the compliance certificate and number, issued by a reputable 3rd Party Compliance certification agency, to demonstrate product's compliance.
2. Color: Orange
3. Impact Strength: HD as per AS/NZS-2053.2:2001 and AS/NZS-2053.2:2009
4. Compressive Strength: HD as per AS/NZS-2053.2:2001 and AS/NZS-2053.2:2009
5. Material: PVC – UV Stabilized
6. Specified Usage: Electrical and Suitable for Underground Installation (direct burial in ground)
7. Nominal Internal Diameter: **150mm, 100mm, 80mm, 50mm**
8. Minimum Wall Thickness: to meet and or exceed requirements as per AS/NZS-2053.2:2001 and AS/NZS-2053.2:2009
9. Minimum Socket Length: to meet and or exceed requirements as per AS/NZS-2053.2:2001 and AS/NZS-2053.2:2009
10. Total Conduit Length: **5.6m**

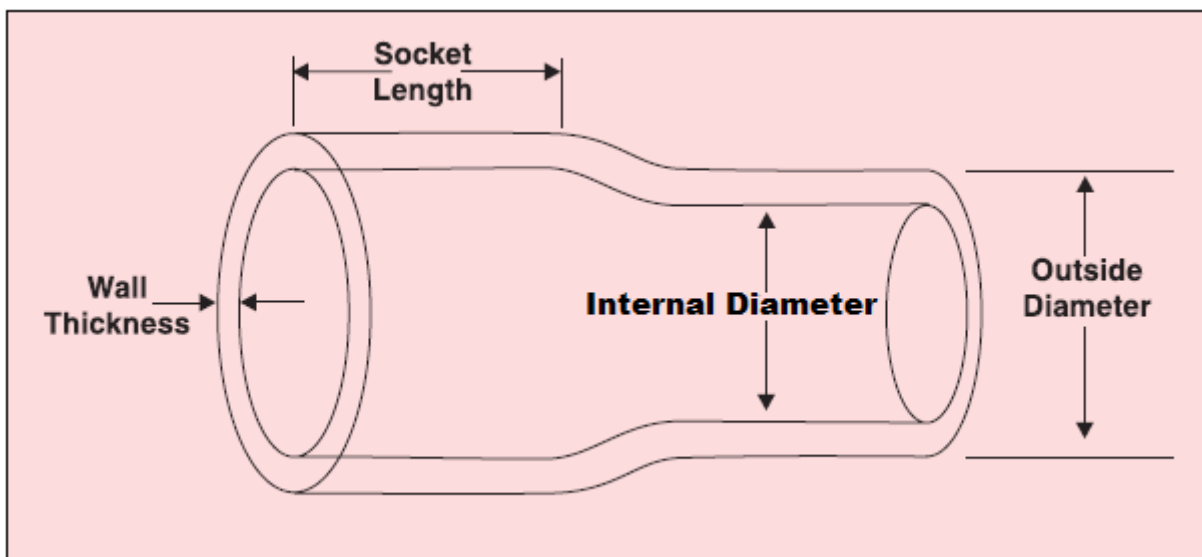

BIDDER'S PRICES AND QUANTITIES REQUIRED

Prices shall be quoted in Fijian Dollar Currency, inclusive of all applicable taxes and duties and for delivery made to **FEA's Kinoya Depot in Suva**.

SCHEDULE OF QUANTITIES AND BIDDER'S PRICES				
SIZE	150mm	100mm	80mm	50mm
QUANTITY REQUIRED	1880 units	1880 units	1260 units	1260 units
BIDDER's UNIT PRICE	?	?	?	?
BIDDER'S LUMP SUM PRICE	?	?	?	?

Quantities quoted are approximate and subject to increase or decrease, depending upon actual site conditions in the field. Final quantities shall be as per FEA purchase order(s) issued to supplier(s).

DELIVERY SCHEDULE

Purchase Orders shall be issued by the FEA in approximately **3 - 5 stages** with minimum order quantities of **200 units**.

Delivery shall accordingly be spread over the **2015 calendar year**. Deliveries shall be commencing approximately around **1st May 2015**.

The FEA reserves the right to issue individual purchase orders for each delivery, if deemed necessary.

Submission of Tenders

Two (2) hard copies of the tender bids in sealed envelope shall be deposited in the tender box located at the Supply Chain Office at the FEA Head Office, 2 Marlow Street, Suva, Fiji.

Courier charges for delivery of Tender Document must be paid by the bidders.

This tender closes at 4:00pm, on Wednesday 15th of April, 2015.

Each tender shall be sealed in an envelope with:

The envelope bearing only the following marking:

Tender- MR 54/2015 – Supply of Heavy Duty PVC Conduits for Underground Cabling Works

The Secretary, Tender Committee
Fiji Electricity Authority

Supply Chain Office

Private Mail Bag, Suva

It must also indicate the name and address of the tenderer on the reverse of the envelope.

All late tenders, unmarked Envelopes and envelopes without bidder's name and address on the reverse of the envelope. (Bids via e-mail or fax will not be considered).

For further information or clarification please contact our Supply Chain Office on phone **(+679) 3224360 or (+679) 9991587.**