



FIJI ELECTRICITY AUTHORITY

**TENDER DOCUMENTS FOR
Wailoa Mid-Life Refurbishment
Generator 11kV Switchgear Replacement
Contract No. MR 57/2016**

June 2016

This document has been prepared for the benefit of Fiji Electricity Authority. No liability is accepted by this company or any employee or sub-consultant of this company with respect to its use by any other person.

This disclaimer shall apply notwithstanding that the report may be made available to other persons for an application for permission or approval to fulfil a legal requirement.

QUALITY STATEMENT

PROJECT MANAGER

Robin Spittle

PROJECT TECHNICAL LEAD

Robin Spittle

PREPARED BY

Robin Spittle..... /...../.....

CHECKED BY

..... /...../.....

REVIEWED BY

..... /...../.....

APPROVED FOR ISSUE BY

Robin Spittle..... /...../.....

DUNEDIN

Level 3, John Wickliffe House, 265 Princes Street, Dunedin 9016
 PO Box 4, Dunedin 9054
 TEL +64 3 477 0885, FAX +64 3 477 0616

REVISION SCHEDULE

Rev No	Date	Description	Signature or Typed Name (documentation on file).			
			Prepared by	Checked by	Reviewed by	Approved by
0	2/6/2016	For Tender				RDS

Fiji Electricity Authority

Wailoa Mid-Life Refurbishment

11kV Switchgear Replacement

CONTENTS

1	Project Background	1
2	Conditions of Tendering	2
2.1	Scope of Tender	2
2.2	Delivery of Tenders.....	2
2.3	Tender Closing Time	2
2.4	Tender Validity.....	2
2.5	Identification of Tenders	2
2.6	Form of Letter of Tender	3
2.7	Tender Documents	3
2.8	Information Required with Tender	3
2.9	Site Visit.....	3
2.10	Evaluation of Tenders.....	3
2.11	Acceptance of Tender.....	4
2.12	Advice on Tender Outcome	4
2.13	Tender Enquiries	4
2.14	Communication.....	4
2.15	Submission of Tenders	5
2.16	Tender Conditions	5
2.17	Tender Responses	6
2.18	Confidentiality	7
2.19	Preferred Tenderer	7
2.20	Acknowledgement by Tenderer	7
2.21	Governing Law.....	8
3	General Conditions of Contract	9
3.1	Preamble	9
4	Particular Conditions of Contract.....	14
4.1	Definitions.....	14
4.2	Changes and Additions to the General Conditions of Contract	15
5	Specification – Preliminary and General	32
5.1	General.....	32
5.1.1	Location	32
5.1.2	Access	32
5.1.3	Site.....	32

5.1.4	Construction Activities to be provided by the Employer	32
5.2	Payments.....	33
5.3	Programme	33
5.4	Training.....	34
5.5	Tests on Completion.....	35
5.5.1	Tests on Completion	35
5.5.2	Tests after Completion.....	35
5.5.3	Acceptance Certificate	35
5.5.4	Performance Shortfall during Defects Notification Period.....	35
5.6	Site Services.....	35
5.6.1	Electricity	35
5.6.2	Water Supply	36
5.6.3	Fire Protection	36
5.7	Health and Safety	36
5.7.1	Health and Safety Procedures	36
5.7.2	Health and Safety Regulations	36
5.7.3	Accidents	36
5.7.4	Barricades.....	36
5.7.5	Safety Supervisors.....	37
5.7.6	Security Fencing	37
5.7.7	Protective Helmets and High Visibility Jackets	37
5.7.8	Lighting	37
5.7.9	Radios.....	37
5.7.10	Safety Signs.....	37
5.7.11	Alcohol & Illegal Drugs and Substances	37
5.7.12	Animals	37
5.7.13	Children	38
5.7.14	Contractor's Responsibilities for Health and Safety.....	38
5.7.15	Fire Regulations.....	38
5.7.16	Housekeeping	38
5.7.17	Responsibility - Employer	38
5.8	Contractor's Administration.....	39
5.8.1	Contractor's Supervisor	39
5.8.2	Meetings	39
5.9	Co-operation.....	39
5.10	Site Operations	39
5.10.1	General	39
5.10.2	Site Specific Entry Conditions.....	39
5.11	Delivery Procedures	39
5.12	Manuals and As-Built Drawings.....	40

5.13	Existing Equipment	40
5.14	Documentation and Approvals	41
5.15	Substitutions	41
5.16	Industrial Relations	41
5.17	Quality Systems and Standard Compliance	41
5.18	Goods and Contractor's Plant.....	41
5.19	Construction Photographs	42
5.20	Advertising.....	42
5.21	Existing Services	42
5.22	Protection of Works	42
6	Specification - Introduction	43
6.1	Scope of Supply.....	43
6.2	Existing Plant.....	43
6.2.1	Generator Switchgear	43
6.2.2	Generators	45
6.2.3	Generator Step-Up Transformers	45
6.2.4	Station Service System.....	45
6.2.5	Switchgear Location.....	46
7	Specification - General Requirements	47
7.1	Submittals.....	47
7.1	Basic Design.....	47
7.2	Detailed Design	47
7.3	Records and Instructions	48
7.4	Standards and Codes	48
7.4.1	Air or Gas Insulated Switchgear	48
7.4.2	Circuit Breakers	48
7.4.3	Current Transformers (CTs).....	48
7.4.4	Voltage Transformers (VTs).....	48
7.4.5	Disconnectors and Earthing Switches	48
8	Specification – Generator Switchgear Description	49
8.1	References	49
8.2	Generator Switchgear.....	49
8.3	Busbars.....	49
8.4	Circuit Breakers	50
8.4.1	General Requirements.....	50
8.4.2	Draw Out Circuit Breakers	50
8.4.3	Circuit Breaker Ratings.....	51
8.5	Disconnecter / Fuse Assembly	51
8.5.1	General	51
8.5.2	Disconnecter/Fuse Ratings.....	51

8.5.3	Disconnecter Mechanism.....	51
8.6	Instrument Transformers	52
8.6.1	General	52
8.6.2	Voltage Transformers	52
8.6.3	Current Transformers.....	52
8.7	Surge Protection Equipment.....	53
8.8	Cable Terminations.....	53
8.9	Control Switches.....	53
8.10	Cubicle Heaters	53
8.11	Maintenance Equipment	53
8.12	Factory Assembly and Tests	54
8.13	Installation, Testing and Commissioning	54
8.14	Training.....	55
8.15	Recommissioning	55
8.15.1	Static Testing	55
8.15.2	Pre-Commissioning Tests.....	56
8.15.2.1	Dry Tests	56
8.15.2.2	Wet Tests	56
8.15.2.3	Generator Excitation, Protection and Synchronising Tests	57
8.15.2.4	Overspeed Test.....	58
8.15.3	Commissioning Tests.....	58
8.15.3.1	First Synchronisation.....	58
8.15.3.2	Load Rejection Tests.....	58
8.15.3.3	Generator Heat Run	59
8.15.3.4	Trial Operation.....	59
8.16	Training.....	59
8.17	Spare Parts.....	59
8.17.1	Specified Spare Parts	59
8.17.2	Optional Spare Parts.....	60
8.18	Generator Switchgear Data	61
Schedule 1 – Tender Forms		64
Tender Form 1 – Letter of Tender		65
Tender Form 2 – Tender Price and Price Breakdown.....		67
Tender Form 3 – Proposed Key Personnel		70
Tender Form 4 – Proposed Suppliers and Sub-Contractors		71
Tender Form 5 – Schedule of Hourly Rates		72
Tender Form 6 – Percentage On-Costs		73
Tender Form 7 – Statement of Conformance		74
Schedule 2 – Form of Contract Agreement		75
Appendix A	Existing Generator Switchgear Selected Drawings and Documents.....	77

Appendix B	Common Requirements Specification	78
------------	---	----

1 Project Background

Wailoa Power Station is four unit station capable of generating 78.3MW, while the individual units operating on their own could originally produce up to 21.3MW at rated flow and maximum reservoir level. The station was finally commissioned in 1983.

The existing 11kV switchgear installed at Wailoa Power Station is some 30 years old and uses air break circuit breaker technology which is now redundant.

This Contract is for the design, manufacture, factory test, delivery to Site, commissioning and start-up of four (4) replacement 11kV switchgear assemblies for the existing generators. Each assembly shall include a generator circuit breaker, voltage and current sensing transformers, and accessory equipment necessary for proper operation of the system. Two of the switchgear assemblies shall include a disconnect/fuse for the station services transformer supply.

Other contracts associated with the turbine generators will be proceeding in conjunction with this Contract. The Contractor is required to cooperate with the Employer and other contractors to help facilitate the smooth execution of the work.

The other contracts include:-

- Refurbishment of the four existing generators.
- Refurbishment of the four existing turbines and governors.
- Replacement of the excitation system.
- Refurbishment of the turbine inlet valves.
- Replacement of the tail race coolers and upgrade of the cooling water system
- Replacement of the individual Unit control panels;
- Provision of individual Unit PLCs to interface with all unit plant and provision of a station PLC to control all station related services and interface with the station, generator and transformer protection;
- Provision of new control systems and communications to the intake and surge chamber
- Provision of penstock flow monitoring systems
- Numerous small works on the station

A number of other refurbishment projects have already been undertaken at the station including:-

- Replacement of the main 11/132kV step up transformers (completed 2013).
- Replacement of the electronic governors (completed 2012).
- Provision of a single new turbine inlet valve and provision of new hydraulic system to enable refurbishment of the existing valves (contract let 2015);

2 Conditions of Tendering

2.1 Scope of Tender

The Fiji Electricity Authority (FEA) invites Tenders for the design, manufacture, factory testing, delivery to site and commissioning of four sets of 11kV switchgear for the Wailoa hydro power facility.

The General Conditions of Contract pursuant to which the Contractor will provide the Works are based on FIDIC Conditions of Contract for Plant and Design Build for Electrical and Mechanical Plant and for Building and Engineering Works Designed by the Contractor, First Edition, 1999.

These Instructions comprise these instructions to tenderers together with all documents issued to tenderers in respect of the Works.

These Instructions do not constitute an offer, but are merely an invitation to the tenderer to submit a Tender.

All documents supplied by FEA remain the property of FEA. FEA reserves the right to request the immediate return of all documents supplied and any copies made of them at any time.

2.2 Delivery of Tenders

Two hard copies of the tender shall be submitted to the tender box located at the Supply Chain Office at the FEA Head Office in Suva by no later than 04.00pm (Fiji Time) on Wednesday, 03rd August, 2016 or addressed to :

Fiji Electricity Authority
2 Marlow Place
Suva
Fiji
Attention: Mr Tuvitu Delairewa

2.3 Tender Closing Time

Electronic copies of tender shall be uploaded onto the TenderLink website <https://www.tenderlink.com/fea> by no later than 04.00pm (Fiji Time) on Wednesday, 03rd August, 2016.

Hard copies can be received after the closing date and time provided the electronic copy is uploaded onto the TenderLink website and hard copy is despatched before the closing date and time as stipulated above. For any information and clarification please contact the General Manager Commercial, Mr Tuvitu Delairewa on email TDelairewa@fea.com.fj

2.4 Tender Validity

All Tenders shall remain open and valid for acceptance for a period of 60 days after the Tender Closing Time.

A Tender, once submitted, may only be varied by the tenderer with the prior written consent of FEA.

2.5 Identification of Tenders

Tender documents are to be delivered packaged and clearly identified.

2.6 Form of Letter of Tender

The form of Letter of Tender shall be as set out in Schedule 1, Tender Form 1.

2.7 Tender Documents

The tender documents comprise the following:

- a) Section 1 – Background to the Contract
- b) Section 2 – Tender Conditions
- c) Section 3 - General Conditions of Contract
- d) Section 4 - Particular Conditions of Contract
- e) Sections 5, 6, 7, 8 – Specification
- f) Tender Schedules

2.8 Information Required with Tender

Tenders shall include the name of the tenderer and a complete postal address for service of notices.

Tenders shall include the following minimum information for evaluation:

- Fixed, lump sum tender price. All prices must be quoted in a single currency, nominated by the contractor plus Fijian dollars if required. The prices should exclude Fiji VAT and Withholding Tax and shall be deemed to include all direct, indirect and ancillary charges and costs for the Works;
- Statement of compliance with all Tender and Contract requirements.
- Completed tender forms;
- Full details of the 11kV switchgear proposed.
- Proposed programme for design, fabrication and delivery;
- Proposed key personnel;
- Any supplementary information required by the documents issued to the tenderers;
- Any interpretation or other statements by the tenderer affecting the Tender;
- The Tender shall be signed by or on behalf of the tenderer by a person with the delegated authority to do so. Written proof of the delegated authority to sign the tender offer may be requested.

2.9 Site Visit

A site visit is not considered necessary for this Tender. However, should any tender wish to arrange a visit they shall advise the Engineer within two weeks of the date of the Employer issuing the tender documents. The Employer will then endeavour to arrange a single visit a time that best suits the Employer, Engineer and all other bidders.

2.10 Evaluation of Tenders

Tenders received will be evaluated on the basis of such matters as FEA in its sole discretion determines are relevant, which may include the following:

- Quality of the solutions and plant offered and completeness of the offer.
- Tender sum and quoted rates and on-costs for possible approved variations.
- Proposed programme for the implementation and completion of the Works.

- Tenderer's experience, capability and commitment to achieving the project objectives.
- Tenderer's health and safety performance record and commitment.
- Compliance with the Contract conditions and specifications.

FEA may apply whatever weighting it considers in its sole discretion to be appropriate and the order set out above is not and shall not be taken to be the order of priority of the factors being considered by FEA.

2.11 Acceptance of Tender

FEA may, in its absolute discretion:

- Decline to consider any Tender;
- Reject all Tenders;
- Accept any Tender, notwithstanding that any other tender may propose a lower cost method of achieving FEA's objectives;
- Accept any Tender, even though it may not be in accordance with these Instructions.

FEA reserves the right to enter into negotiations with any unsuccessful tenderer or other party after the Tender Closing Time to complete the Contract.

2.12 Advice on Tender Outcome

All tenderers who submit a complying Tender will be notified of the outcome of the Tender. The advice will be limited to the name of the successful tenderer only if a Tender is accepted.

The successful tenderer will be invited by FEA to execute the Contract Agreement.

The original copies of all Tenders delivered to FEA will be the property of FEA and will not be returned to tenderers (unless FEA determines otherwise, in its absolute discretion).

2.13 Tender Enquiries

All enquiries relating to these Instructions shall be addressed to:

Tuvitu Delairewa
Fiji Electricity Authority

Phone: +679 999 2436

Email: TDelairewa@fea.com.fj

Any additional information, modifications or clarifications arising from enquiries from any tenderer will be confirmed in writing to all tenderers unless non-disclosure is necessary to protect tenderer confidentiality.

2.14 Communication

All communications regarding these Instructions may only be made to Tuvitu Delairewa. FEA will not be bound by any statement, written or verbal made by any person other than Tuvitu Delairewa, who is the only person authorised to make representations or explanations regarding these Instructions.

FEA may issue clarifications or changes to these Instructions by way of written Notice to Tenderers (“NTT”) at any time prior to the Tender Closing Date. A copy of each NTT will be mailed or delivered to those who have received a copy of these Instructions. All NTTs issued will become part of this tender.

Where the Instructions are ambiguous or unclear to a tenderer, the tenderer may request the issue of an NTT for clarification. All such requests should be made in writing to Tuvitu Delairewa. A copy of each NTT issued will be mailed or delivered to those who have received a copy of these Instructions. All NTTs issued will become part of these Instructions.

In the absence of an NTT, Tenders may be submitted subject to any reasonable interpretation of any ambiguity or uncertainty in these Instructions, which shall be endorsed on the Tender.

2.15 Submission of Tenders

It is FEA’s preference to contract on the basis set out in these Instructions. However, FEA may consider alternative Tenders. Any alternative Tender should clearly identify the commercial advantage and ‘value added’ offered.

By submitting a Tender, the tenderer confirms that FEA is authorised to:

- Verify with any third party any information included in the Tender or disclosed to FEA in connection with the tender;
- Discuss any matter relating to the tenderer or the tenderer’s performance with any referee or other third party;
- Carry out a credit check on the tenderer and any proposed guarantor or other security provider.

The cost of preparing and submitting a Tender shall be borne by the tenderer

2.16 Tender Conditions

FEA reserves the right to:

- Suspend or cancel (in whole or in part) this tender process and/or overall process without assigning a reason;
- Terminate or exclude at any time participation by any tenderer in the tender process without assigning a reason;
- Call and/or re-advertise for tenders or revisit any tender process;
- Waive any irregularities or informalities in this tender process;
- Run the tender process as it sees fit, including by varying the process without assigning reason;
- Select suppliers based on their tender responses and/or invite them to participate in a further closed or open tender process;
- Issue Instructions with modified descriptions of goods/services requirements, including innovations identified and/or proposed FEA through this tender process;
- Enter into discussions and/or negotiations with one or more tenderers relating to matters dealt with in these Instructions;
- Deal separately with any of the divisible elements of any tender response, unless the relevant tender response specifically states that those elements must be taken collectively;
- Limit or extend the list of potential tenderers beyond those who respond to these Instructions;
- Seek clarification of any aspect or information provided in any tender response, and seek further information from any party;
- Consider, accept or reject any further Tenders (including any alternative or non-conforming Tenders) it may receive from any tenderer or other correspondent;

- Change any time, date or timeframe in, or any other aspect of, this tender process (including extending the closing date for the receipt of tender responses) by notice in writing to each tenderer;
- Liaise or treat with any prospective or actual tenderer at any time without necessarily liaising or treating with any other prospective or actual tenderer;
- Delete or change its requirements for any goods/services covered by this tender process;
- Conduct a financial check on any tenderer submitting a tender response; and
- Obtain similar goods/services from any third party and not deal exclusively with any tenderer under this tender process.

FEA will not be bound to give any reasons for decisions made as a result of the tender process or as an outcome of the Tender evaluations. Nothing contained or implied in these Instructions shall oblige FEA to discuss, justify or give reasons for any of its decisions or actions relating to these Instructions or any response.

Whilst FEA seeks to ensure that the supporting information contained in these Instructions and otherwise provided by or on behalf of FEA to the tenderer is accurate:

- FEA makes no representation or warranty, whether express or implied, as to the completeness, correctness or accuracy of such information; and
- Any drawings, reports or other material provided by or on behalf of FEA are provided for information purposes only and may not be relied upon as constituting accurate information.
- The tenderer is to make its own enquiries as it considers necessary before relying on any information provided by FEA and before submitting its Tender. FEA shall have no liability for any inaccuracies, errors, omissions or mistakes in such documentation.

Those submitting tender responses will be deemed to have:

- Examined these Instructions and all documents referenced (if any);
- Considered all the risks, contingencies and other circumstances that may have an effect on their tender responses;
- The Tenderer will be deemed to have visited the site and satisfied themselves that the offer is complete. On site conditions will not be accepted as a reason for variation at a later date.
- Taken into account all restrictions, procedures, costs, timings and potential difficulties which may affect the performance of the Works; and
- Satisfied themselves as to the correctness and sufficiency of their tender responses, including the pricing structure offered.

All tenderers submitting a Tender agree that:

- A contract is only formed between FEA and the successful tenderer when FEA executes the Contract Agreement, setting out in full the terms upon which FEA has engaged that tenderer to carry out the Works;
- These Instructions, and any provision contained herein, do not give rise to a separate contract between FEA and the tenderer; and
- Nothing in these Instructions, or in the relationship of FEA and the tenderer, imposes any duty of care on FEA, and any such duty of care is expressly excluded.
- All costs incurred by the tenderer in connection with its Tender, these Instructions or any related matters are the sole responsibility of the tenderer.

2.17 Tender Responses

Each tenderer must include the information as required by FEA in these Instructions. Information not specifically required by these Instructions, but believed by the tenderer to be of value in evaluating the

responses, should be included as an addendum. Where there is reference to published manuals, only the relevant extracts should be placed in the addendum.

All tenderers warrant that:

- All information provided in their response is complete and accurate in all material respects;
- Provision of information to FEA, and the use of it by its employees, agents or contractors for the evaluation of responses and the possible subsequent negotiation and implementation of a contract, will not breach any third party's intellectual property rights; and
- FEA is under no obligation to check any tender response for errors. Acceptance of a tender response that contains errors will not invalidate any contract that may be negotiated on the basis of that tender response.
- Tenderers must not, without FEA's prior written consent, consult, communicate or agree with any other tenderer in connection with any Tender, and shall not make any attempt to influence any other tenderer to submit or not submit a Tender or to alter the proposed content of that tenderer's Tender.

2.18 Confidentiality

These Instructions, all information supplied by FEA (either itself or through its consultants or advisors) in connection with these Instructions and all discussions relating to these Instructions, are confidential. Tenderers must not release or disclose any of the information or discussions to any other person (other than the tenderer's employees or advisors on a need to know basis) without the prior written consent of FEA.

All drawings and documents of the existing works included in these tender documents are provided for the sole purpose of enabling Tenders to submit to the Employer proposals to rehabilitate the works. Unsuccessful Tenderers shall destroy all such drawings and documents following notification of award to another party. Any use of the drawings and documents by a Tenderer, other than for the purposes of assisting the Employer in rehabilitating the works, may breach the original manufacturer's copyright and the Tenderers shall indemnify the Employer and Engineer against the costs of any claim or defending any such claims that may arise from such breach of copyright by the Tenderer.

2.19 Preferred Tenderer

Should a tenderer be informed that they are a preferred tenderer, such advice does not:

- Constitute an acceptance by FEA nor create a contract;
- Constitute an award of the contract; nor
- Imply or create an obligation on FEA to enter into negotiations with or award the contract to the tenderer.

FEA reserves the right to discontinue negotiations at any time.

2.20 Acknowledgement by Tenderer

Each tenderer acknowledges that FEA has reserved to itself certain rights and discretions in these Instructions and agrees that it assumes, at its sole cost, the risk that FEA may at any time exercise any of these rights and discretions. Each tenderer agrees that it shall not have any rights, and further waives any rights it may have, against FEA or any other person arising from the exercise by FEA of its rights and discretions, and agrees not to make any claim, bring any action or otherwise seek to recover from FEA any costs incurred by that tenderer in respect of its Tender or any lost expectation of profits or other benefits which that tenderer may expect to accrue to it from acceptance of its Tender.

2.21 Governing Law

These Instructions shall be construed according to and governed by Republic of the Fiji Islands Law and the tenderers agree to submit to the non-exclusive jurisdiction of the Fijian Courts in any dispute or difference of any kind which may arise concerning the same.

3 General Conditions of Contract

3.1 Preamble

The General Conditions of Contract pursuant to which the Contractor shall provide the Works will be the "FIDIC - Conditions of Contract for Plant and Design-Build for Electrical and Mechanical Plant, and for Building and Engineering Works, Designed by the Contractor", First Edition, 1999.

All capitalised terms in this section of the documents are as defined in The General Conditions of Contract unless the context requires otherwise or unless amended by the Particular Conditions of Contract.

References to Sub Clauses in this section are references to Sub Clauses in the General Conditions of Contract.

The Employer: Sub Clause 1.1.2.2

The Employer is: Fiji Electricity Authority
Private Mail Bag
2 Marlow St
Suva
FIJI ISLANDS

The Employer's Representative is: Eparama Tawake
General Manager - Generation

The Contractor: Sub Clause 1.1.2.3

The Contractor is:

Telephone:

Facsimile:

Email:

The Engineer: Sub Clause 1.1.2.4

The Engineer is: Robin Spittle
MWH New Zealand Ltd
PO Box 4
265 Princes St
Dunedin
NEW ZEALAND

Telephone: +64 021 649402
Facsimile: +64 4 477 0616
Email: robin.d.spittle@mwhglobal.com

The Engineer's Representative: Sub Clause 3.2

The Engineer's Representative is: Robin Spittle
MWH New Zealand Ltd
PO Box 4
265 Princes St
Dunedin
NEW ZEALAND

Telephone: +64 021 649402
Facsimile: +64 4 477 0616
Email: robin.d.spittle@mwhglobal.com

Time for Completion: Sub Clause 1.1.3.3

Section 1: 417 days
Section 2: 789 days
Section 3: 1063 days
Section 4: 678 days

Defects Notification Period: Sub Clause 1.1.3.7

365 Days for each of Sections 1, 2, 3 and 4 of the Contract.

Contract Sections: Sub Clause 1.1.5.6

There are four separate Sections

Section 1: Design, manufacture, factory test, transport, installation supervision, commissioning and testing of Unit 4 11kV switchgear.
Section 2: Design, manufacture, factory test, transport, installation supervision, commissioning and testing of Unit 3 11kV switchgear.
Section 3: Design, manufacture, factory test, transport, installation supervision, commissioning and testing of Unit 2 11kV switchgear.
Section 4: Design, manufacture, factory test, transport, installation supervision, commissioning and testing of Unit 1 11kV switchgear.

Each Separate Section shall be a standalone Section of the contract with its own Taking Over, Certificate of Acceptance, Defects Liability Period and Performance Certificate.

The following applies

- a) The Employer reserves the right to change the order in which each generator is refurbished.
- b) Only one turbine generator unit can be out of service at any time.

Electronic Transmissions: Sub Clause 1.3

Electronic transmissions shall be by email. Drawings shall be transmitted as AutoCAD drawing files and PDF files. Spreadsheets shall be transmitted as Microsoft Excel files or PDF files. Typed documents shall be transmitted as Microsoft Word files or PDF files. The PDF files shall be created using Adobe software.

Governing Law: Sub Clause 1.4

The Contract shall be governed and take effect in accordance with the laws of the Republic of Fiji and any arbitration shall be governed by such laws. The parties hereto submit to the non-exclusive jurisdiction of the Fiji Courts.

Ruling Language: Sub Clause 1.4
English**Language for Communications:** Sub Clause 1.4

The language for all communications is English.

Time for Access to the Site: Sub Clause 2.1

The Employer shall give the Contractor right of access to, and non-exclusive possession of, each part of the Site on or before the possession dates shown in the latest approved programme. Refer to clause 3.3 of Preliminary and General Section of this Contract for the preliminary programme.

Engineer's Duties and Authority Sub Clause 3.1

The Engineer must obtain approval from the Employer for any Variation that increases the Contract Price.

Performance Security Sub Clause 4.2

10% of the Accepted Contract Amount for all Sections of the Contract up to Taking Over of the final 11kV switchgear assembly covered under the contract. This shall reduce to 5% during the Defects Notification Period for the final 11kV switchgear assembly.

Employer's Equipment: Sub Clause 4.20

None to be provided. The exception is the powerhouse crane and any special tools available for the maintenance of the existing generators and their auxiliaries.

Period for Notifying Unforeseeable Errors, Faults and Defects in the Specification: Sub Clause 5.1

14 days after Commencement Date.

Working Hours Sub Clause 6.5

Working hours shall be between 7am and 10pm unless otherwise approved by the Employer.

Commencement of Work Sub Clause 8.1

The Commencement dates for each all Sections of the works is the date of the Letter of Acceptance.

Delay Damages Sub Clause 8.7

0.5% of the value of the Section of the Contract per day, up to a maximum of 10% of the Contract value

Adjustments for Changes in Cost Sub Clause 13.8

The Contractor shall propose a method for adjusting for any changes in cost over the time the Works under the Contract are being carried out. The agreed method for adjusting the cost during the duration of the Contract will be set out in the Letter of Acceptance. No cost increase will be allowed for delays in completion of any of the Sections of Work or for the effect of a delay in one Section of the Work on subsequent Sections of Work.

Advance Payment Sub Clause 14.2

10% advance payment will be provided. The payment will be due within 14 days of the Commencement Date.

Percentage of Retentions: Sub Clause 14.3

The Percentage of Retentions shall be 10%, reducing to 5% on Taking Over and 0% on provision of the Defects Notification Period performance bond by the Contractor.

Delayed Payment: Sub Clause 14.8

The interest rate for delayed payment shall be at the Westpac Banking Corporation of Fiji base commercial overdraft rate applicable at the time of the delayed payment plus 1.8% per annum.

Currencies of Payment: Sub Clause 14.15

Payments can be claimed in Fiji dollars plus a single nominated currency. Australian, New Zealand, Euro and US currency are permitted. Other international currencies will be considered. The maximum amount owing in each currency must be nominated at time of tender

The rate of exchange between currencies shall be the sell rate quoted by the Westpac Banking Corporation of Fiji at the Base Date.

Period for Submission of Insurance: Sub Clause 18.1

(a) evidence of insurance: within 28 days of the acceptance of contract.

(b) relevant policies: Within 28 days of the acceptance of contract.

Maximum Amount of Deductibles For Insurance of Employer's Risks: Sub Clause 18.2(d)

US\$50,000

Minimum Amount of Public Liability Insurance: Sub Clause 18.3

US\$10,000,000

Minimum Amount of Professional Indemnity Insurance: Sub Clause 18.5

Value of the Works plus 20%

Motor Vehicle Third Party Insurance: Sub Clause 18.6

US\$1,000,000

The DAB shall be: Sub Clauses 20.2

There is no DAB. Refer to the Particular Conditions Clauses 20.2 to 20.4

4 Particular Conditions of Contract

The following Particular Conditions of Contract amend or modify or are in addition to the General Conditions of Contract.

4.1 Definitions

References to Sub Clauses in this section are references to Sub Clauses in the General Conditions of Contract.

1.1.1.1 *second line, replace "Employer's Requirements" with "Specification".*

1.1.1.5 *delete and substitute: "Employer's Requirements" means the purpose, scope, design requirements and technical data contained in the Specification.*

1.1.2.2 *delete and substitute: "Employer" means Fiji Electricity Authority, its assignees and any legal successors in title to Fiji Electricity Authority.*

1.1.2.8 *delete and substitute: "Engineer" means MWH New Zealand Ltd, its assignees and any legal successors in title to MWH New Zealand Ltd.
add "and includes a Nominated Subcontractor" after "Works" on line 3*

1.1.3.3 *delete. There is no Dispute Adjudication Board
replace "Appendix to Tender" with "Preamble"*

Add new Sub Clause:

1.1.3.10 "Acceptance Certificate" means the certificate to be issued by the Engineer to the Contractor pursuant to clause 12.5."

1.1.5.6 *replace "Appendix to Tender" with "Preamble".*

Add new Sub Clauses:

1.1.6.10 "Specification" means Sections 5, 6, 7, and 8 of the Contract and the Common Requirements Section provided in Appendix B of the Contract.

4.2 Changes and Additions to the General Conditions of Contract

References to Sub Clauses in this section are references to Sub Clauses in the General Conditions of Contract.

1 The Contract

1.3 Communications *In (a) and (b) replace “Appendix to Tender” with “Preamble”.*

1.4 Law and Language *replace “Appendix to Tender” with “Preamble” where it appears throughout this Sub Clause.*

1.5 Priority of Documents

Delete and substitute:

The documents forming the Contract shall be taken as mutually explanatory of one another. For the purposes of interpretation, the priority of documents from highest to lowest shall be in accordance with the following sequence:

- (a) Contract Agreement;
- (b) Letter of Acceptance;
- (d) Preamble;
- (e) Completed Tender Schedules;
- (f) Notice to Tenderers (NTT);
- (g) Particular Conditions;
- (h) General Conditions;
- (i) Specification;
- (j) Letter of Tender;
- (k) Contractor's Proposal;
- (l) Instructions to Tenderers.

1.7 Assignment

Delete and substitute:

“The Contractor shall not assign the whole or any part of the Contract or any benefit or interest in or under the Contract. However, the Contractor may:

- (a) Assign the whole or any part of the Contract with the prior agreement of the Employer, at the sole discretion of the Employer, and
- (b) As security in favour of a bank or financial institution, assign its right to any moneys due, or to become due, under the Contract.

The Employer shall be free to assign the whole or any part of the Contract or any benefit or interest in or under the Contract.”

1.8 Care and Supply of Documents

First paragraph, replace “six” with “three”.

Second paragraph, replace “Employer’s Requirements” with “Specification”.

1.12 Confidential Details

Add the following:

"The Contractor shall treat the details of the Contract and the Works as private and confidential except to the extent necessary to carry out obligations under the Contract or to comply with applicable Laws. The Contractor shall not publish, permit to be published or disclose any particulars of the Works in any trade or technical paper or elsewhere without the prior agreement of the Employer."

"The Contractor is required to disclose to the Engineer or the Employer confidential information to allow:

- (a) The Plant and the Works to be fully integrated with existing systems and operated and maintained in the correct manner; and
- (b) The Employer or the Engineer to confirm the full compliance with the Specification.

2 The Employer**2.1 Right of Access to the Site**

Insert the words "Subject to Sub-Clause 4.15 (Access Route)" at the beginning of the first paragraph.

First paragraph delete "Appendix to Tender" and substitute "Preamble".

Second paragraph delete "Appendix to Tender" and substitute "Preamble".

3 The Engineer**3.1 Engineer's Duties and Authority**

Third paragraph, second sentence, delete "Particular Conditions" and substitute "Preamble".

4 The Contractor**4.1 Contractor's General Obligations**

In line 4 of the last paragraph delete the words "to the Engineer" and insert "and approved by the Engineer. No refusal by the Engineer to such alterations shall give rise to a claim for a Variation, extension of time, cost or profit."

Add the following at the end of the Sub Clause:

The Contractor agrees that if at any time during the performance of the Works the Contractor is of the opinion that a change in the design or execution of the Works:

- (a) is necessary to eliminate a potential defect in the Works or a specific hazard to any person in the performance or operation of the Works; or
- (b) would otherwise be beneficial to the Employer (whether by maximising the efficiency or cost effectiveness of the construction, operation and maintenance of the Works or otherwise);

then the Contractor shall bring the matter to the attention of the Engineer in writing and the Engineer shall determine whether Clause 13 [Variations and Adjustments] shall be applied and shall notify the Contractor accordingly.

4.2 Performance

Delete the first paragraph and substitute:

Security

The Contractor shall provide the Employer with Performance Security in the form of an unconditional on demand bond to secure performance of the Contractor's obligations under the Contract Agreement. The Performance Security shall be for the amount stated in the Preamble. The Performance Security shall be provided as an irrevocable bond provided by a surety which shall be a registered bank in Fiji, New Zealand or Australia or such other jurisdiction as approved by the Employer.

Add the following to the end of the Sub Clause:

If the Performance Security is not delivered to the Employer within the required time or at any time ceases to be valid and enforceable (except in the circumstances expressly permitted in the contract), or the surety providing the Performance Security becomes, in the reasonable opinion of the Employer, no longer acceptable credit support then the Employer shall be entitled to:

- (a) suspend the contract until the Performance Security (or an acceptable replacement, as the case may be) is delivered to the Employer. Such suspension shall not be treated as a Variation and the Contractor shall not be entitled to any extensions of time or any compensation as a result of such suspension;
- (b) withhold any payments due to the Contractor until the Performance Security (or an acceptable replacement, as the case may be) is delivered to the Employer. The Contractor shall not be entitled to make any claims against the Employer by reason of any such withholding of payments; and/or
- (c) without limiting the foregoing, treat such failure as a default by the Contractor under Sub Clause 15.2.

Following consultation with the Contractor, where the Employer gives reasons for its view, the Employer shall be entitled to require the Performance Security to be replaced by another form of security acceptable to the Employer if it reasonably forms the view at any time that the validity or enforceability of the Performance Security or credit-worthiness of the surety providing the Performance Security may be in question. The Contractor shall, within 14 days after receipt of the Employer's request for the Performance Security to be replaced, procure the replacement Performance Security and deliver the same to the Employer within the 14 day period. The Employer shall release a replaced Performance Security within 14 days of receiving the replacement Performance Security from the Contractor, provided that should there be any unpaid claims on such replaced Performance Security, the Employer shall not be required to release it until such claims have been paid in full.

**4.5 Nominated
Subcontractors**

Add the following as a second paragraph:

"Where such notice of objection is given to the Engineer and the matter is not resolved within a reasonable time the Employer or the Engineer shall make a fresh nomination of a Subcontractor. Alternatively the Engineer and the Contractor may agree to the work being carried out by the Contractor or by another Subcontractor or by some other contractor under a separate contract with the Employer."

4.16 Transport of Goods

Add the following:

“Any packing used shall prevent mechanical damage to the contents. It shall also prevent the ingress of water. Desiccants shall be included in each waterproof package. Each package shall be clearly labelled with its contents, drawing reference, destination, handling requirements and weight.

Packing of any Plant or Materials shipped from overseas shall comply with The Fiji Islands import regulations. The Contractor shall certify, with the notice provided under (a) above that no prohibited materials have been used for packing. The Contractor shall be responsible for any fumigation costs or other costs resulting from packing that does not comply with The Fiji Islands import regulations.

The Contractor shall not bring any Goods onto the Site unless and until the time they are to be incorporated into the Works.

All Goods when incorporated into the Works shall be free from all charges, encumbrances or liens.

4.18 Protection of the Environment

Delete the second paragraph and substitute:

“The Contractor shall ensure that all activities and operations under the Contract comply with all applicable Laws, and all applicable the environmental requirements for the Works”

Add the following at the end of the Sub Clause:

In carrying out the Works, the Contractor shall not do anything or omit to do anything, or use materials, substances or processes which:

- (a) might discharge a contaminant into the environment, cause the emission of noise to exceed such levels, or cause any adverse effect on the environment, which would constitute a breach of the environmental approvals applicable to the Works or the Site;
- (b) is a breach of any duty or obligation of the Employer; or
- © is a breach of any of the environmental approvals applicable to the Works or the Site or causes the Employer to breach any such approvals for Works on the site; or

4.22 Security of the Site

Add to the end of paragraph (a):

“The Contractor shall advise the Engineer if the Contractor is aware of unauthorised persons on the Site.”

5 Design**5.1 General Design Obligations**

Third paragraph, second sentence, delete “Appendix to Tender” and substitute: “Preamble”

Add at the end of the Sub Clause:

Without limiting the foregoing, the Contractor must ensure that the Plant, Materials and the Works are professionally designed to be appropriate and fit for the purposes for which the Works are intended as defined in the Contract and which meet the technical specifications, design life and the performance requirements set out in the Specifications and the Contractor’s Tender.

5.9 Additional Design Issues

Add new Sub Clause 5.9:

"The Contractor agrees to accept all responsibility and meet all costs for developing all aspects of the design required by the Specifications and to produce detailed plans and specifications.

The Specifications include preliminary plans and specifications that describe the scope, requirements and expectations of the Employer in respect of the Works and their operation. The Contractor acknowledges in this regard that:

- (a) The Specifications are a guide only and do not cover all items of work required to provide the Works; and
- (b) The Employer accepts no responsibility for the completeness or accuracy of the design, plans, drawings and specifications described in the Specifications.

The Contractor shall develop the design described in the Specifications into a concept design and a detailed design (which for the purposes of this Sub Clause 5.9 are the *designs*). The content of the designs shall be as described in the Specifications.

The Contractor shall certify to the Employer that the designs comply with at least the minimum requirements and expectations of the Employer in respect of the undertaking and performance of the Works as described in the Specifications.

The Contractor shall submit the designs to the Engineer for review on the dates specified in the Specifications, and shall undertake any factory or Site testing as required by the Specifications and supply the test results to the Engineer.

Except where the Contract otherwise provides:

- (a) The Engineer shall not be required to check the designs for errors, omissions, inconsistencies, ambiguities, discrepancies or compliance with the Contract.
- (b) Any acknowledgement, comment, or approval of the designs by the Engineer shall not prejudice or affect the Contractor's obligations to complete the Works in strict compliance with the Contract
- (c) If errors, omissions, inconsistencies, inadequacies or other defects are found in the designs, the designs and the Works shall be corrected at the Contractor's cost, notwithstanding any consent or approval given by the Engineer.

5.10 Design Responsibility Scope

Except where the Contract otherwise provides:

- (a) The Contractor is responsible for the design of the replacement 11kV switchgear assemblies provided under this Contract.
- (b) The Contractor is not responsible for the design of the existing generator and appurtenant facilities.

5.11 Technical Standards and Regulations

Add New Clause 5.11

Wherever reference is made in the Contract to specific standards and codes to be met by the Materials, Plant, and other Goods to be furnished, and work performed or tested, the provisions of the latest current edition or revision of the relevant standards and codes in effect shall apply, unless otherwise expressly stated in

the Contract. Where such standards and codes are national, or relate to a particular country or region, other authoritative standards that ensure substantial equivalence to the standards and codes specified will be accepted subject to the Engineer's prior review and written approval. Differences between the standards specified and the proposed alternative standards must be fully described in writing by the Contractor and submitted to the Engineer at least 28 days prior to the date when the Contractor desires the Engineer's approval. In the event the Engineer determines that such proposed deviations do not ensure substantially equal performance, the Contractor shall comply with the standards specified in the documents.

Notwithstanding the above, the Fiji National Building Code shall be applied to any building works. The Fiji Electricity Regulations Cap 180 Regulations 45, 46 and 47 shall apply to all elements the Works.

6 Staff and Labour

6.5 Working Hours

Add the following:

"The normal working hours in respect of those parts of the Site owned by the Employer are restricted (if at all) to the extent specified in the Preamble. The Contractor acknowledges that where any part of the Works is to be carried out on parts of the Site not owned by the Employer, the Contractor will be required to comply with any restrictions on working hours put in place by the owner of the Site."

Replace "Appendix to Tender" with "Preamble" (being paragraph 1.2 of this document).

Insert the following at the end of the Sub Clause:

"Any works undertaken pursuant to the above shall not entitle the Contractor to additional costs, unless such work is undertaken pursuant to a Variation."

6.7 Health and Safety

Delete and substitute:

"The Contractor, in its capacity as an employer and a person in control of a place of work, shall ensure that its employees, any other persons in the workplace and people in the vicinity of the workplace, are not harmed by any workplace hazard. The Contractor shall comply with health & safety requirements for Site, the Contractor's health and safety plans and its obligations under the Fiji Health and Safety at Work Act 1996 including subsequent amendments (including all regulations and, where appropriate, Codes of Practice made under the Act), and the Electricity Regulations and any other legal and statutory safety obligations in relation to ensuring the safety of its employees, hazard management, information for employees and training and supervision of employees, and any other statutory safety obligations.

The Contractor, in its capacity as an Employer and a person in control of a place of work, shall ensure that its employees, Subcontractors, and any other persons on the Site and in the vicinity of the Site for whom it is responsible, are informed of existing Site specific hazards, emergency and other requirements and the Employer's expectations and requirements as regards

health and safety, all as set out in the Specification or advised from time to time by the Engineer. The Engineer shall notify the Contractor of all of the Employer's key personnel at the workplace and their contact details for accident and other reporting purposes.

The Contractor shall immediately notify the Engineer in writing of any hazard the Contractor identifies on the Site, the date the hazard was identified, and the steps taken to eliminate, isolate, minimise and monitor the hazard.

The Contractor shall have and comply with its own appropriate Site specific safety and health plan which shall ensure all relevant places of work are safe, that hazards are controlled and that compliance with all health and safety laws is achieved. The Contractor shall submit its project specific safety and health plan to the Engineer at least 14 days prior to commencing any work on the Site. The Contractor shall review the plan regularly and shall ensure that it is maintained so as to be up to date and fully compliant with all Laws.

The Contractor shall comply with any health and safety plans currently implemented on the Site. Failure to comply with existing health and safety plans may result in the Engineer instructing the Contractor to cease or not commence furnishing the Works or part of the Works until the Contractor complies with its health and safety obligations required pursuant to this Contract. Any such instruction shall not constitute a Variation and the Contractor shall not be entitled to any extensions of time or any compensation as a result of such instruction.

The Engineer may audit the Contractor from time to time on any aspect of its activities or procedures as they relate to safety and health. If the Engineer is of the opinion that the Contractor has failed to comply with any part of this Sub Clause the Engineer may advise the Contractor and may instruct the Contractor to cease or not commence furnishing the Works or part of the Works until the Contractor complies with its health and safety obligations required pursuant to this Contract. Any such instruction shall not constitute a Variation and the Contractor shall not be entitled to any extensions of time or any compensation as a result of such instruction.

If any employee of the Contractor or any Subcontractor suffers an injury while furnishing the Works which results in the employee's death or inability to work for any part of the next day or shift scheduled for work, the Contractor shall inform the Engineer forthwith and as soon as practicable shall provide details on the Employer's standard "Event Report" form.

For statistical purposes, the Contractor shall provide in writing, with each monthly progress report, the total hours worked during the previous month on the Site by its staff and also separately by its Subcontractors. Staff shall include supervisory and administrative staff. The Contractor shall maintain records and make reports concerning health, safety and welfare of persons, and damage to property, as the Engineer may reasonably require.

The Contractor shall also comply with any safety provisions included in the Specification."

6.9 Contractor's

Add the following:

Personnel	<p>"The Contractor shall employ the key personnel named in the Tender to fill the positions stated in the Tender, or, where it is unable to do so, shall employ others approved by the Engineer pursuant to this Sub Clause 6.9".</p> <p>The Contractor shall not without the prior consent of the Engineer replace any of the approved key personnel.</p> <p>The Engineer shall not be required to approve a proposed replacement key person unless such person's relevant qualifications and experience are at least as good as those of the person who is to be replaced. Otherwise, the Employer's approval to any proposed replacement key person shall not be unreasonably withheld".</p>
7 Plant, Materials and Workmanship	
7.1 Manner of Execution	<p><i>Add to the end of Sub-Clause 7.1</i></p> <p>Unless otherwise specified in the Contract, all Materials used other than Temporary Works shall be new.</p> <p>The Contractor expressly acknowledges that the Employer entered into the Contract in reliance upon:</p> <ul style="list-style-type: none">(a) the skill and judgement of the Contractor as a designer, manufacturer, fabricator, supplier, installer, erector, constructor, tester and commissioner of facilities of the size, nature and standard of the Works; and(b) the ability of the Contractor to design, manufacture, construct, fabricate, supply, install, erect, test and commission the Works with the highest regard to the environment and to the safety of workers and all other persons at or in the vicinity of the site, the Works and the property of third parties. <p><i>Add new Sub-Clause 7.1(d)</i></p> <p>The Contractor shall also provide the raw materials, utilities, lubricants, chemicals, catalysts, Works, services and other matters required for testing and commissioning. The Contractor must provide all operating staff prior to Taking Over for testing and commissioning.</p>
7.7 Ownership of Plant and Materials	<p>The Contractor warrants that the Plant and Materials are or will at the point that ownership transfers to the Employer pursuant to this Sub Clause 7.7 and until the date of issue of the Taking-Over Certificate, be free of any lien, pledge, mortgage, charge, or encumbrance whatsoever (save in respect of any rights acquired by the Employer) and in the case of any Security Interest existing over any of the Plant or Materials (or part thereof), the Contractor shall register or procure the registration of a financing change statement wholly releasing each such Security Interest prior to transfer of ownership to the Employer pursuant to this Sub Clause 7.7.</p>
8 Commencement, Delays and Suspension	
8.1 Commencement of Work	<p><i>First paragraph, second sentence, delete "Particular Conditions" and substitute: "Preamble".</i></p>

- 8.3 Programme** *Delete the first two sentences of the first paragraph and substitute:*
- "The Contractor shall prepare a revised programme when required to do so by the Specification, or when instructed to do so by the Engineer. The period within which the Contractor shall submit a revised programme for approval, either having been asked to do so by the Engineer or following disapproval of a previous submission, is 7 days. Each revised programme shall show the effect of Variations, extensions of Time for Completion granted and how any delays are to be dealt with. The form of the programme shall be as set out in the Specification."
- Add the following after (d)(ii):*
- "(e) Any other requirements set out or required by the Specification."
- 9 Tests on Completion**
- 9.4 Failure to Pass Tests on Completion** *Add to the end of Sub Clause 9.4 (a):*
- "The Contractor shall at no cost to the Employer rectify, modify or replace the Plant and repeat the Tests as often as may be determined by the Engineer acting reasonably until the said Tests have been passed."
- Add the following to Sub-Clause 9.4*
- If the Contractor does not attend the Tests on Completion, the tests shall be deemed to have been conducted with the consent of the Contractor and the results of the tests shall be accepted as accurate.
- 9.5 Tests after Completion** *Add new sub-clause*
- Should the Engineer approve Tests on Completion or Functional Guarantee Tests taking place after Taking Over, the requirements of Clause 12 as modified by the Particular Conditions shall apply.
- 10.3 Interference with Tests On Completion** *Add new paragraph to before the final paragraph of this Clause*
- Nothing in this clause shall prevent the Engineer from instructed that the Tests on Completion be carried out as Tests after Completion
- 11 Defects Liability**

11.9 Performance Certificate

Delete the second paragraph and substitute:

"The Engineer shall issue the Performance Certificate within 28 days after the latest of the expiry dates of the Defects Notification Periods, or as soon as practicable thereafter, provided that the Contractor has supplied all the Contractor's Documents, completed and tested all the Works, including remedying any defects, and received an Acceptance Certificate pursuant to Sub Clause 12.5. For the avoidance of doubt, the Engineer shall not be obliged to issue the Performance Certificate until all of the above conditions have been satisfied."

Add the following at the end of the Sub Clause:

"The issue of the Performance Certificate shall not relieve the Contractor from any liability in respect of:

- (a) fraud or dishonesty relating to the Works or any part thereof or to any matter dealt with in the Performance Certificate;
- (b) any incidental or erroneous inclusion or exclusion in the Performance Certificate;
- (c) any unresolved issues the subject of a notice of dispute pursuant to Sub Clause 20.2, served before the seventh day after the issue of the Performance Certificate
- (d) any other deed or agreement entered into between the Employer and the Contractor (whether or not with any other parties) relating to all or any part of the Works."

11A Supplier Warranties

Add a new Clause:

"The Contractor shall obtain from any supplier of Plant for the Works warranties for defective product and workmanship ("the Supplier Warranties") on the relevant suppliers' usual commercial terms and for a period agreed upon between the Employer and the Contractor (acting reasonably) which period shall in any event not be less than, nor expire prior to expiry of, the Defects Notification Period. To the extent permissible the Supplier Warranties shall be assigned by the Contractor to the Employer to the intent that the Employer shall be entitled to the full benefit of such warranty. To the extent that the Supplier Warranties are not assignable, they shall be held on trust by the Contractor for and on behalf of the Employer to the intent that as between the Employer and the Contractor, the Employer shall be entitled to the full benefit of the Supplier Warranties. The Supplier Warranties shall not limit the obligations placed on the Contractor under this Contract. The Contractor shall take all necessary and reasonable steps to assist the Employer in the enforcement of any Supplier Warranties.

12 Tests After Completion**12.1 Procedure for Tests after Completion**

Delete the first sentence of Sub Clause 12.1 and replace with the following:

"If Tests after Completion are specified in the Contract, or if the Engineer agrees to Tests on Completion being delayed until after Taking Over in accordance with Clause 9.5 of the Particular Conditions, this Clause shall apply."

12.5 Acceptance Certificate

Add the following new Sub Clause to Clause 12:

"The Engineer will issue an Acceptance Certificate when the Works have met all requirements for Taking Over, and the Recommissioning Tests detailed in Part 8.15 for each Section have been completed either as part of the Tests on Completion or have been completed after Taking Over as Tests After Completion and fully meet all of the obligations under this Contract. The issue of an Acceptance Certificate does not affect the Defects Notification Period.

The Contractor may apply by notice to the Engineer for an Acceptance Certificate in respect of the Works or, if the Works are divided into Sections, in respect of each Section, at any time after completion of the Tests after Completion.

The Engineer shall, within 28 days after receiving the Contractor's application:

- (a) issue the Acceptance Certificate to the Contractor, stating the date on which the Works or Section were completed in accordance with the Contract, except for any minor outstanding work and/or defects which will not affect the use of the Works or Section for their intended purpose (either until or whilst this work is completed and/or these defects are remedied); or
- (b) reject the application, giving reasons and specifying the work required to be done by the Contractor to enable the Acceptance Certificate to be issued. The Contractor shall then complete this work before issuing a further notice under this Sub Clause."

13 Variations and Adjustments**13.5 Provisional Sums**

Delete the second sentence in (b)(ii)

13.8 Adjustments for Changes in Cost

Delete the Sub Clause and insert:

As stated in the Preamble the Contractor shall be permitted to adjust the price as the works proceed using the index method that is agreed at the commencement of the Contract, as detailed in the Letter of Acceptance.

(Add new paragraph to end of sub-clause)

Where a variation is granted the price shall be valid from the date the Engineer approved the Variation rather than from the Base Date.

14 Contract Price and Payment**14.1 The Contract Price**

(Add the following to sub-paragraph (e) as follows)

However, the Contractor shall be responsible for the payment of any redeemable bond posted by the relevant authorities in the Country in relation to the importation of the Contractor's Equipment.

14.6 Issue of Interim Payment Certificates

Replace the first paragraph of this Sub Clause with the following;

"No amount will be certified or paid until the Engineer has

received and approved the Performance Security and the certificates of insurance required from the Contractor in accordance with Clause 18 [Insurance]. Thereafter, the Engineer shall after receiving a Statement and supporting documents, issue to the Employer an Interim Payment Certificate which shall state the amount which the Engineer fairly determines to be due, with supporting particulars."

14.7 Payment

Add the following Sub Clause

14.7.1 Interim Payment Procedure

The procedures and timing for interim progress payments shall be as follows:

- (a) Each Statement shall be in writing and comply with the requirements of the Contract.
- (b) The Contractor shall submit each Statement to the Engineer by the seventh day of the month following the month in respect of which the Statement is calculated.
- (c) Within seven days of receipt of each Statement the Engineer shall issue a Payment Certificate in respect of the Statement and provide a copy to the Contractor.
- (d) Each Payment Certificate shall identify the Payment Claim to which it responds, indicate the amount that the Engineer fairly determines to be due and show the manner in which the amount due has been calculated.
- (e) If the amount indicated on a Payment Certificate differs from the amount claimed in a Statement, the Payment Certificate will provide reasons for the difference.
- (f) The Contractor shall submit a tax invoice to the Employer for the amount to be paid as shown on a Payment Certificate within five days of receipt of the Payment Certificate.
- (g) Subject to compliance by the Contractor with the provisions of this Sub Clause, the Employer will pay the invoiced amount within 56 days following receipt of the Contractor's tax invoice.
- (h) For the purposes of interpreting the requirements of the Contract:
 - (a) The Employer acknowledges that all Payment Certificates issued by the Engineer shall be regarded as payment schedules and that the Engineer has the full authority and support of the Employer in issuing such payment schedules or certificates in the Employer's name; and
 - (b) The Contractor acknowledges that the Engineer has the full authority and support of the Employer in issuing the payment schedules or certificates and the Contractor acknowledges that the Employer can only make payment against correct tax invoices prepared by the Contractor for the amount specified in the payment schedules or certificates."

14 Delayed Payment

Delete the second paragraph and substitute:

"Financing charges shall be calculated using the annual interest rate as set out in the Preamble."

- 14.11 Application for Final Payment certificate** *Delete the last sentence and substitute:*
"Thereafter, if the dispute is finally resolved under Clause 20, the Contractor shall then prepare and submit to the Employer (with a copy to the Engineer) a Final Statement.
- 14.13 Issue of Final Payment Certificate** *Add at the end of the Sub Clause:*
"The Contractor shall submit a tax invoice to the Employer for the amount to be paid as shown on the Final Payment Certificate within five days of receipt of the Payment Certificate.
Subject to compliance by the Contractor with the provisions of this Sub Clause, the Employer will pay the invoiced amount within 56 days following receipt of the Contractor's tax invoice."
- 14.15 Currencies of Payment** *Add at the end of the Sub Clause:*
"No adjustment of the Contract Price shall be made for any fluctuations in the rate of exchange between the currency of the Contractor's country of origin and any other currency."
- 14.16 Fiji Islands Taxation** *Add new sub-clause 14.16 to Clause 14*
- 14.16.1 Withholding Tax** *(Add a new sub-clause 14.16.1 stating :)*
The Contractor must include 15% as withholding tax in their invoices for the labour component of on-shore costs.
- 14.6.2 Company Tax** *(Add a new sub-clause 14.16.2 stating:)*
The Contractor is responsible for paying all income tax due on profits earned in Fiji. The Employer will not compensate the Contractor for this taxation.
- 14.6.3 Personal Tax** *(Add a new sub-clause 14.16.3 stating:)*
The staff of the Contractor are responsible for paying all income tax due on income earned in Fiji. The Employer will not compensate the Contractor, or its staff, for this taxation, regardless of whether the staff are Fijian nationals or residents of another country.
- 14.17 Direct Payment** *(Add new Sub-Clause 14.17 as follows)*
Before issue of the Final Payment Certificate, the Employer may pay unpaid moneys owed by the Contractor to a worker or a subcontractor directly to that worker or subcontractor, where:
- a) permitted by law;
 - b) given a court order in favour of the worker or subcontractor; or
 - c) Requested in writing by the Contractor.
- Such payment made to a worker or subcontractor in compliance with a legislative requirement shall be deemed to be part-satisfaction of the Employer's obligation to pay pursuant to Sub-Clause 14.7 [Payment].

15 Termination by Employer

- 15.2 Termination by** *Add the following sub-paragraph (g):*

Employer

"(g) commits any other material breach of the Contract which is not remedied within 14 days of receiving notice of the breach from the Employer,"

Add the following at the end of the last paragraph of Sub Clause 15.2:

"Without limiting the foregoing provisions, upon termination of the Contractor's employment under the Contract, the following shall apply:

- (a) the Contractor shall, when and if required by the Employer, assign to the Employer all of its rights under all or any of the subcontracts;
- (b) the Contractor shall co-operate with the Engineer in the transfer of information and disposition of work in progress so as to mitigate the cost to the Employer of the termination of the Contractor's employment;
- (c) the Contractor shall comply with all other reasonable requests from the Engineer and co-operate with and provide all reasonable assistance to the successor contractor (if any) and/or the Employer following the termination of the Contractor's employment to ensure that there is a smooth and efficient handover of the Works to any successor contractor and/or the Employer as the case may be;
- (d) if requested to do so by the Employer, the Contractor shall assign to the Employer any or all of the Contractor's rights under the Contractor's shipping documentation (if any) for items of Plant and/or Materials to be supplied for incorporation into the Works and execute all documentation and do all things reasonably required by the Employer to effect such assignment, within 14 days of being requested to do the same;
- (e) the Employer may pay any Subcontractor for any Materials or Goods delivered or works executed for the purpose of the Contract (whether before or after date of termination) insofar as the price thereof has not already been paid by the Contractor. Payments made under this Sub Clause may be deducted from any sums due or to become due to the Contractor. It is a condition of this contract that the Contractor is entitled to be paid any such sum as, in the event of termination and the making of any direct payments pursuant to this Clause 15 [Termination by Employer], may remain after the amount equivalent to such direct payment has, in addition to any other amounts certified by the Engineer under this Sub Clause, been debited against the Contractor;
- (f) the Contractor shall provide to the Employer upon request and as a precondition to receiving any payment under this Clause 15 [Termination by Employer], such evidence as the Employer shall reasonably require to satisfy the Employer that property in all Plant and Materials which have been supplied by the Contractor to the Employer has vested (or will upon such payment vest) in the Employer."

17 Risk and Responsibility

-
- 17.4 Consequences of Employer's Risks** *First paragraph, delete the word "Goods" in the second line.*
- 17.6 Limitation of Liability** *Add the words:*
"Sub Clause 8.7 [Delay Damages]" after the word "under" on line 3.
- 18 Insurance**
- 18.1 General Requirements for Insurances** *Fourth paragraph; replace the first sentence with the following:*
"Where the Contract requires insurance to be effected in joint names:
1. The cover shall apply separately to each insured as though a separate policy had been issued for each of the joint insured.
2. The policy or policies shall provide for waiver of subrogation with respect to each of the insured."
Sixth paragraph; replace "the respective periods stated in the Appendix to Tender" with "14 days".
- 18.2 Insurance for Works and Contractor's Equipment** *The Employer shall be the insurer for project works on site. The Contractor is responsible for the insurance of the Project Works while in their possession and in transit to and from the site.*
Fourth paragraph, sub-paragraph (d), replace "the amount stated in the Appendix to Tender" with "\$AUD50,000.00 or as may otherwise be agreed by the Employer".
- 18.3 Insurance against Injury to Persons and Damage to Property** *Second paragraph, replace "Appendix to Tender" with "Preamble".*
Third paragraph, delete sub-paragraph (d)(i)
- 18.5 Professional Indemnity Insurance** *Add the following new Sub Clauses to Clause 18:*
"The Contractor shall effect and maintain professional indemnity insurance, which shall cover the risk of professional negligence in the design of the Works, for an amount not less than that specified in the Preamble for any one claim or series of claims arising out of the same occurrence.
- 18.6 Motor Vehicle Third Party Liability Insurance** *"The Contractor shall effect and maintain, until expiry of the Defects Notification Period, motor vehicle third party liability insurance for an amount not less than that specified in the Preamble for any of the Contractor's vehicles used and operated in Fiji."*
- 20 Claims, Disputes and Arbitration**
Delete Sub Clauses 20.2 to 20.8 inclusive and substitute the following Sub Clauses:
- 20.2 Disputes** *"If either party is dissatisfied with a decision or instruction of the Engineer, or if no decision is given by the Engineer within a prescribed time frame under this Contract or there is some other dispute between the Contractor and the Employer in relation to*
-

this Contract, then the dissatisfied party may refer the matter to mediation or arbitration pursuant to Sub Clauses 20.3 or 20.4 respectively.

Unless the dissatisfied party has notified the other party and the Engineer within 28 days of such decision or instruction of its intention to refer the matter to mediation or arbitration it shall be deemed to have accepted the decision or instruction as final."

20.3 Mediation

"Where a request for mediation is made the parties shall endeavour to agree on a mediator and shall submit the dispute to him/her. The mediator shall discuss the matter with the parties and seek to resolve the dispute by agreement. All discussions in mediation shall be without prejudice and shall not be referred to in any later proceedings. The parties shall bear their own costs in the mediation and shall each pay half the costs of the mediator.

The parties may at any stage agree to invite the mediator to give a decision to determine the matter. The mediator's decision shall in such case be binding on both parties unless within 14 days either party notifies the other in writing that it rejects the mediator's determination.

If:

- (a) Mediation has been requested but has not been agreed upon within 14 days of the request, or
- (b) Within 14 days of mediation being requested the parties have been unable to agree upon a mediator, or
- (c) No agreement has been reached in mediation and no determination has been issued by the mediator within 56 days of the request for mediation, or
- (d) either party has, within the prescribed time rejected the mediator's determination,

then the matter may be referred to arbitration."

20.4 Arbitration

"A notice requiring arbitration shall be in writing and shall be given by the dissatisfied party in accordance with the time frame in Sub Clause 20.2 [*Disputes*] or within 28 days after the happening of the event in Sub Clause 20.3 [*Mediation*] which gives rise to the arbitration.

Arbitration shall be in accordance with the Rules of Arbitration of the International Chamber of Commerce (ICC). The law governing the procedure and administration of any arbitration is Republic of the Fiji Islands law. The place of arbitration shall be Suva, The Fiji Islands

The arbitrator shall have full power to open up, review and revise any decision, opinion, instruction, direction certificate or valuation of the Engineer and to award on all questions referred to him/her. Neither party to the arbitration shall be limited to the evidence or arguments put before the Engineer or put before a mediator.

No decision given by the Engineer in accordance with his/her duties under the Contract shall disentitle him/her from being called as a witness and giving evidence before any hearing on any matter relevant to the dispute.

Where the matter has been referred to mediation the mediator shall not be called by either party as a witness, and no reference

shall be made to the determination, if any, issued by the mediator in respect of the matter in dispute."

20.5 Works to Continue

"Performance of the Contract shall continue during mediation or arbitration proceedings unless the Employer shall order suspension. If any such suspension is ordered the documented costs incurred by the Contractor and occasioned thereby shall be added to the Contract Price.

No payments due or payable by the Employer shall be withheld on account of pending reference to mediation or arbitration."

Appendix and Annex

delete

5 Specification – Preliminary and General

5.1 General

5.1.1 Location

The Site of the proposed Works is the Wailoa powerstation on Viti Levu in the Republic of the Fiji Islands. The site is normally accessed by road from the Capital, Suva.



Figure 1 – Viti Levu Island, Fiji. Approximate site location shown in red box

5.1.2 Access

Only construction vehicles will be allowed in the construction zone. All other vehicles shall be parked in the designated contractor staff car parking areas.

5.1.3 Site

The Contractor and his/her staff shall comply with the Employer's requirements for external contractors when working on the Site.

5.1.4 Construction Activities to be provided by the Employer

The Employer will provide the following services and construction work as part of this project;

- a) Installation of the replacement 11kV switchgear assemblies, including supply and installation of all cabling systems between the 11kV switchgear assemblies and other powerhouse systems.

- b) Provide accommodation, free of charge for the Contractor's installation supervision and commissioning personnel at Wailoa Camp which is approximately one kilometre from the power station. The contractor will need to arrange their own food but the Employer can assist in arranging a cook and cleaner to be available;
- c) The Contractor must provide its own accommodation at other locations in Fiji;
- d) The Contractor is required to co-operate with the Employer in all respects in the provision of these services.

5.2 Payments

Payment will be made on completion of milestones as set out below:-

Milestone	Milestone Payment Basis	Maximum Milestone Payment
The following applies to each of Sections 1 to 4		
Advance Payment	Lump Sum	10% of Contract Price.
Basic Design Submittal	Lump Sum on acceptance of submittal by Employer	5% of Contract Price
Detailed Design Submittal	Lump Sum on acceptance of submittal by Employer	10% of Contract Price
Manufacture and delivery of parts for shipment to Fiji.	Lump Sum on successful completion of the factory acceptance tests and presentation of shipping bill of lading and insurance documents for each Contract Section.	13.75% of Contract Price for each Contract Section
On Taking Over of each Section	Lump sum	3.75% of the Contract Price for each Contract Section
On Acceptance of each Section	Lump sum	1.25% of the Contract Price for each Contract Section
Defects Notification Period	Covered by a 5% Performance Bond for each Section – no retentions. 5% retentions will be held until the revised Performance Bond is received	

Delivery shall mean delivery to the project site or other store in The Fiji Islands as may be approved by the Engineer. For overseas sourced items manufactured specifically for this contract, payment will be made on presentation of certified shipping documents.

5.3 Programme

The following programme shall apply for the refurbishment of each of Sections 1 to 4 of the Contract. Please note one week equals seven days as defined in the General Conditions of Contract. All durations for each Section are cumulative starting on the Commencement Date of that Section.

Activity	Section 1 Duration	Section 2 Duration	Section 3 Duration	Section 4 Duration
Basic Design Report	4 weeks			
Approval of Basic Design Report	14 days			
Preparation of detailed design report and detailed construction drawings	4 weeks			
Approval of detailed design report and construction drawings	14 days			
Manufacture and factory testing of 11kV switchgear assemblies	30 weeks	30 weeks	30 weeks	30 weeks
Transport items required for rehabilitation to site	8 weeks	8 weeks	8 weeks	8 weeks
Outage period for rehabilitation	90 days	90 days	90 days	90 days
Commissioning and Tests on Completion	14 days	14 days	14 days	14 days
Trail Operation	720 hours	720 hours	720 hours	720 hours
Defects Liability Period	12 months	12 months	12 months	12 months
Total Duration (Days)	417	678	789	1062
Preliminary Site Installation Dates				
Outage Commence	11 July 2017	30 March 2018	19 July 2018	19 April 2019
Tests on Completion Completed and Unit returned to service (Taking Over)	23 October 2017	12 July 2018	31 October 2018	1 August 2019
Trial Operation Complete (Acceptance)	22 November 2017	11 August 2018	30 November 2018	31 August 2019
Defects Notification Period Ends	17 November 2018	6 August 2019	25 November 2019	25 August 2020

As numerous other upgrade works will be taking place concurrently on the turbine generator unit there will be no opportunity to commission each Section earlier than the scheduled dates.

A detailed schedule must be provided 4 weeks after the Contract Acceptance date and revised 4 weeks prior to commencing any work on site.

5.4 Training

As part of this contract the Contractor shall include comprehensive training of the staff to levels suitable for accreditation to ISO 9001/2.

Included in the training shall be:-

- Description of the entire plant;
- Operation of the plant (hands on) in all modes;
- Identification and function of all plant components;
- Performance assessment;
- Routine maintenance and annual servicing procedures and requirements;
- Identification of faults and trouble-shooting;
- Reporting;
- Safety; and
- Use of the Manuals.

The Contractor shall be required to demonstrate to the Engineers satisfaction that he has adequately trained the nominated staff members so they have been well trained and are fully conversant with all aspects of operation, maintenance and procedures associated with the Plant.

The Acceptance Certificate will not be issued until all training requirements have been satisfied.

5.5 Tests on Completion

5.5.1 Tests on Completion

The Tests on Completion for each Section are detailed in Part 8.13 of the Specification.

5.5.2 Tests after Completion

It is expected that all Tests on Completion of the each 11kV switchgear assembly will be completed before Taking Over is granted. However, the Employer may require some or all of the Tests on Completion to be carried out as Tests after Completion owing to station operating requirements.

5.5.3 Acceptance Certificate

When the above tests are successfully completed the Engineer will issue an Acceptance Certificate confirming the tests have been carried out and the test criteria has been met.

5.5.4 Performance Shortfall during Defects Notification Period

Should any performance shortfall be identified during the Defects Notification Period, the Contractor shall be responsible for taking immediate steps to determine and effectively correct the fault. The performance test shall be repeated by the Contractor after any resulting plant modifications.

5.6 Site Services

5.6.1 Electricity

A 400 VAC, 4 wire plus earth, 3 phase 50 Hz and a 230 VAC, two wire plus earth, single phase 50 Hz power supply adequate for the Contractor's nominated requirements will be made available. Supply will be available by arrangement at all hours but liability will not be accepted by the Employer for any loss, damage or inconvenience created resulting from the total or partial interruption of the supply.

5.6.2 Water Supply

A potable water supply is not available at the Site for construction use. The Contractor will be required to make his own arrangements for the provision of bottled water and beverages for staff. .

5.6.3 Fire Protection

The Contractor shall provide fire extinguishers of an appropriate capacity and type at all locations where work is carried out.

5.7 Health and Safety

5.7.1 Health and Safety Procedures

The Contractor's and Sub-contractor's employees on Site shall adhere to the safety procedures established for the Site including: any lawful instruction given to them by an authorised person; emergency and evacuation procedures; the use of fire-fighting appliances; the observance of all industrial regulations relating to the Works; the observance of the shutdown of plant procedures and compliance with Site plant isolation procedures.

All Contractor employees including any Sub-contractor's employed on Site shall attend Site Induction Courses as required prior to the start of work on Site. All work on site shall be subject to and comply with the Site Health and Safety Policy, which is available to the Contractor upon request.

5.7.2 Health and Safety Regulations

The Contractor is required to ensure that the requirements of The Fiji Health and Safety at Work Act 1996 along with the Health and Safety in Employment Regulations and various Codes of Practice are observed by its own employees and those of his Sub-contractors and shall submit, prior to commencing the Works, a Site record sheet to the Engineer that confirms that all employee have been given the current information covering health and safety. The Contractor shall submit an updated Site record sheet weekly.

5.7.3 Accidents

The Contractor shall promptly report within 24 hours in writing to the Engineer all accidents and incidents that caused injury, illness and those that might have caused injury. In addition, if death, serious injury, or serious damages are caused, the accident shall be reported immediately by telephone or messenger to the Engineer and The Occupational Safety and Health Department. If any claim is made by anyone against the Contractor as a result of any accident, the Contractor shall promptly give a complete report of the facts in writing to the Engineer giving full details of the claim, including witnesses, statements, sketches and the like.

5.7.4 Barricades

Barricades, fences or guard-rails must be provided around all excavations or openings where there is a risk of persons falling into them. Such barricades shall be erected after the completion of the day's work and/or when the Site is left unattended and shall be brightly coloured and clearly visible at night. Such barricades shall not be removed without written permission by the Contractor's Safety Supervisor.

5.7.5 Safety Supervisors

The Contractor's Safety Supervisor nominated for the Site shall have their name displayed on all facilities and the person's name is to be known by all employees and in accordance with The Fiji Health and Safety at Work Act 1996. The Contractor's Safety Supervisor shall be responsible for all safety matters and shall liaise with the Engineer.

5.7.6 Security Fencing

The Contractor is not required to provide security fencing around the perimeter of or within the Site. However, the Contractor shall be responsible for the provision of all temporary fences, barriers and signage as appropriate to effectively isolate hazards associated with the works.

5.7.7 Protective Helmets and High Visibility Jackets

The Employer will designate protective helmet areas. All Contractors' employees, sub-contractors employees, visitors and delivery personnel shall wear a hard hat at all times within such designated areas. Contractors must advise all appropriate people. Hard hats are to be replaced every three (3) years and are not to be painted. Only the company logo may be attached.

High visibility jackets shall be worn at all times and in all areas designated by the Employer.

5.7.8 Lighting

The Contractor shall provide artificial lighting when natural lighting becomes inadequate at any walking access-way and construction space. The artificial lighting may be by either the permanent lighting installation or by a temporary installation which is later removed once the permanent installation is complete.

5.7.9 Radios

No broadcast frequency radios, Walkman's, radio cassettes CD players, MP3 players, or other similar devices shall be permitted on the construction work areas.

5.7.10 Safety Signs

The Contractor's employees shall observe and comply with all safety signs displayed about the Site. These signs inform personnel both of safety equipment that is required and the hazards that personnel may encounter in special areas.

5.7.11 Alcohol & Illegal Drugs and Substances

Illegal drugs and substances are not permitted on Site. Alcohol must not be brought on Site or be consumed on Site unless approved by the Site Manager. Personnel reporting for duty or seen on Site under the influence of drugs, substances or alcohol will not be allowed to commence work and will be asked to leave the Site.

5.7.12 Animals

Animals are not permitted on Site.

5.7.13 Children

Children under the age of 15 are not permitted on Site.

5.7.14 Contractor's Responsibilities for Health and Safety

The Employer requires the Contractor to comply with safety regulations detailed herein. Compliance with these safety regulations shall not relieve the Contractor of his obligations under the Contract, The Fiji Health and Safety at Work Act 1996, and any amendments thereto.

The Contractor shall:

- Ensure that Contractor and Sub-contractor employees have the necessary skills, qualifications and are supervised by trained personnel to perform the contracted Works safely;
- Audit the performance of Contractor and Sub-contractor employees to ensure compliance to Health and Safety at Work Act 1996 and Site requirements and report each month in the prescribed form to the Engineer. In addition, the Contractor shall report weekly to the Engineer as to the total number of personnel (including Sub-contractors) employed on Site over the last week;
- Inform the Engineer of Health and Safety hazards presented by the Contractor's or Sub-contractor's Works;
- Inform the Engineer of Health and Safety hazards found by Contractor or Sub-contractor whilst undertaking Works;
- Ensure that Health and Safety equipment and clothing is supplied to protect Contractor and sub-contractor employees from the hazards their work creates and that all steps have been taken to prevent harm to other people in the area from the hazard created; and
- The Contractor has the responsibility for informing each Sub-contractor of Health and Safety hazards they may be exposed to and the controls in place to protect them including hazards that may be created by other contractors.
- The Contractor shall run minuted toolbox meetings involving all staff working on site.

5.7.15 Fire Regulations

The Contractor shall provide and maintain adequate fire prevention equipment facilities in areas of potential fire hazard, including, but not limited to, portable fire extinguishers, fire protection mats and fire watchers. In the event of any fire, the Contractor shall take all steps necessary to extinguish the fire and contain its effects and shall report promptly in writing to the Engineer the cause and extent of damage resulting there from.

5.7.16 Housekeeping

The Contractor is responsible for keeping all work areas free from accumulated rubbish at all times and shall deposit rubbish in the central rubbish skips.

5.7.17 Responsibility - Employer

The Employer will:

- Document procedures for Contractor and Sub-contractor personnel movements in and out of the Site or nominated work areas;
- Advise the designated Site Health and Safety Officer;
- Facilitate regular Health and Safety meetings with Contractor's Occupational Health and Safety representatives; and
- Undertake Health and Safety Audits.

5.8 Contractor's Administration

5.8.1 Contractor's Supervisor

The Contractor shall appoint a properly qualified and experienced supervisor to control and direct his staff at Site and the appointed supervisor or replacement approved by the Engineer shall be on Site whenever members of the Contractor's staff are working. The supervisor shall not be replaced except by agreement with the Engineer.

The Contractor's supervisor shall be entirely responsible for the direction of employees of the Contractor and shall be given authority to negotiate and agree points arising out of the erection in order to minimise delays. All instructions from the Engineer will be issued to the appointed supervisor.

5.8.2 Meetings

Meetings will be convened by the Engineer at regular intervals which will not be less frequent than monthly and may be weekly at critical periods. The Contractor shall ensure that a senior person conversant with the project and with decision making authority attends each meeting.

5.9 Co-operation

The Contractor shall co-operate with Site staff, and other contractors on the Site as applicable, to ensure an orderly programme.

5.10 Site Operations

5.10.1 General

At all times the Contractor and his work force shall observe the Employer's requirements in regard to safety and power scheme operating conditions and shall carry out no acts which would, or have the potential to, cause damage or down-time of any Site operations.

5.10.2 Site Specific Entry Conditions

The Contractor is required to ensure that he and all employees and sub-contractors comply with all Site specific entry conditions as may be issued by the Employer from time to time.

5.11 Delivery Procedures

In the event of plant or sections thereof being supplied from outside The Fiji Islands, such plant shall be delivered to a port in the country of manufacture for direct shipment to the specified port in Fiji. Plant must not be shipped on deck unless in containers.

The Contractor shall:

- Arrange for a mutually approved authority to inspect the manufacture, witness testing of the plant and certify that materials, tests and specifications meet the Employer's requirements and comply with the requirements of those codes specified by the Employer;
- Arrange an independent survey certificate verifying that the packing is adequate and sufficient for the required land, ocean and/or air transit to the final destination determined by the Employer certifying in particular that the packing complies with Fiji Government Regulations;

- the wooden packing cases or timber used in packing machinery for shipment are free of bark and/or obvious insect damage, are certified and cleared by the overseas shippers and that all packing is clean and new;
- Supply to the Employer copies of both of these certificates with the shipping documents; and
- Indemnify the Employer against all liabilities, claims, costs and expenses that may result from failure of the Contractor to comply with the above mentioned conditions;

All wooden packing cases or timber used in packing machinery from overseas shall be fumigated prior to delivery to Site and following equipment unpacking it shall be delivered to a nominated Site area for incineration. This material shall not be used on Site for construction activities.

5.12 Manuals and As-Built Drawings

The Contractor shall provide three securely bound sets of Operating and Maintenance Manuals together with three copies of as built drawings including full process and instrumentation diagrams. A full draft manual shall be provided prior to the issue of a Taking-Over Certificate with three copies of the final revision provided, at least one copy to be on CD-ROM.

The information provided with each manual shall include but not necessarily be limited to:

- Design specifications;
- Serial numbers of the package, the electrical motors and all individual components as applicable;
- All manufacturers' components design specifications, model numbers and information;
- Operating instructions for starting up, running and shutting down of all systems;
- Full instructions for adjustments and settings;
- Full commissioning and test records;
- Full lubrication instructions;
- Full maintenance manuals to enable the Employer to carry out their own maintenance;
- Full plant log and inspection and maintenance schedules;
- Full electrical schematics of the controls including all wiring diagrams;
- Function descriptions and automation software programmes and listings including a copy in electronic form;
- Full spare parts list for the complete package; and
- List of critical and recommended spares.

The final format of all such manuals and drawings shall be agreed with the Engineer prior to their preparation.

Drawings shall also be supplied as hard copies and also in electronic form. All plant layout and P&ID drawings shall be provided in AutoCAD or similar format.

5.13 Existing Equipment

Existing equipment to be reused and where necessary modified by the Contractor shall be inspected jointly by the Contractor and Engineer. Where the equipment to be reused requires repairs and/or maintenance beyond that which could reasonably have been foreseen by the Contractor, the Contractor and Engineer shall agree the extent of the additional work and the costs thereof. If during the course of the alterations to an item of existing equipment it becomes apparent that repair work is required, the Engineer and Contractor shall inspect the work and agree the extent of any additional work and the cost.

5.14 Documentation and Approvals

The Contractor shall allow 14 days for the approval by the Engineer of all drawings, schedules and documents as required under this Contract unless such lesser time is agreed in writing by the Engineer. The Contractor shall allow for up to four copies of each and every drawing and document necessary for the approval of the proposed plant and for the subsequent operation and maintenance of the plant. Electronic copies of CAD drawings shall also be provided in AutoCAD format.

5.15 Substitutions

All components and engineering specifications shall comply with the technical specification unless agreed to in writing by the Engineer.

Substitutions of alternative equipment or brands of component types shall be approved by the Engineer in writing prior to commitment and installation.

5.16 Industrial Relations

The Contractor shall keep the Engineer fully informed of all claims made or other industrial relations matters which may affect the Site or the Employer's activities and shall take all reasonable steps to avoid actions or inactions which will prejudice the Employer.

The Employer instructs the Contractor not to enter into any specific Site agreement, or redundancy agreements and shall not employ workers at the Site nor specifically for the Site nor specifically for this Contract but for general work at unspecified locations. Any actions in contravention of these preferences are likely to be prejudicial to the Employer and therefore not acceptable.

5.17 Quality Systems and Standard Compliance

The Contractor shall implement full Quality Management System procedures on all aspects of the Work from and including initial design to final documentation.

The Engineer reserves the right to arrange an independent assessment of the Contractor's or Plant Suppliers Quality Management System if quality systems procedures in use on the Contract are considered by the Engineer to be deficient.

5.18 Goods and Contractor's Plant

All Goods and mechanical plant used by the Contractor in the execution of the Works shall be of such type, size and shall be utilised in such a manner as the Engineer shall approve. The Engineer's approval to use mechanical plant will not be unreasonably withheld, but if in the Engineer's opinion, circumstances arise which make it desirable that the use of plant be suspended either temporarily or permanently, the Contractor shall change the method of performing the work affected and shall have no cause for claim against the Employer on this account nor shall there be cause for claim if any order by the Engineer results in the mechanical plant having to stand idle for a period of any duration whatsoever or having to be removed.

The Contractor shall use every possible means to prevent noise and annoyance to the inhabitants of the area in which the Works are situated, and all machinery must be of such design and so arranged as to be reasonably free from noise in operation. The Contractor shall have no claim for any charges involved in complying with the requirements of this clause.

5.19 Construction Photographs

Before commencing and during the progress on any part of the Works, the Contractor shall permit and if required, shall render assistance in the taking of such photographs as the Engineer may require.

5.20 Advertising

The Contractor shall treat the Contract and everything within it as private and confidential. In particular the Contractor shall not publish any information, drawing or photograph relating to the Works and shall not use the Site for advertising purposes except with the written consent of the Engineer and subject to such conditions as the Engineer may prescribe.

5.21 Existing Services

The Contractor is to leave all existing services, in place unless otherwise directed by the Engineer.

5.22 Protection of Works

Where required, the Contractor shall cover and protect the Works and all plant and equipment from inclement weather and damage as the Works proceeds. Any work, materials, plant or equipment suffering damage shall be made good at the Contractor's expense.

6 Specification - Introduction

6.1 Scope of Supply

The Contractor shall furnish all labour, materials and equipment required to design, manufacture, factory test, deliver to the Site, commission and start-up four (4) sets of 12 kV, 3-phase, 3-wire indoor metal-clad switchgear for the existing generators. Each generator switchgear assembly shall comprise either air-insulated switchgear (AIS) or gas-insulated switchgear (GIS), equipped with vacuum type generator rated circuit breakers.

Equipment used shall be a type having an established reputation of two years or more of satisfactory and reliable service, designed for hydroelectric generators 20 MVA and larger. The requirements of this specification for the design apply to all units.

Equipment and accessories shall be, to the greatest extent practicable, of a type which is readily available in the domestic market or which can be readily imported from Australia or New Zealand. The names of manufacturers of mechanical and electrical auxiliary equipment to be incorporated into the Work, together with performance characteristics, and other significant information, including specification sheets, equipment data, shall be submitted to the Employer for review and acceptance.

Equipment shall not be incorporated into the Work without prior review and acceptance by the Employer.

The erection, field testing and commissioning of the four (4) sets of switchgear will be performed by others, with the Contractor providing supervision for the first set. The Contractor shall provide complete erection instructions, field test plans, pro-forma test record sheets (including acceptance criteria) for the switchgear. The Contractor shall also provide Operating and Maintenance manuals for the switchgear, which shall include space for the Employer to insert the field test records once completed.

The Contractor shall provide two (2) one day duration on-site training sessions for the Employers Operating and Maintenance staff. The training sessions are to be provided during the commissioning phase of the first set of switchgear.

6.2 Existing Plant

6.2.1 Generator Switchgear

The existing TIBB 11kV switchgear installed at Wailoa Power Station is some 30 years old and uses air break circuit breaker technology. On units 1 and 2 the existing switchgear has a stub connection for the auxiliary transformers (TA and TB respectively). The existing switchgear is to be removed and replaced with the equipment described in this specification. Part of the O&M manual for the existing switchgear is provided in Section 4. Figures 1, 2 and 3 below show the existing 11kV switchgear:-



Figure 1 - Front View - Cables to Unit Transformer



Figure 2 - Front View - Cables to Auxiliary Transformer (Units 1 and 2 only)



Figure 3 - Rear View - Cables from Generator

6.2.2 Generators

The four existing generators are vertical shaft, synchronous type. Each generator is rated at 24,500kVA and 11kV output. Each generator has high-resistance neutral earth consisting of a dry-type distribution transformer connected in the neutral of the generator with a loading resistor on the secondary winding.

The generators will be connected by cables to the 11kV switchgear. In addition each generator is being provided with a new excitation system. Each excitation transformer will be directly connected by cables to the respective generator circuit breaker (generator side).

6.2.3 Generator Step-Up Transformers

The power plant is provided with four 25 MVA, 11 kV / 132 kV generator step-up transformers (one per generator) for transformation between generator voltage and transmission voltage.

The transformers have recently been replaced, the Contractor is to note that the impedance of each transformer is 10.8 %.

6.2.4 Station Service System

The station service system is 415 V / 230 V, solidly earthed, and designed to provide power for all systems installed in the powerhouse that are fed by the two auxiliary transformers TA and TB. Each 11kV / 433V Auxiliary Transformer has a rated capacity of 300 kVA.

The Generator Switchboards for Unit 1 and Unit 2 respectively shall each be fitted with a switch disconnector/fuse assembly and a SEL protective relay to feed the Auxiliary Transformers TA and TB.

6.2.5 Switchgear Location

The existing 11kV switchgear is 1.6m (W) x 2.3m (D) x 2.3m (H), with the Unit 1 and 2 panels being 0.8m wider in order to accommodate the Auxiliary Transformer connection.

A maximum space of some 3.6m (W) x 2.0m (D) x 2.6m (H) is available for the new switchgear. The Contractor's layout drawings are to show the proposed method of routing all 11kV cables into the two switchboard types and also the drawing out space required for removing the generator circuit breaker.

7 Specification - General Requirements

The following sections and paragraphs written in the singular form for one generator switchgear system shall apply equally to all generator switchgear systems furnished, except where specifically indicated otherwise, in particular the additional requirements for the generators Unit 1 and Unit 2 to include for the Auxiliary Transformer connections.

The basic materials and methods shall be in accordance with the Common Requirements Specification.

7.1 Submittals

Submittals shall be provided in accordance with the requirements of Section 1.3 of the Common Requirements Specification.

7.1 Basic Design

The following documents shall be provided:

- a) Drawings
 - General arrangement of the switchboards, including foundation arrangement, major outline dimensions and elevations.
- b) Documents
 - Technical description of the switchgear including brochures.
 - Design criteria and calculation sheets for the main equipment design.
 - Type test certificates for the switchgear.
 - Manufacturing quality control plan.
- c) Standards
 - A list of all design codes and standards being used.
- d) Generator switchgear data required in Section 8.18.

7.2 Detailed Design

The following detailed design documents shall be provided:

- a) Outline Drawings.
- b) Detail Drawings
 - Switchgear front, rear and side views.
 - Inside view of equipment arrangements, including terminal blocks and cable entrance details for external cables.
 - Conduit and cable entrances connections and bushing details.
- c) Schematics.
- d) Documents
 - Factory acceptance test plan.
 - Erection and commissioning quality control plan.
 - Operating and Maintenance manual

7.3 Records and Instructions

The following records and instructions shall be provided:

- a) Factory Test Reports.
- b) Type Test Reports.
- c) Instructions:
 - Factory Assembly and Testing Procedures
 - Handling and Storage Instructions
 - Installation Instructions.
 - Operating and Maintenance Instructions.
 - Field Testing, Pre-Commissioning, Commissioning Procedures of Check-Out, Start-Up, Initial Operation and Testing.
- d) As built drawings.

7.4 Standards and Codes

The Contractor shall comply with requirements of the Common Requirements Specification and the latest revisions of applicable industry standards, specifically including the following:

7.4.1 Air or Gas Insulated Switchgear

- IEC 62271-200 - High-voltage switchgear.
- IEC 62271-1 - High-voltage common requirements.

7.4.2 Circuit Breakers

- IEC/IEEE 62271-37-013 – AC generator circuit breakers.

7.4.3 Current Transformers (CTs)

- IEC 61869-1 – Instrument transformers – general requirements.
- IEC 61869-2 – Instrument transformers – requirements for current transformers.

7.4.4 Voltage Transformers (VTs)

- IEC 61869-1 – Instrument transformers – general requirements.
- IEC 61869-3 – Instrument transformers – requirements for inductive voltage transformers.

7.4.5 Disconnectors and Earthing Switches

- IEC 62271-102 – Disconnectors and earthing switches.

8 Specification – Generator Switchgear Description

8.1 References

Equipment shall comply with international technical requirements and applicable IEC standards. All equipment shall be designed and manufactured according to well-proven technology.

8.2 Generator Switchgear

The replacement generator switchgear including generator circuit breaker shall be designed to provide coordinated operation of the generator and provide safe connection and disconnection of the generator from the step-up transformer and, where fitted, from the station services transformer under normal and abnormal conditions.

The design and construction of the metal-clad switchgear assembly shall conform to the applicable requirements of IEC Standards and shall meet the requirements of these Employer's Requirements.

The switchgear shall be of the indoor heavy-duty type, rated 12 kV and not less than 75 kV basic impulse insulation level. The full-load temperature rise shall not exceed the limits established by IEC Standards.

The switchgear shall be of self-supporting and dead-front construction complete with insulated busbars, vacuum generator circuit breaker, current and voltage transformers, surge protection equipment, terminal blocks, control wiring, and other miscellaneous devices as called for in this specification.

The generator vacuum circuit breakers shall be suitably rated for generator fault conditions. Where required, the switchgear shall incorporate arc flash sensors to help minimise hazards to operating personnel.

The ratings and characteristics of the MV Switchboard shall be as follows:

a. Installation	Indoor
b. Frequency	50 Hz
c. Number of phases	3
d. Short circuit current (3 sec)	25kA
e. Short circuit current (peak)	75kA
f. Rated voltage, kV rms	11kV
g. Highest system voltage	12kV
h. Basic impulse level, Peak	75kV
i. Power frequency withstand voltage during one minute	28kV
j. Internal Arc Classification (IAC)	AFLR
k. Loss of Service Continuity Category (LSC)	LSC2A
l. IP Rating	3X (2X with door opened)

8.3 Busbars

The switchgear shall have a 3-phase, busbar configuration with a continuous current-carrying capacity of at least 2,000 A with a hottest-spot temperature rise not greater than 65°C above the ambient temperature outside the switchgear. The busbars and connections shall be fully insulated for 12 kV service with flame-retardant sleeve-type, moulded insulating material or installed in SF6 enclosures.

The momentary current rating of all busbars and connections shall be not less than 25 kA rms asymmetrical. An earthing busbar shall extend through the entire length of the switchgear. The switchgear frame and all internal equipment bases and mountings shall be connected to the earthing busbar.

The generator circuit breaker and, where fitted, the auxiliary transformer disconnecter shall each have the capability to earth the windings of the generator or transformer during maintenance.

8.4 Circuit Breakers

The generator circuit breakers shall be 3-pole, indoor vacuum type, with a removable draw-out circuit breaker unit with fixed outgoing earthing switch and a draw-out type busbar earthing truck. The circuit breaker shall be specifically designed for generator circuit breaker applications and shall be selected taking into account the DC component of the short circuit current.

8.4.1 General Requirements

The circuit breakers shall be equipped with two (2) 110 V DC shunt trip coils and a stored-energy closing mechanism, which is charged by a 110 V DC motor. Each trip coil shall be provided with a trip circuit supervision relay with auxiliary contacts for control and indication purposes.

Circuit breakers and isolation / earthing switches shall be furnished with auxiliary contacts for control and indication purposes.

The circuit breaker control compartment shall include indicating lights and control wiring to give a red indication for breaker closed position and a green indication for breaker open position. Indication shall be visible from the front with door closed at all times when the circuit breaker is within the housing.

The following position displays shall be provided for each 11kV circuit breaker, isolation switch and earth switch:

CB or Isolation Switch in Closed Position – 'ON' to be marked in white lettering on a RED background.
CB or Isolation Switch in Open Position – 'OFF' to be marked in white lettering on a GREEN background.
Earth Switch In Open Position – 'E/S OPEN' in black lettering in YELLOW background.
Earth Switch In Closed Position – 'E/S CLOSED' in white lettering in GREEN background.

A blue indicating light shall be wired so as to provide a continuous indication of the continuity of the shunt trip circuit when the breaker is closed.

The circuit breaker shall be provided with an operation counter, a local control switch, and a "Local/Remote" selector switch. Circuits shall also be designed for indication and control from the control switchboard. In the test position of the circuit breaker, the remote control circuits shall be inoperative. The local control switch for each circuit breaker shall be interlocked to prevent breaker closing except when breaker is in the "Test" position.

8.4.2 Draw Out Circuit Breakers

The cubicles for the draw-out circuit breakers shall have self-engaging definite-positioning stops for "Disconnected," "Test," and "Connected" positions. The frame of a draw-out type circuit breaker shall be equipped with wheels.

Provision shall be made to ensure that the breaker cannot be withdrawn or inserted without being open.

Handling and testing equipment shall be furnished as required to remove, replace, test, and maintain the draw-out-type vacuum circuit breakers. The equipment shall include but not be limited to the following:

- a) One set of rail extensions for supporting the circuit breakers in the "Disconnected" position.
- b) One racking crank or suitable levering device for easy withdrawal of the breakers to the "Test" or "Disconnected" positions.
- c) One portable, hand-operated hoist for lifting and moving one draw-out breaker. The hoist shall be mounted on large, ball-bearing, rubber-tired casters, so that it can be easily moved by one person carrying the breaker.
- d) One lifting yoke.
- e) One manual operating mechanism cranks and levers.

Independent cell switches shall be provided for remote indication to show when the removable circuit breaker element is withdrawn and to show that the earthing truck is installed.

8.4.3 Circuit Breaker Ratings

The minimum circuit breaker ratings shall be as follows:

Voltage (nominal)	12kV
3-phase MVA (nominal)	25MVA
Withstand test voltages:	
- 50Hz, not less than	28kV
- Basic impulse, not less than	75kV
Rated continuous current	1600A
Rated interrupting time, cycles	5 cycles
Duty cycle	O-3min-CO-3mn-CO

8.5 Disconnecter / Fuse Assembly

8.5.1 General

The auxiliary transformers on the Unit 1 and 2 switchgear shall consist of an indoor, 12kV fused disconnector with shunt release.

8.5.2 Disconnecter/Fuse Ratings

The minimum disconnector/fuse ratings shall be as follows:

Voltage (nominal)	12kV
Withstand test voltages:	
- 50Hz, not less than	28kV
- Basic impulse, not less than	75kV
Rated continuous current	400A
Rated short time current	25kA
Rated peak current	63kA
Fuse type	HH with thermal striker pin
Fuse rating	40A

8.5.3 Disconnecter Mechanism

The disconnector mechanism shall include the following:-

- a) An earthing switch on the outgoing circuit to the auxiliary transformer, mechanically interlocked to the disconnector.
- b) A motor drive for opening and closing.

- c) A breaking current shunt release rated at 110V DC.
- d) 3 pole striking pin release.
- e) At least 4 NO/NC auxiliary switches.
- f) Safety shrouding to ensure IP2X rating maintained when cabinet door opened AND when replacing the fuse cartridges.

8.6 Instrument Transformers

8.6.1 General

The instrument transformers shall be indoor type designed and rated in accordance with IEC Standards.

8.6.2 Voltage Transformers

Voltage transformers shall have a voltage rating of $11,000V/\sqrt{3} : 110V / \sqrt{3}$. Voltage transformers shall have a basic impulse insulation level of not less than 75 kV.

Voltage transformers (3 phase set) shall be provided on the 11kV switchgear as listed herein.

- a) Generator Incoming Connection:
 - Use Protection / Instrumentation
 - Secondary 1 accuracy class 1
 - Secondary 2 accuracy class 3P
 - Rated burden > 15VA per secondary
- b) Main Transformer Outgoing Connection:
 - Use Protection / Instrumentation
 - Secondary 1 accuracy class 1
 - Secondary 2 accuracy class 3P
 - Rated burden > 15VA per secondary

8.6.3 Current Transformers

The current transformers shall have a standard insulation class of 11 kV and a basic impulse insulation level of not less than 75 kV.

Current transformers (3 phase set) shall be provided on the 11kV switchgear as listed herein.

- a) Main Transformer Outgoing Connection:
 - Use Protection
 - Ratio 1600/1200/1000/1A (multi-ratio)
 - Number required 2
 - Rated burden > 10VA
 - Accuracy class 5P20
 - Use Revenue Metering
 - Ratio 1600/1A
 - Number required 1
 - Rated burden > 10VA
 - Accuracy class CI 0.2
 - Use Differential Protection
 - Ratio 1500/1A
 - Number required 2
 - Rated burden > 10VA
 - Accuracy class CI X 0.05I_μ 330Vk Rct 6Ω
- b) Auxiliary Transformer Outgoing Connection:
 - Use Protection
 - Ratio 50/1A
 - Number required 1

- Rated burden > 10VA
- Accuracy class 5P20

- Use Differential Protection
- Ratio 1500/1A
- Number required 1
- Rated burden > 10VA
- Accuracy class CI X 0.05I_μ 330Vk Rct 6Ω

8.7 Surge Protection Equipment

Surge arresters shall be provided on the generator outgoing connection. Surge arrestors shall be of the metal oxide station class type for rotating AC machines, suitable for surge protection of 11 kV, 3-phase, 50 Hz, high resistance-earthed generators. The surge arresters shall be rated 15 kV and meet the requirements of the appropriate IEC Standards.

8.8 Cable Terminations

Cable terminators required for external cabling from the switchgear shall be slip-on type, suitable for 11kV cable. The cable terminators shall provide stress relief using factory pre-formed components. The preferred manufacturer of cable terminations is Pfisterer brand.

The switchgear shall be arranged as shown in the Employer's Drawings, with provisions for the following busbar and cable connections on each switchgear assembly:

- a) 11 kV cross-linked polyethylene insulated cables from the generator to the generator circuit breaker (2 x 500mm² per phase).
- b) 11 kV cross-linked polyethylene insulated cables from the main power transformer to the transformer isolator (2 x 500mm² per phase).
- c) 11 kV cross-linked polyethylene insulated cables from the generator termination to the excitation transformer (1 x 25mm² per phase).
- d) 11 kV cross-linked polyethylene insulated cables from the disconnect/fuse to the auxiliary transformer (1 x 25mm² per phase).

8.9 Control Switches

A control switch shall be provided for circuit breaker control. The switch shall be 3-position, momentary-contact type, with spring return to the neutral position, and shall have a pistol-grip handle. A pull-to-lock feature shall be provided. The circuit breaker control switch shall be enabled when the Local / Remote switch is selected to Local.

Selector switch for Local / Remote control shall be 2-position, maintained contact type and shall have a round notched handle.

8.10 Cubicle Heaters

Each switchgear cubicle shall be provided with a 230V AC space heater, with thermostat controller.

8.11 Maintenance Equipment

Handling and testing equipment shall be furnished as required to remove, replace, test, and maintain the draw-out-type vacuum circuit breakers. The equipment shall include but not be limited to the following:

- a) One set of rail extensions for supporting the circuit breakers in the "Disconnected" position.
- b) One racking crank or suitable levering device for easy withdrawal of the breakers to the "Test" or "Disconnected" positions.

- c) One portable, hand-operated hoist for lifting and moving one draw-out breaker. The hoist shall be mounted on large, ball-bearing, rubber-tired casters, so that it can be easily moved by one person carrying the breaker.
- d) One lifting yoke.
- e) One manual operating mechanism cranks and levers.

8.12 Factory Assembly and Tests

Each set of Generator Switchgear shall be completely factory assembled and shall be fully tested and documented by certified production test reports in accordance with IEC 62271-200.

- a) General
Each item of equipment shall be given the manufacturer's routine factory tests and additional tests as specified below to ensure successful operation of all parts of the assemblies.
- b) Routine Tests
As a minimum, the following Routine Tests shall be conducted for the medium-voltage portion of the switchgear in accordance with IEC 62271-200:
 - Power-frequency voltage (high-potential) test one minute
 - Dielectric test of auxiliary circuit
 - Measurement of the resistance of the main circuit
 - Partial discharge test
 - Mechanical operation test
 - Test of auxiliary devices
 - Verification of the correct wiring
 - Pressure test of gas-filled compartments (as applicable)
 - Gas tightness test of factory gas-filled compartments as per shipping splits (as applicable)
 - Measurement of gas condition after filling (as applicable)
- c) 12 kV Switchgear
The metal-clad vacuum circuit breakers and power switchgear cubicles shall be subjected to the following additional factory tests:
 - The circuit breakers shall be given at least 10 times (close-open) operations at the minimum, rated, and maximum operating range of control voltages. The circuit breakers shall be thoroughly checked for proper operation, and all necessary adjustments shall be made.
- d) Instrument Transformers
The instrument transformers shall be subjected to the following additional tests:
 - All routine tests as specified in IEC 61869
 - One voltage transformer shall be given special ratio and phase angle tests at 3 secondary voltages and at the standard burden values. The serial numbers of these voltage transformers and their location in the switchboard cubicles shall be given in the test data.
 - One current transformer of each rating and type shall be given ratio and measurement of exciting current. The serial numbers of these current transformers and their location in the switchboard cubicles shall be given in the test data.

8.13 Installation, Testing and Commissioning

The equipment shall be installed, field tested, and placed in operation under the supervision of the Contractor. All necessary assistance, tools, and facilities required for the supervising engineer shall be provided.

The Contractor shall provide a detailed list of all Test Equipment including recommended manufacturer, model number and accessories that is required for site installation, pre-commissioning and commissioning to meet the requirements of this specification. Each of the Routine Tests conducted during the shop tests shall be repeated during the field tests.

The Contractor shall provide the following level of service during the equipment installation and commissioning:-

Section 1: The Contractor shall provide full time supervision of the following activities, unpacking the switchgear components, assembly in their final position, connection of all cabling and static testing. The Contractor shall be responsible for commissioning the 11kV switchgear. The Contractor shall allow a minimum of seven days for installation supervision and three days for commissioning. Note that the commissioning period may not follow on immediately after the installation supervision period.

Sections 2, 3 and 4: The Contractor shall provide for inspecting the installed switchgear and for supervision of the static testing. The Contractor shall be responsible for commissioning the 11kV switchgear. The Contractor shall allow a minimum of three days for commissioning of each Section.

Note that for the purposes of the installation, testing and commissioning phase a day shall be defined as 12 hours on site.

If additional time on site is required in order to correct issues of the Contractors making, then no additional charges to the Employer will be accepted.

8.14 Training

The Contractor shall provide a factory-authorized service representative for training that shall cover the following items:

- Installation.
- Operation.
- Testing & commissioning.
- Maintenance practices for the supplied equipment as recommended by the Manufacturer
- Hands on training on periodic adjustment required, and parts replacement procedure.

It is expected that the Contractors Commissioning Engineer would perform this training prior to Section 1 Commissioning.

8.15 Recommissioning

Recommissioning of the turbine and generator will be undertaken primarily by the Employer and Engineer with supervision being provided by the various contractors as applicable to their scope of work.

The overall sequence for recommissioning each turbine generator will follow the following general structure.

8.15.1 Static Testing

Activity	Responsible Party
Inspection for completeness.	Each Contractor for their work area
Inspection of all the hydraulic conduits and removal of any foreign bodies.	Each Contractor for their work area
Point to point wiring tests.	Each Contractor for their work area
All terminations checked for tightness.	Each Contractor for their work area
Insulation resistance checks on all equipment.	Each Contractor for their work area
2 kV rms power frequency withstand test on all control and protection wiring.	Each Contractor for their work area
High current resistance checks across all high voltage joints (Ductor test).	Each Contractor for their work area
Correct settings applied to all protective devices.	Control system Installation Contractor
Plant control system software SAT tests.	Control system Installation Contractor assisted by each Contractor for their work area.
Measurement of bearing and seal clearance.	Each Contractor for their work area

Hydrostatic tests.	Turbine Contractor
Pressure tests in the governing system, check of oil levels and of the conditions of all oil filters and filtering systems	Turbine Contractor
Pressure tests in the cooling water system.	Generator Contractor
First fill of all lubricating and hydraulic oil.	Turbine Contractor Generator Contractor
First fill of cooling water system.	Generator Contractor
Verification of the correct operation of governor HPU.	Turbine Contractor
Verification of correct operation of HP Oil system.	Generator Contractor
Verification of correct operation of cooling water system.	Generator Contractor
Operational tests of all balance of plant equipment.	Each Contractor for their work area

8.15.2 Pre-Commissioning Tests

The pre-commissioning tests shall include pre-start and closing devices checks:

8.15.2.1 Dry Tests

These tests shall include:

Activity	Responsible Party
Adjustment of dry opening and closing times of turbine needles and deflectors to calculated settings.	Turbine Contractor
Adjustment of dry opening and closing times of main inlet valve to calculated settings.	Turbine Contractor
Confirm that the shutdown circuits function correctly by simulating each and every plant protective trip event and verifying correct operation of the turbine shutdown systems, inlet valve closing systems and generator circuit breaker trip (the generator circuit breaker shall be racked out during these tests).	Control System Installation Contractor assisted by each Contractor for their work area.
Unit Control System start up sequences	Control System Installation Contractor assisted by each Contractor for their work area.

8.15.2.2 Wet Tests

These tests shall include:

Activity	Responsible Party
Verify that the needle leakage is within acceptable limits.	Turbine Contractor
Check the opening and closing times for the inlet valve and confirm that they are as expected.	Turbine Contractor

<p>First run operation of the turbine generator. During the first run, the turbine generator shall be “bump started” by manually opening the needles to a small opening for a few seconds. The unit shall be permitted to rotate and observed for any unusual readings, measurements, vibrations or noise.</p>	<p>Turbine Contractor Generator Contractor</p>
<p>Progressively bring the turbine generator up to rated speed using the governor. The turbine generator shall remain at each speed step until such time as the bearing temperatures have stabilised. If any of the turbine generator instrumentation reaches an alarm or trip condition, or exhibits unusual behaviour.</p> <p>At each speed step it shall be verified that the closing devices are functioning correctly:</p> <ul style="list-style-type: none"> • Verify adjustment for operation of governing system timing at rated speed. • Verify adjustment and measuring accuracy of the speed monitoring systems. • Verify adjustment of the overspeed devices. 	<p>Turbine Contractor Generator Contractor</p> <p>Turbine Contractor Generator Contractor</p> <p>Generator Contractor</p>
<p>A bearing heat run at rated speed shall then be conducted. The heat run shall continue for one hour after the bearing temperatures have stabilised.</p> <p>The following parameters shall be recorded during these tests:</p> <ul style="list-style-type: none"> • Ambient temperature. • Bearing temperatures. • Bearing oil temperatures. • Unit speed 	<p>Generator Contractor assisted by Control System Installation Contractor</p>
<p>At the end of the test the turbine generator shall be shut down by simulating an overspeed event to demonstrate that the emergency shutdown systems are operating correctly.</p>	<p>Control System Installation Contractor</p>

8.15.2.3 Generator Excitation, Protection and Synchronising Tests

Following the successful completion of the heat run the unit shall be started and the following tests conducted:

Activity	Responsible Party
<p>Excite the generator for the first time. Verify that all voltage measurements are being read correctly in the Unit control system and shall undertake excitation system tests as required by the IEC standard and the manufacturer.</p>	<p>Control System Installation Contractor Excitation System Contractor</p>
<p>Test the generator electrical protection as far as</p>	<p>Control System Installation Contractor</p>

possible by reducing settings below the actual measured values and confirming that the protection relays operate correctly.	
With the generator circuit breaker racked out, test synchronising against a dead bus, and verify phase sequence and phase angle between the generator and bus VTs.	Control System Installation Contractor
With the generator racked in and the main power transformer MV open and other generator circuit breaker open, retest synchronising against a dead bus and verify phase sequence and phase angle between generator and bus VTs.	Control System Installation Contractor

8.15.2.4 Overspeed Test

Activity	Responsible Party
Test the overspeed devices by increasing the turbine speed under manual control.	Generator Contractor assisted by Turbine Contractor

8.15.3 Commissioning Tests

8.15.3.1 First Synchronisation

The Commissioning tests shall commence with a first synchronisation and loading of the turbine generator.

Activity	Responsible Party
Set the governor load limiter to no more than 10% of rated.	Turbine Contractor
The turbine generator shall initially be started, synchronised and loaded (to the 10% limit) using the Unit Control System automatic start controls in 'step by step' manual override mode.	Control System Installation Contractor Assisted by Turbine Contractor and Generator Contractor

The tests shall then be repeated in fully automatic mode.

8.15.3.2 Load Rejection Tests

The turbine generator shall be started, synchronised and the load shall be increased in steps to the maximum value.

Activity	Responsible Party
At each step, observations and measurements in steady state condition shall be repeated and the operating stability of the turbine shall be verified.	Control System Installation Contractor Assisted by Turbine Contractor and Generator Contractor
The turbine generator shall be subjected to load rejection tests at each of the following load steps: 25%, 50%, 75% and 100% of rated load. The load rejection should operate into the turbine ESD controls and a different initiating event should be used for each test.	Control System Installation Contractor Assisted by Turbine Contractor and Generator Contractor
Record the following parameters during these tests: <ul style="list-style-type: none"> • Penstock pressure. 	Control System Installation Contractor

<ul style="list-style-type: none"> • Spiral case pressure. • Guide vane position. • Turbine generator speed. • Circuit breaker position. • Inlet valve position. 	
---	--

8.15.3.3 Generator Heat Run

Activity	Responsible Party
Undertake a generator heat run at rated output. The heat run shall continue for one hour after the winding, cooling system and bearing temperatures have stabilised.	Control System Installation Contractor Assisted by Turbine Contractor and Generator Contractor
Record the following parameters during these tests: <ul style="list-style-type: none"> • Ambient temperature. • Stator winding temperatures. • Cooling system temperatures. • Turbine discharge water temperature. • Bearing temperatures. • Bearing oil temperatures. • Generator load. 	Control System Installation Contractor

8.15.3.4 Trial Operation

Following successful completion of the Commissioning Tests, a Test Run (Trial Operation) shall be performed as required to assure that the equipment has been installed and adjusted properly and that it will function safely and properly under continuous operation. The test run shall be performed in the automatic control mode, without any adjustments or corrections, under certain loads specified by the Employer. The duration of the Test Run shall be for a continuous period (no interruptions allowed) of 720 hours. If the Test Run is interrupted due to malfunction of equipment, the Test Run shall be performed over again.

8.16 Training

The Contractor shall provide a factory-authorized service representative for training that shall cover the following items:

- Installation.
- Operation.
- Testing & commissioning.
- Maintenance practices for the supplied equipment as recommended by the Manufacturer
- Hands on training on periodic adjustment required, and parts replacement procedure.

It is expected that the Contractors Commissioning Engineer would perform this training prior to Section 1 Commissioning.

8.17 Spare Parts

8.17.1 Specified Spare Parts

The Contractor shall furnish the following Specified spare parts:

- a) One set of primary disconnecting devices for one 3-pole breaker.
- b) One set of secondary disconnecting devices for one 3-pole breaker.
- c) One sets of MV fuses of each type used.

- d) Two sets of trip coils of each type used.
- e) Two closing solenoid coil or motor.
- f) One set of auxiliary switches of each type used.
- g) One set of main blades.
- h) One set of interrupter units.
- i) One operating handle mechanism for disconnecting switch.

“Set” shall be defined as the total number required for an item of equipment

8.17.2 Optional Spare Parts

The Contractor shall furnish a list of recommended Optional additional spare parts.

8.18 Generator Switchgear Data

The Contractor shall provide the data listed on the following generator switchgear data sheets as part of the Basic Design:

		Purchaser's Requirements	Vendors Response
Manufacturer and Place of Manufacturer - The Contractor shall indicate the location of the factory where each item will be manufactured.			
Metal clad switchgear cubicle			
Generator circuit breaker			
Disconnecter / Fuse			
Current transformers			
Voltage transformers			
Surge arrestors			
Overall Switchgear and Bus			
Internal Arc Classification (IAC)		AFLR	
Loss of Service Continuity Category (LSC)		LSC2A	
IP Rating		3X (2X with door opened)	
Rated Frequency	Hz	50	
Rated maximum voltage	kV	12	
Basic impulse insulation level	kV	75	
Short circuit current (3 sec)	kA	25	
Short circuit current (peak)	kA	75	
Bus current rating	A	> 2000	
Circuit Breakers			
Type			
Circuit Breaker Continuous Current	A	1600	
Symmetrical current interrupting capability at rated maximum voltage (RMS)	kA		
Maximum rated interrupting time on a 50 Hz basis	s		
Closing and latching current (momentary)	kA		
Tripping mechanism type			
Rated Interrupting time	cycles	5	
Duty cycle		O-3min-CO-3mn-CO	
Fuse Disconnecter			
Type			
Rated Continuous Current	A	400	
Fuse rating	A	40	

Short circuit current (3 sec)	kA		
Short circuit current (peak)	kA		
Tripping mechanism type			
Fuse Type		HH with striker pin	
Operating motor voltage	V		
Current Transformers - Append details of current transformer construction including type, manufacturer, and insulation			
Rated primary current	A		
Rated secondary current	A	1	
Rated accuracy and burden designation:			
Protective Relaying			
Metering			
Basic impulse insulation level	kV		
Voltage Transformers - Append details of voltage transformer construction including type, manufacturer, and insulation			
Rated primary voltage	kV		
Rated secondary voltage	V		
Rated accuracy and burden designation:			
Protective Relaying			
Metering			
Basic impulse insulation level	kV		
Surge Arresters - Append details of surge arrester construction, type, manufacturer, and ratings.			
Nominal system voltage	kV-rms		
Maximum continuous operating voltage	kV-rms		
Duty cycle rating	kV-rms		
Maximum 0.5 microsecond discharge voltage			
Maximum discharge voltage for an 8 x 20 microsecond impulse current waveform:			
10,000A	kV crest		
20,000A	kV crest		
Heat losses			
For the complete switchboard	W		
Dimensions and Weights Switchgear Section (Each)			
Width	mm		
Depth	mm		

Height	mm		
Weight	Kg		
Overall Dimensions and Weight of Entire Switchgear			
Width	mm	2400	
Depth	mm	2300	
Height	mm	2300	
Weight	Kg		

GENERATOR SWITCHGEAR DATA SHEET

Date: _____

Schedule 1 – Tender Forms

Tender Form 1 – Letter of Tender

Name of Contract: Wailoa Mid Life Refurbishment Project,
Generator 11kV Switchgear Contract No. **MRXXXX/2016**

Tender To: Fiji Electricity Authority
2 Marlow St
Private Mail Bag
Suva
Republic of the Fiji Islands

1. This tender is made by _____
[insert full name and registered address of tenderer].
2. Capitalised terms used in this letter have the meaning given to them in the Instructions to tenderers dated *[insert date]* ("**Instructions**") unless otherwise defined.
3. Having examined and understood the Tender Documents relating to the Works (including the Instructions and all documents attached thereto, including but not limited to the Particular Conditions of Contract, the General Conditions of Contract, the Specification and the Employer's Drawings) we, the undersigned, hereby offer to design, execute, complete and remedy defects in the whole of the Works in conformity with the said documents for the sum of:
.....
....., (\$.....),
Exclusive of VAT, WHT or such other sum as may be ascertained in accordance with the Contract.
4. This offer is made on the terms and conditions set out in this Tender and the Instructions.
5. We attach the following documents which form part of this tender:
 - (a) Completed tender forms;
 - (b) Technical description of the plant offered;
 - (c) Maintenance contract proposal
 - (d) Proposed P&IDs – as applicable;
 - (e) Proposed programme;
 - (f) Proposed key personnel;
 - (g) Any supplementary information;
6. We agree to abide by this Tender for a period of 60 days after the Tender Closing Date and that this Tender it shall remain binding upon us and may be accepted by you at any time before the expiration of that period.
7. We confirm that you may rely upon all statements made by us in response to the Instructions or in subsequent correspondence, discussions or negotiations with you.
8. We certify that:
 - (a) The entry into, and performance of the obligations under, the Contract by us will not violate any laws provided that you obtain all consents and authorisations you are required to obtain under the Contract;
 - (b) We have corporate power to enter into and perform our obligations under the Contract and we have taken all necessary corporate action to authorise the entry into, and execution of, this offer and (if required) entry into, and execution of, the Contract;
 - (c) The rates and prices in our offer have been arrived at independently, without consultation or agreement with any other tenderer; and
 - (d) No attempt has been made, nor will be made, by us to influence any other tenderer to submit or not submit a tender or to alter the proposed content of that tenderer's tender.
9. We acknowledge that this tender, and any contract arising upon its acceptance, shall be governed by and construed in accordance with the laws of The Fiji Islands.
10. Unless and until a formal agreement is prepared and executed, this Letter of Tender, together with your written acceptance thereof, shall constitute a binding contract between us.

We understand that you are not bound to accept the lowest or any tender you may receive.

Dated this _____ day of _____ 2016

Signature _____ in the capacity of _____

duly authorised to sign Tenders for and on behalf of: _____

Witness _____

Address _____

Occupation _____

Tender Form 2 – Tender Price and Price Breakdown

Item	Amount Fijian Dollars (FJD) excluding VAT	Amount Foreign Currency (Nominated by Tenderer)
Section 1 Unit 4 Generator		
Basic design report		
Detailed design report		
11kV switchgear manufacture		
Delivery to Site		
Spare Parts		
Installation Supervision and commissioning		
O&M Manuals		
Training		
Completed Test Reports		
As Built Drawings		
Section 1 Sub-Total		

Item	Amount Fijian Dollars (FJD) excluding VAT	Amount Foreign Currency (Nominated by Tenderer)
Section 2 Unit 3 Generator		
11kV switchgear manufacture		
Delivery to Site		
Installation Supervision and commissioning		
Completed Test Reports		
As Built Drawings		
Section 2 Sub-Total		

Item	Amount Fijian Dollars (FJD) excluding VAT	Amount Foreign Currency (Nominated by Tenderer)
Section 3 Unit 2 Generator		
11kV switchgear manufacture		
Delivery to Site		

Item	Amount Fijian Dollars (FJD) excluding VAT	Amount Foreign Currency (Nominated by Tenderer)
Installation Supervision and commissioning		
Completed Test Reports		
As Built Drawings		
Section 3 Sub-Total		

Item	Amount Fijian Dollars (FJD) excluding VAT	Amount Foreign Currency (Nominated by Tenderer)
Section 4 Unit 1 Generator		
11kV switchgear manufacture		
Delivery to Site		
Installation Supervision and commissioning		
Completed Test Reports		
As Built Drawings		
Section 4 Sub-Total		

Tender Price Summary	Amount Fijian Dollars (FJD) excluding VAT	Amount Foreign Currency (Nominated by Tenderer)
Section 1		
Section 2		
Section 3		
Section 4		
Total Tendered Price		

Optional prices	Amount Fijian Dollars (FJD) excluding VAT	Amount Foreign Currency (Nominated by Tenderer)
Optional spare parts (list in detail)		
Total		

Signature
Name
Position
Company
Address
Date

Tender Form 3 – Proposed Key Personnel

Contract Manager:

Site Works Supervisor:

Commissioning Engineer:

Signature

Name

Position

Company

Address

Date

Tender Form 4 – Proposed Suppliers and Sub-Contractors

.....
.....
.....
.....

Signature
Name
Position
Company
Address
Date

Tender Form 6 – Percentage On-Costs

Item	Description	Percentage on Cost
1.	Equipment and materials supplied on cost plus basis (including transport).
2.	Sub-contractors employed on cost plus basis.
3.	Equipment hire.
4.	Contractor's profit.

Explanatory Notes

- (a) The Tenderer shall complete the Percentage on Costs form to show the percentage on cost applicable for supplying extra equipment and materials, employing extra Sub-contractors on a cost plus basis and for arranging extra equipment hire.
- (b) The percentage on costs shall allow for all costs incurred by and profits for the Contractor in arranging for the supply of any extra equipment and materials or hire of any extra equipment.
- (c) The percentage on costs shall allow for all costs incurred by and profits for the Contractor in arranging and managing any extra Sub-contractors employed on the job.
- (d) Invoices shall be supplied by the Contractor to substantiate any claim for costs associated with work performed on a cost plus basis.
- (e) The percentage on costs and invoices will be used as a basis for agreeing costs associated with any variations to the contract.

Signature

Name

Position

Company

Address

Date

Tender Form 7 – Statement of Conformance

We have read and understood the Tender documentation for the generator rehabilitation contract, and confirm that:

Tick 1 Box as
Applicable

Our Tender is in full compliance with the requirements and we have no exceptions to note.

Our Tender does not fully comply with the requirements. The following exceptions apply:

.....
.....
.....
.....
.....
.....
.....
.....

Signature
Name
Position
Company
Address
Date

Binding signature on behalf of the Contractor Title:
..... Dated:

Appendix A Existing Generator Switchgear Selected Drawings and Documents

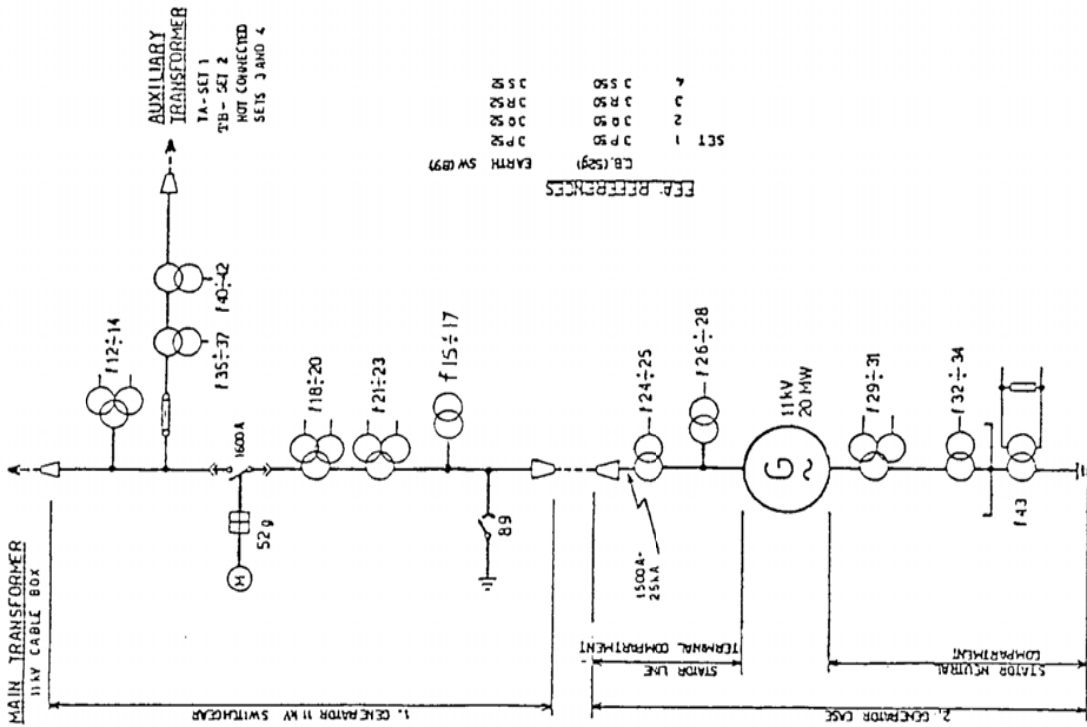


FIGURE 1
TYPICAL SINGLE LINE DIAGRAM
FOR SETS 1 TO 4

1. DESIGN AND CONSTRUCTION

1.1 GENERAL DESCRIPTION
(Refer to figure 1)

The 11 kV system described herein includes the equipment and connections installed between:

- 1- U, V, W generator terminals, the main transformer LV cable box and the auxiliary transformer HV terminals (sets 1 and 2 only)
- 2- X, Y, Z generator terminals and earthing transformer grounding terminal

1.2 LAYOUT AND ENCLOSURES

The enclosures for the main equipment of items 1 and 2, sub-section 1.1 above comprise steel framed and enclosed cubicles with hinged or bolted doors and covers, as appropriate, for equipment access, the layouts being as described in the following sub-sections 1.2.1 and 1.2.2.

1.2.1 GENERATOR 11 KV SWITCHGEAR

The switchgear comprises a free standing assembly of two cubicles divided in separate zones as indicated in fig.s 1,2,3,4 and 5

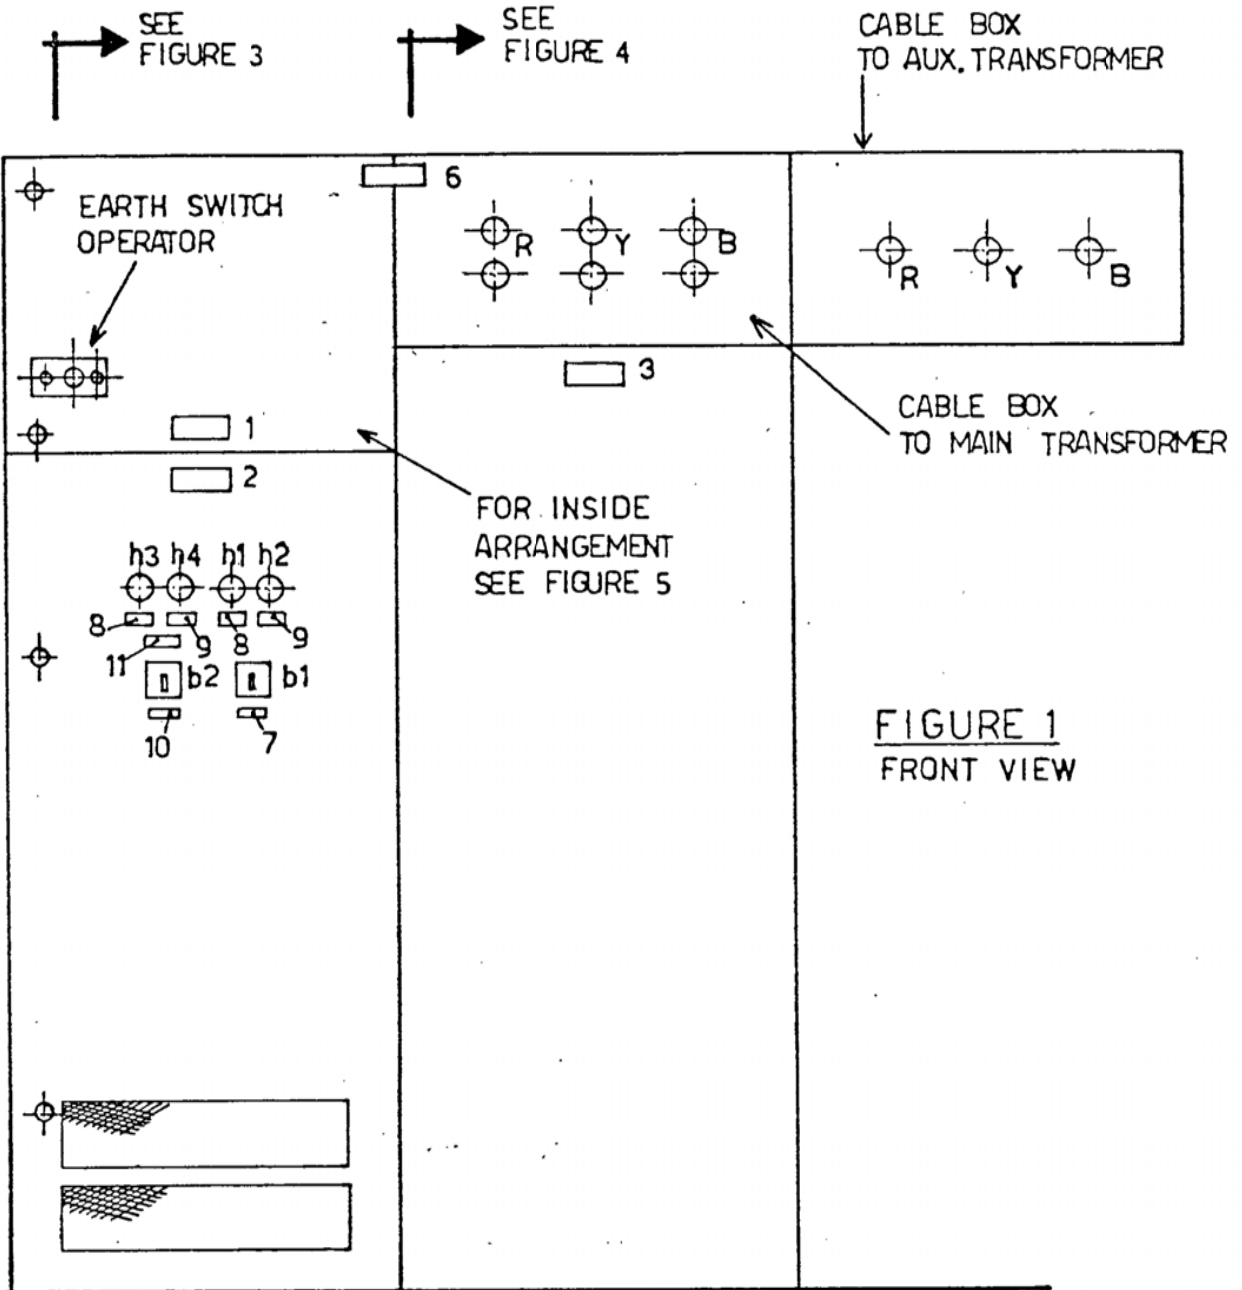


FIGURE 1
FRONT VIEW

SEE
FIGURE 3

SEE
FIGURE 4

LABELS LIST

- 1- Lv COMPARTMENT
- 2- CB COMPARTMENT
- 3- MAIN TRANSFORMER COMPARTMENT
- 4- GENERATOR COMPARTMENT } SEE FIGURE 2
- 5- AUX TRANSF. COMPARTMENT } (REAR VIEW)
- 6- GENERATOR (1T04) 11 kV SWITCH GEAR
- 7- CIRCUIT BREAKER CONTROL
- 8- OPEN
- 9- CLOSED
- 10- CONTROL SELECTOR
- 11- EARTH SWITCH

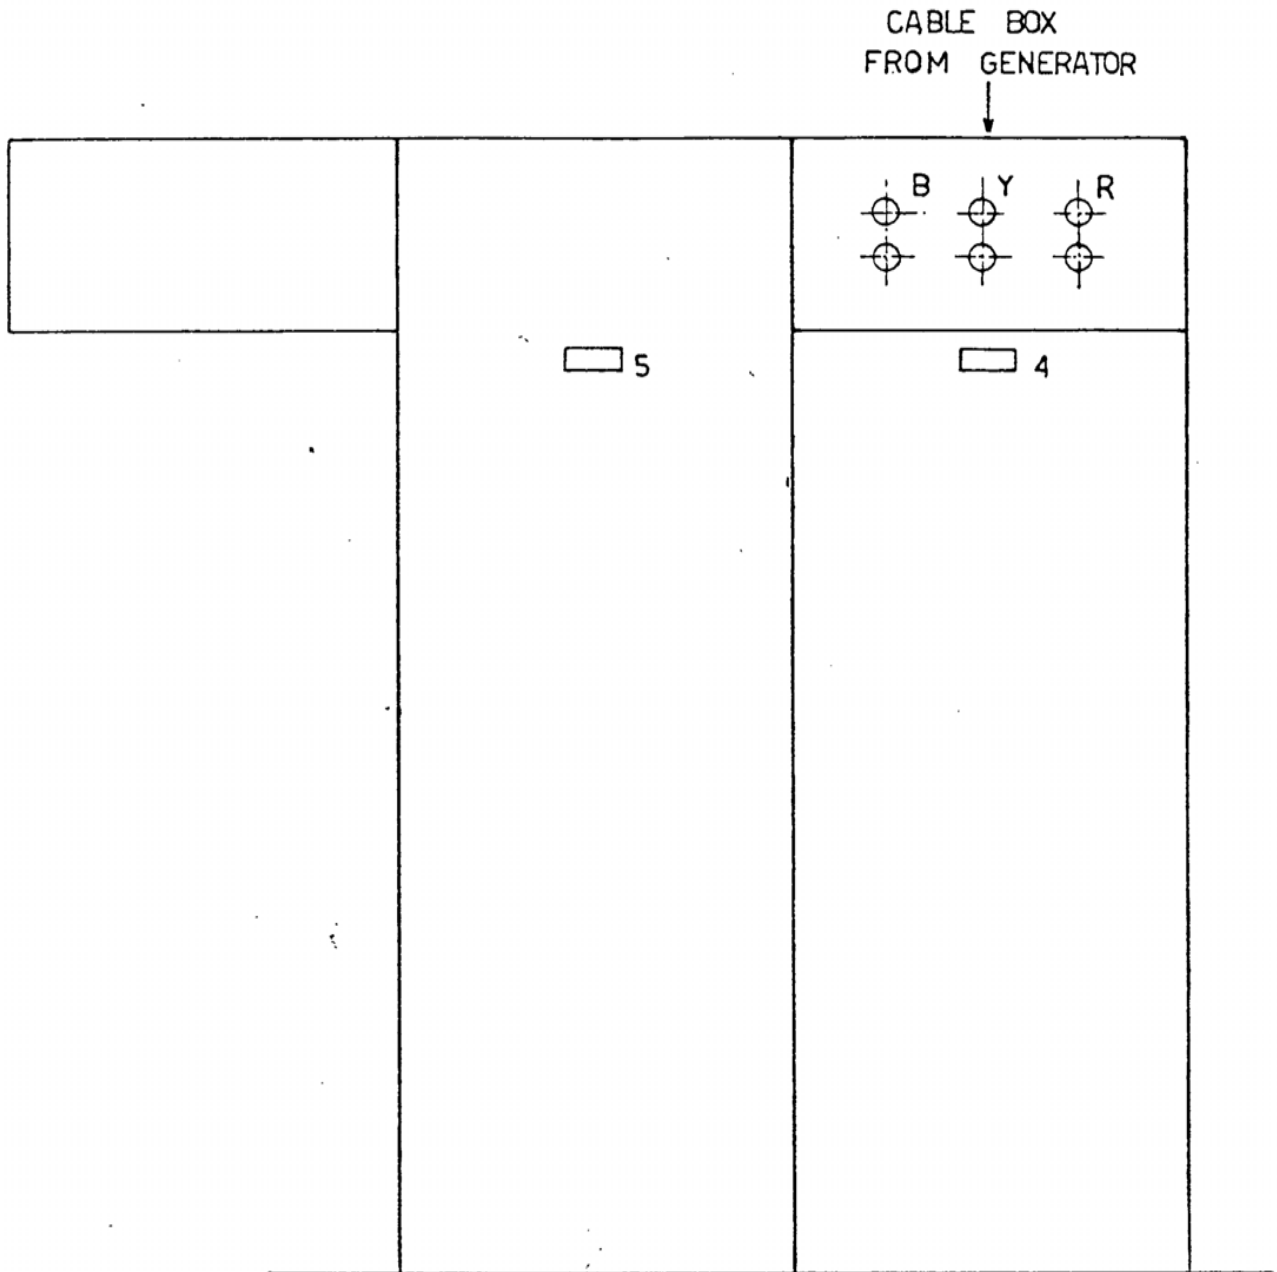


FIGURE 2

REAR VIEW

LABEL LIST

4 - GENERATOR COMPARTMENT

5 - AUX. TRANSFORMER COMPARTMENT

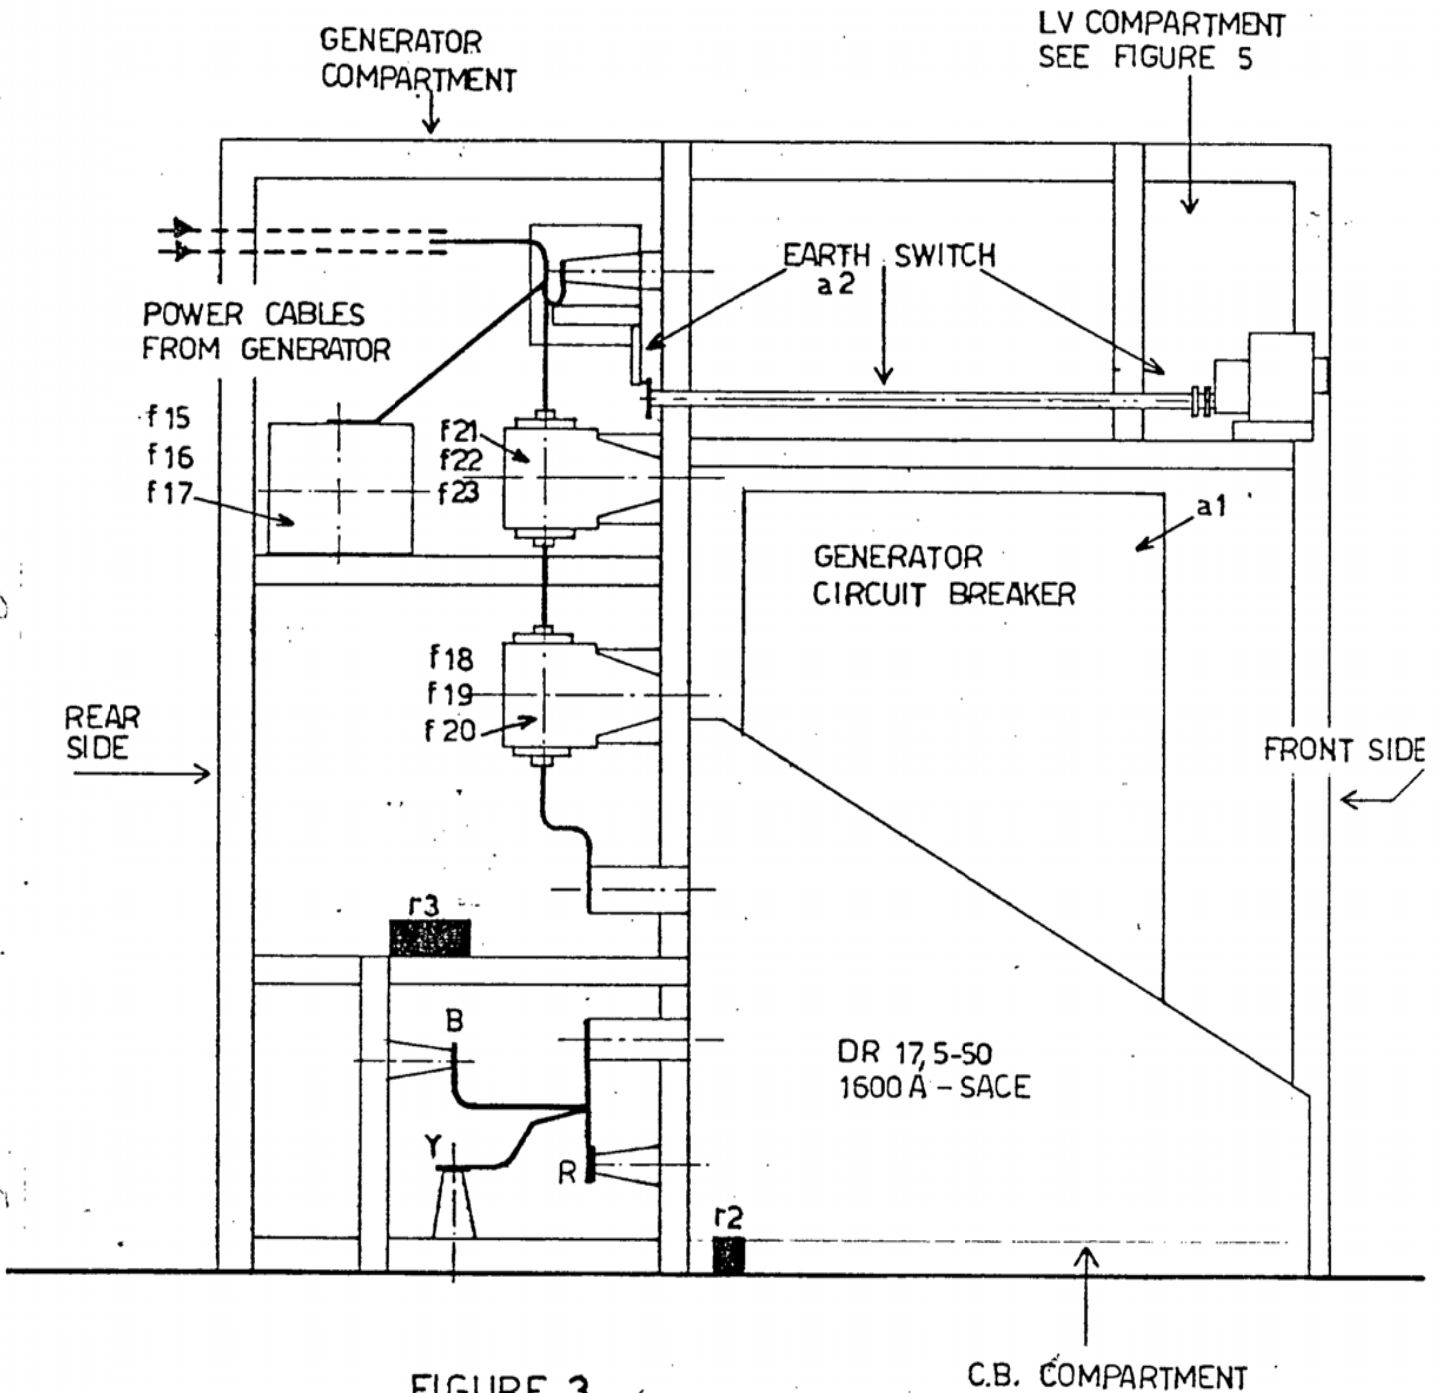


FIGURE 3

r2-r3 ANTICONDENSATION HEATERS

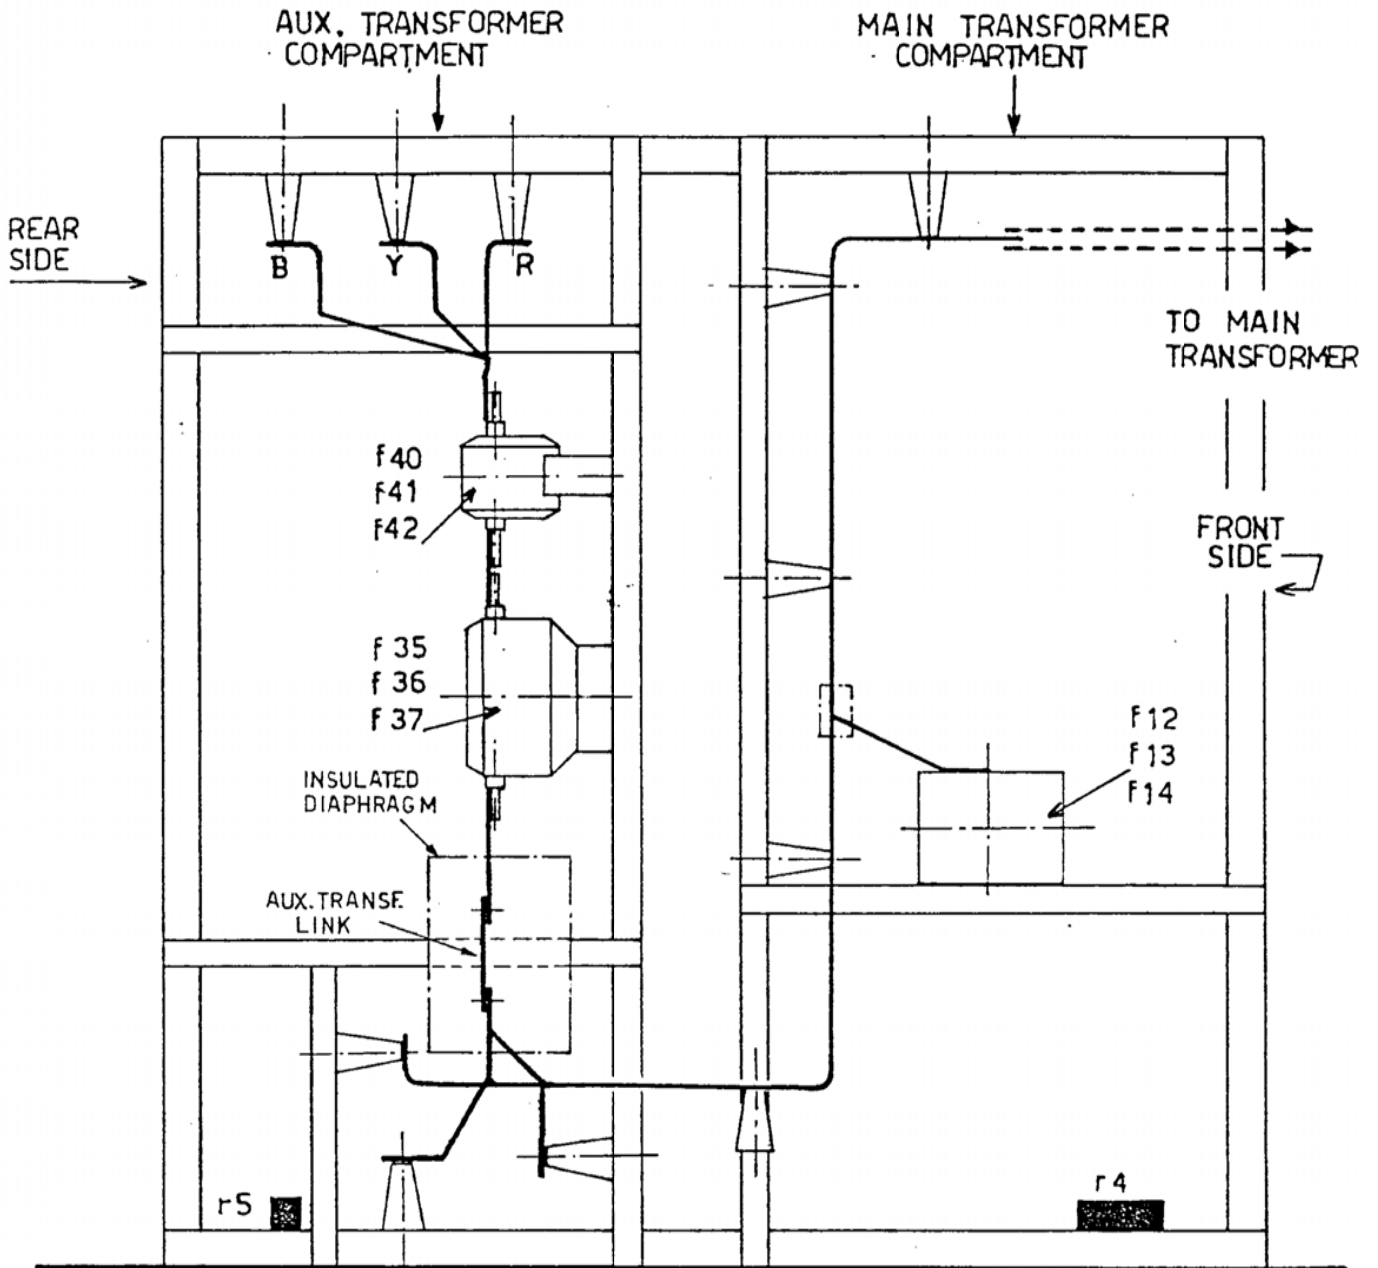


FIGURE 4

r4-r5 ANTICONDENSATION HEATERS

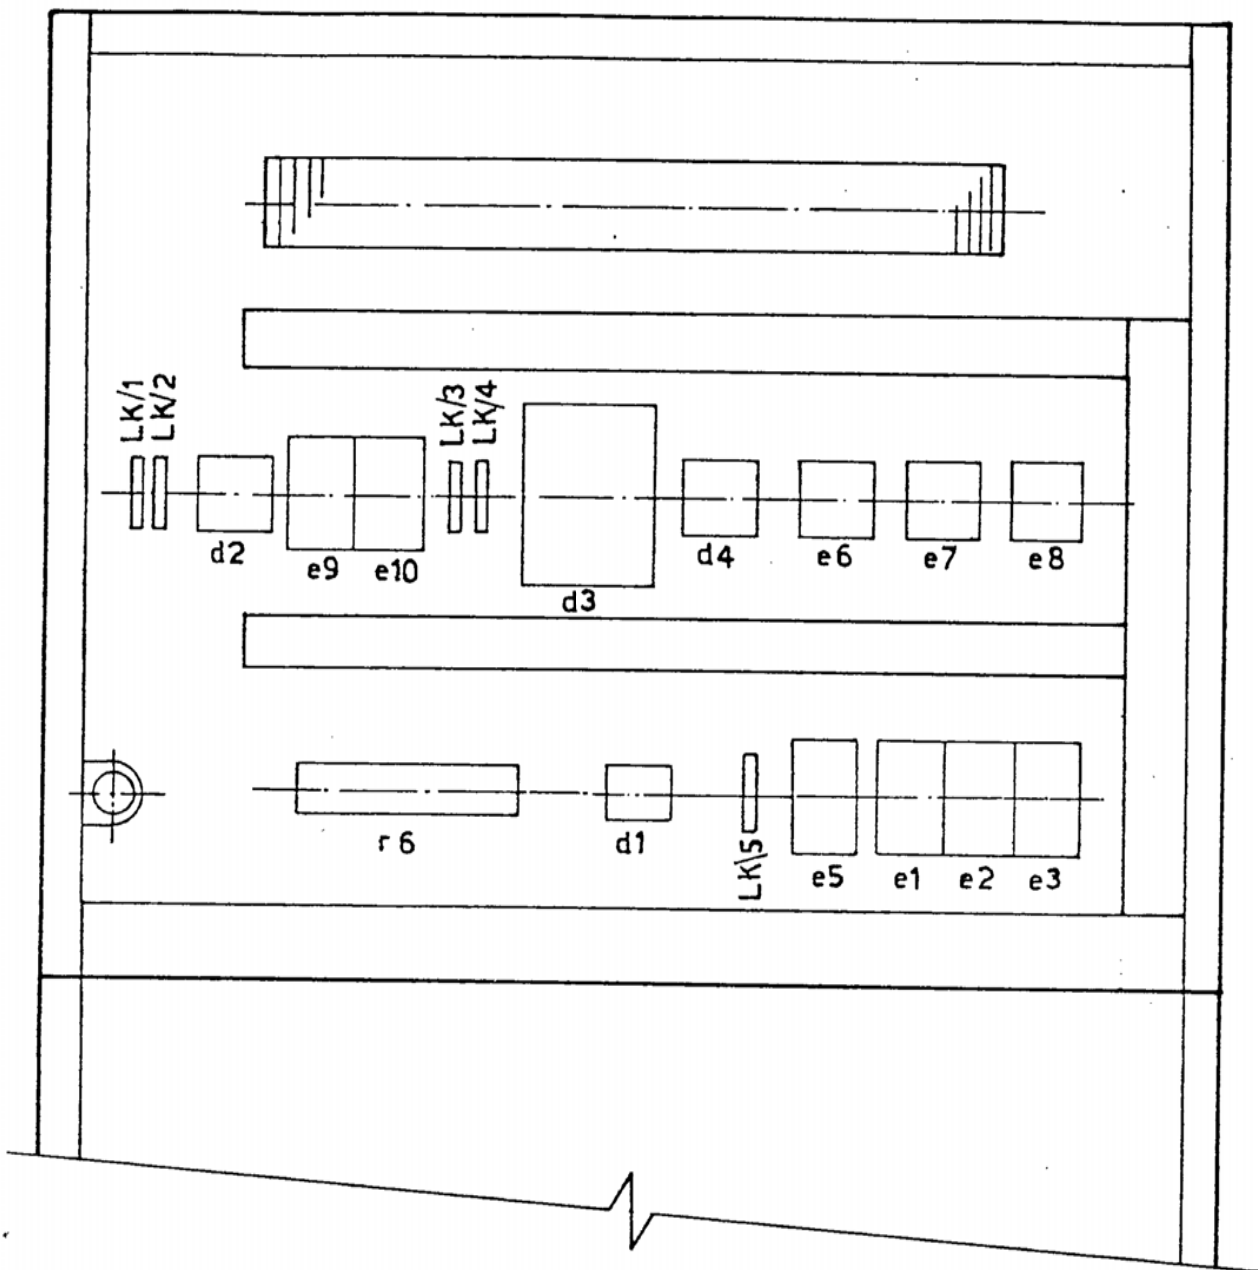


FIGURE 5

LV COMPARTMENT
(SHOWN WITH DOOR REMOVED)

1.2.2 STATOR NEUTRAL AND LINE TERMINAL COMPARTMENTS
(Generator casing)

The cubicle forms an abutment to the generator casing and is divided into separate compartments as indicated in figure 1. Separate bolted covers are provided for each of the zones designated 1, 2 and 3 for access to the equipment from the machine operating floor (front)

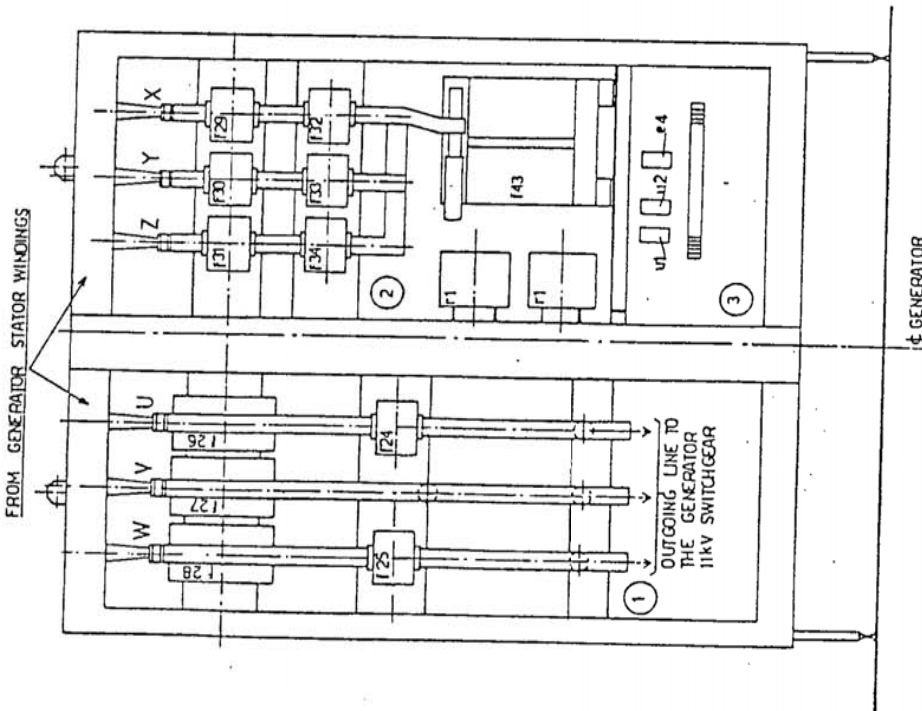


FIGURE 1
(VIEWED FROM INSIDE
GENERATOR CASING)

- ① STATOR LINE TERMINAL COMPARTMENT
- ② STATOR NEUTRAL COMPARTMENT
- ③ LOW VOLTAGE COMPARTMENT

1.3 EQUIPMENT CHARACTERISTICS1.3.1 11 KV GENERATOR CIRCUIT BREAKER

(see also the SACE instruction manuals for the c.b. and the operating mechanism in section 4)

11 kV air circuit breaker, SACE type DIARC DR 17,5-50 with motor operating mechanism type ERM 8

1. ELECTRICAL FEATURES:

- Rated voltage	17,5 kV
- Rated insulating level	17,5 kV
- Rated current	1600 A
- Withstand voltage at 50 Hz 1 min.	45 kV
- Impulse withstand voltage	95 kV
- Rated frequency	50 Hz
- Short-time current 3 sec.	75 kA peak
- Symmetrical breaking capacity at 12 kV	25 kA
- Total break time	60+65 ms
- Opening time 100% rated braking current	50 ms
- Closing time 100% rated making current	60 ms
- Aux. supply voltage for operation of trip mechanism	110 V d.c.
- Aux. supply voltage for operation of closing mechanism and control and indication	110 V d.c.

2. CONSTRUCTIONAL CHARACTERISTICS

- a) General The following figures 1, 2, 3 and 4 show the general assembly of the withdrawable circuit breaker and the matching stationary part.

(Please note that Figure 5 in this series is not relevant and has been omitted).

Appendix B Common Requirements Specification

Fiji Electricity Authority

Wailoa Mid-Life Refurbishment Project Common Requirements

June 2016

Fiji Electricity Authority

Wailoa Mid-Life Refurbishment Project

Common Requirements

Contents

1	Design Requirements.....	1
1.1	Design Responsibility	1
1.2	Project Procedures	1
1.3	Submittals	1
1.3.1	Drawing Standards	3
1.3.2	Outline Drawings.....	3
1.3.3	Detail Drawings.....	3
1.3.4	Line Diagrams.....	4
1.3.5	Schematic/Elementary Diagrams	4
1.3.6	Wiring Diagrams.....	4
1.3.7	Panel Layouts.....	4
1.3.8	Nameplate Schedules, Meter Scales, Engravings and Switch Handles.....	4
1.3.9	Design Calculations.....	4
1.3.10	Bills of Material.....	5
1.3.11	Cable Schedules	5
1.3.12	Pipe Schedules	5
1.3.13	Functional Block Diagrams.....	5
1.3.14	Block diagrams shall be provided that show the functional configuration of the main components of a system including the communication network and paths interconnecting them. The functional block diagram shall be presented in a manner that conveys the functionality of the system. Termination Drawings/Schedules	5
1.3.15	Logic Diagrams.....	5
1.3.16	Erection Schedule	6
1.3.17	Instructions	6
1.3.18	Operating and Maintenance Instructions.....	7
1.3.19	Field Commissioning Procedures of Check-Out, Start-Up, Initial Operation, Testing and Test Run	10
1.3.20	Reports 10	
1.3.21	Photographs	10
1.4	Quality Control & Testing Plans	11
1.4.1	Witnessing of Shop Assembly and Tests.....	11
1.4.2	Factory Tests.....	12

1.4.3	Test and Commissioning Plan	12
1.4.4	Training Program	12
1.4.5	Materials 12	
1.4.6	Supplier Information	12
1.4.7	Purchase Orders	13
1.4.8	Spare Parts Lists	13
1.4.9	Notice(s) of Equipment Inspections	13
1.4.10	Shop Inspection and Test Reports	13
1.4.11	Quality Control Reports	13
1.4.12	Manufacturer Field Service Reports	13
1.4.13	As-Built Drawings	13
1.5	Drawings Furnished by the Employer	13
1.6	Units of Measurement	14
1.7	Site Conditions	14
1.7.1	General Conditions	14
1.7.2	Transport Limitations	14
1.7.3	Water Conditions and Corrosion	14
1.8	Spare Parts	15
1.8.1	Specified Spare Parts	15
1.8.2	Optional Spare Parts and Maintenance Equipment	15
1.9	Tools and Appliances	15
1.10	Labels and Plates	15
1.11	Standards	16
1.11.1	Australian/New Zealand Standards	17
1.11.2	International Electrotechnical Commission (IEC)	17
1.11.3	American National Standards Institute (ANSI)	19
1.11.4	Institute of Electrical and Electronic Engineers (IEEE)	19
1.11.5	British Standards (BS)	19
1.11.6	ASTM 20	
1.11.7	Other 20	
2	Mechanical Requirements	22
2.1	Workmanship	22
2.2	Handrails	22
2.3	Materials	22
2.4	Test of Materials	24
2.4.1	General 24	
2.4.2	Impact and Bend Tests	24
2.4.3	Test Certificates	24
2.5	Safety Factors and Design Stresses	25
2.5.1	General 25	
2.5.2	Maximum Allowable Stresses	25

2.6	Tolerances.....	25
2.7	Workmanship.....	26
2.8	Welding.....	26
2.8.1	General 26	
2.8.2	Edge Preparation.....	26
2.8.3	Welding Qualifications.....	26
2.8.4	Field-Weld-Filler Metal.....	27
2.8.5	Documentation.....	27
2.9	Fabrication.....	27
2.10	Non-destructive Testing.....	27
2.10.1	General 27	
2.10.2	Examination of Welds.....	27
2.10.3	Examination of Castings.....	28
2.10.4	Examination of Forgings.....	28
2.11	Steel Castings.....	28
2.11.1	General 28	
2.11.2	Inspection.....	29
2.11.3	Repair Welding.....	29
2.11.4	Dimensions.....	29
2.12	Surface Finish of Equipment Parts and Welds.....	30
2.12.1	Weld Finish.....	30
2.12.2	Hydraulic Packing.....	30
2.12.3	Auxiliary Equipment and Data.....	30
2.12.4	Nameplates.....	30
2.13	Piping.....	31
2.13.1	General 31	
2.13.2	Water Piping.....	31
2.13.3	Oil Piping.....	32
2.13.4	Piping Integral with Turbine Water Passages.....	32
2.13.5	Piezometer and Pressure Tap Piping.....	32
2.13.6	Compressed Air Piping.....	32
2.13.7	Instrument Piping.....	32
2.13.8	Governor and Inlet Valve Oil Pressure Piping.....	32
2.13.9	Carbon Dioxide Piping.....	33
2.13.10	Pipe Supports and Piping Materials.....	33
2.13.11	Piping Connections.....	33
2.14	Pumps.....	33
2.15	Foundation Materials.....	35
2.15.1	General 35	
2.15.2	Design 35	
2.15.3	Anchor Bolts.....	35
2.16	Handling Devices.....	35

2.17	Protection, Cleaning and Painting	36
2.17.1	General 36	
2.17.2	Employers Colour Scheme.....	37
2.17.3	Surface Preparation.....	38
2.17.4	Application Procedure	38
2.17.5	Surfaces Not to be Painted.....	38
2.17.6	Galvanising.....	38
2.17.7	Paint Schedule	39
2.18	Lubricants and Hydraulic Fluid.....	39
2.19	Ventilation and Air Conditioning Systems.....	40
2.19.1	Ductwork40	
2.19.2	Fans 43	
3	Electrical Requirements	46
3.1	General	46
3.2	System Conditions	46
3.3	Phase Rotation	46
3.4	Control Equipment Electrical Ratings	46
3.4.1	Voltage Ratings.....	46
3.4.2	Electrical Contact Ratings	47
3.5	Motors.....	47
3.5.1	Standards.....	47
3.5.2	Ratings and Characteristics	47
3.5.3	Service Factor.....	47
3.5.4	Bearings 48	
3.5.5	Starting 48	
3.5.6	Finish 48	
3.6	Cabling Installation Practice	48
3.6.1	General 48	
3.6.2	Cable Identification	49
3.6.3	Underground Cables.....	49
3.6.4	Cable Ladder	49
3.6.5	Cable Installation Practice (HV Cables)	50
3.6.6	Cabling Installation Practice (LV Cables)	50
3.6.7	Cable Installation Practice (Instrumentation Cables)	51
3.7	Cable Selection.....	52
3.7.1	240/415V Cables.....	52
3.7.2	Instrumentation Cabling	52
3.7.3	Control Cabling	53
3.8	Earthing and Equipotential Bonding	53
3.8.1	Building Structure	53
3.8.2	External Foundation Pads.....	53
3.8.3	External Fencing	53

3.9	Panel Construction	54
3.9.1	Metalwork.....	54
3.9.2	Terminals	54
3.9.3	Neutral & Earth Bars.....	55
3.9.4	Busbars & Connections.....	55
3.9.5	Fuses 55	
3.9.6	Miniature Circuit Breakers (MCBs).....	56
3.9.7	Moulded Case Circuit Breakers (MCCBs).....	56
3.9.8	Relays 56	
3.9.9	Contactors	56
3.9.10	Isolators 57	
3.9.11	Pushbuttons and Pushbutton Switches.....	57
3.9.12	Control and Selector Switches.....	57
3.9.13	Electrical Digital and Analogue Indicating Instruments.....	58
3.9.14	Motor Starters.....	59
3.9.15	Heaters 60	
3.9.16	Lighting and Receptacles	61
3.9.17	Panel Wiring	61
3.9.18	Panel Earthing	62
3.9.19	Panel Labelling	62
3.10	Small Power requirements	63
3.10.1	Outlet Boxes.....	63
3.10.2	Receptacles and Switches	63
3.10.3	Fixtures 63	
3.10.4	Ballasts 64	
3.10.5	Lamps 64	
3.10.6	Lighting Panel Boards.....	64
3.10.7	Lighting Contactor Cabinets	64
3.10.8	Photocells.....	64
3.11	Switchboards	64
3.11.1	General 64	
3.11.2	Metalwork.....	65
3.11.3	Construction	65
3.11.4	Busbars and Connections	65
3.11.5	Neutral & Earth Bars.....	66
3.11.6	Moulded Case Circuit Breakers (MCCBs).....	66
3.11.7	Miniature Circuit Breakers (MCBs).....	68
3.11.8	Cable Details	69
3.11.9	Contactors.....	69
3.11.10	Control Relays	69
3.11.11	Control Wiring	69
3.11.12	Selector Switches.....	70
3.11.13	Terminals – Control Wiring	70
3.11.14	Earthing 70	
3.11.15	Labels 70	
3.11.16	Manufacture.....	71

3.12		Distribution Boards	71
	3.12.1	General	71
	3.12.2	Cabinet Construction	71
	3.12.3	Busbars & Connections.....	72
	3.12.4	Circuit Breakers	72
	3.12.5	Isolators	72
	3.12.6	Manufacture.....	72
3.13		Battery Charger Panel Construction	72
	3.13.1	Control Panel Terminals.....	73
	3.13.2	Fuses	73
	3.13.3	Relays	73

1 Design Requirements

1.1 Design Responsibility

The Contractor shall assume full responsibility for a coordinated and adequate design of all equipment specified and shall ensure that such equipment conforms to the best engineering practice for the operating conditions specified. When requested by the Engineer, the Contractor shall furnish complete information as to the maximum stresses and other criteria used in the design. All equipment shall be proportioned and arranged to fit with proper clearances into the nominated spaces.

1.2 Project Procedures

The Contractor shall issue a set of Project Procedures within 28 days from the Commencement Date for Engineer's review and approval. Such document shall give the procedures which shall govern the relationship between Employer and Contractor, document distribution, lines of communication (including contact information), responsibility of project participants, etc.

1.3 Submittals

The following drawings and document listing is intended to summarize the information and data to be submitted by the Contractor to the Engineer. In the case of differences between this list and the specific submittal descriptions of the Employer's Requirements, or the Particular Conditions of Contract, the specific descriptions or particular conditions shall govern.

Table 1.1

<u>Document</u>	<u>Submittal Schedule</u>	<u>Submitted for</u>
A. Basic Design Drawings All documents as detailed in the "Basic Design" section of the Technical Specification.	Note 2	Review/Approval
B. Detailed Design All documents as detailed in the "Detailed Design" section of the Technical Specification.	Note 2	Review/Approval
C. Other Documents Quality control plan	Within 10 days of Commencement	Review/Approval
Contractor progress reports	Monthly	
Materials test certificates	As received.	Info/Record
QA/QC procedures	Note 2	Review/Approval
Shop test/inspection reports		Review/Approval

<u>Document</u>	<u>Submittal Schedule</u>	<u>Submitted for</u>
	On completion of each test/inspection	
Operating and Maintenance Manuals	Note 3	Review/Approval
Field Commissioning Procedures	Note 4	Review/Approval
Shop drawings	Note 2	Info/Record
As-Built design drawings	Note 2	Info/Record
Recommended spare parts and maintenance equipment list	Note 2	Review

Notes:

1. Submittals

- a. "Info/Record" refers to documentation that normally will not be reviewed by Engineer during the design phase but is required for the testing, commissioning and operation phase.
- b. "Review" refers to documents that Engineer will receive and comment on during the design, construction or testing, commissioning and testing phase, as applicable.
- c. "Approval" refers to documents Engineer shall approve or give acceptance as set forth in the Contract.
- d. If documents are required earlier to support Engineer related activities such as: permitting interface with other Employer contractors' activities, etc., Contractor shall use all reasonable efforts to support these requirements.

2. Design Drawings and Documents

- a. The Basic Design provided with the Tender shall be updated and issued as follows:
 - (1) Issue for comments from the Engineer
 - (2) Engineer comment period is 14 days
 - (3) Incorporate comments and issue for final review within 14 days
 - (4) Engineer's final review period is 14 days
 - (5) Basic Design issued within 14 days.
- b. Detailed Design to be issued as follows:
 - (1) Issue for comments from the Engineer
 - (2) Engineer comment period is 14 days
 - (3) Incorporate comments and issue for Construction
 - (4) Engineer will comment again if necessary and the Contractor will revise the document if required.
- c. Design drawings and documents shall be transmitted to Engineer upon issuance of the drawing/document, or any revision thereof, or when "Issued for Construction" or "issued for Manufacture".
- d. Shop drawings and documents to be transmitted to Engineer for "Info/Record" shall be transmitted to Engineer within 1 month after shipment of the plant to which the Shop drawing relates.
- e. As Built or As Constructed drawings and documents to be transmitted to Engineer for "Info/Record" shall be transmitted to Engineer on within 2 weeks after shipment of the plant to which the As Built drawing relates or within one month after construction is completed. Red pen markups of all

construction drawings showing any site modifications shall be retained on site until such time as the As Constructed records have been delivered.

3. Operating and Maintenance manuals shall be provided 4 weeks prior to ex works shipment of the plant to which the Operating and Maintenance manuals relates.
4. Field Commissioning Procedures shall be provided 3 months prior to the field testing and commissioning of the plant to which the Field Commissioning Procedures relates.

1.3.1 Drawing Standards

All drawings shall be prepared in accordance with ISO standards, and shall be based on the "A" series paper sizes as defined in ISO216.

Electrical drawings shall use the IEC symbolset as defined in IEC 60617.

P&ID drawings shall use the symbolset defined in the Instrument Society of America standard S5.1.

Electronic master files of all drawings shall be provided in Autocad DWG format. Each dwg file shall only contain one drawing sheet and shall have a unique file number that matches the number on the drawing sheet. The electronic file shall be saved such that, upon opening, the full drawing is depicted on the screen and the "Print Extents" command will print the entire drawing correctly aligned on the paper.

All drawings shall include the following:-

- Drawing title.
- Logo for the Employer, Engineer and Contractor.
- Original drawing size.
- Revision Index.
- Quality control verification for checked and approved.
- Space for Employers Approval.
- Drawing number using the Employers drawing numbering system.

All modifications made to a drawing shall be "clouded" and marked with the revision identification. Previous revision clouding shall be removed.

1.3.2 Outline Drawings

Outline drawings shall be drawn to scale and denoted with critical or major dimensions. Drawings shall include estimated weights, external forces, anchoring details and overall dimensions and information on installation requirements for the equipment.

1.3.3 Detail Drawings

Detail drawings shall consist of general assembly Drawings, subassembly Drawings and details to demonstrate fully that all parts will conform to the provisions and intent of the Employer's Requirements and to the requirements of their installation, operation and maintenance.

1.3.4 Line Diagrams

- Electrical Single line diagrams showing the power connections, location of instrument and control transformers, and connections to transducers, meters, relays and instruments.
- Single line relay diagrams. Expanded single line diagrams showing all protective relay elements and tripping paths.
- Process and Instrumentation Diagrams (P&IDs) for all systems.

1.3.5 Schematic/Elementary Diagrams

Diagrams shall demonstrate the operation of the supplied control equipment. They shall include:

- Electrical schematic drawings showing each individual component, terminal, interconnecting wiring, associated terminal, conductor and cable identification; protective device ratings and settings; voltage levels.

Electrical schematic drawings shall be ladder style drawing to DIN standards, including an 'assembled form' depiction of each element with references identifying the drawing sheet on which each terminal is used.

1.3.6 Wiring Diagrams

Diagrams shall show the point-to-point interconnections of the control and power equipment. Control devices and terminal blocks shall be shown in their correct relative positions. One side of the terminal blocks shall be clearly identified for external wiring connections and shall be free of any manufacturer's wiring. Control devices and terminal blocks shall be identified in accordance with schematic/elementary diagrams.

1.3.7 Panel Layouts

Equipment and nameplates mounted on and within control cabinets and switchboards shall be shown. Diagrams shall be drawn to scale.

1.3.8 Nameplate Schedules, Meter Scales, Engravings and Switch Handles

Schedules for all front-of-panel devices and equipment shall be provided. Nameplate schedules shall include dimensions and lettering size. Scale markings for meters and other indicating instruments shall be shown. Escutcheon plate and legend plate engravings and type and color of switch handles shall be shown.

1.3.9 Design Calculations

The design calculations shall define the design approach, assumptions, criteria used and the calculated results in sufficient detail to demonstrate that the equipment meets the specified requirements and to provide adequate information for trouble-shooting of the equipment.

1.3.10 Bills of Material

A list of equipment shall be submitted for each major assembly or sub-assembly and shall include the names of manufacturers of articles and auxiliary equipment to be incorporated in the work, together with description, part number, ratings, performance characteristics and other significant information as necessary to allow the Employer to obtain replacement parts. A separate list of equipment shall be provided for each printed circuit board and sub-assembly incorporated into the work, identifying the individual components mounted on the board. Bills of Material shall be provided listing the spare parts, special tools and maintenance equipment.

1.3.11 Cable Schedules

Tabulations showing the routing of all cable and wire used for power, control and instrumentation circuits shall be provided. Cable tabulations shall be prepared showing the type, size and number of conductors in each cable. Each cable shall be given a unique cable identifier. The cable tabulations shall list the equipment to which each cable is connected (From/To) and the cable tray in which it is routed.

1.3.12 Pipe Schedules

Tabulations showing the routing of all piping shall be provided. Pipe tabulations shall be prepared showing the material, size, pressure and conveyed material of each pipe. Each pipe shall be given a unique pipe identifier. The pipe tabulations shall list the equipment to which each pipe is connected (From/To) and the pipe rack in which it is routed.

1.3.13 Functional Block Diagrams

1.3.14 Block diagrams shall be provided that show the functional configuration of the main components of a system including the communication network and paths interconnecting them. The functional block diagram shall be presented in a manner that conveys the functionality of the system.
Termination Drawings/Schedules

All terminations of power, control and instrumentation cable external to an electrical component, panel or cabinet shall be shown either on termination drawings or on schedules. Information shall include the terminal block designation, cable identifier, cable characteristics (i.e., size, number conductors/pairs/triads, shielding) conductor identification (e.g., number, color), number of spare conductors and to where the other end of the cable is routed (with references).

1.3.15 Logic Diagrams

1.3.15.1 *General*

A complete set of logic diagrams describing the software used in microprocessor-based controllers shall be provided. The logic diagrams shall be provided as follows:

- Analog Control Loops. These diagrams shall be provided in accordance with ISA standard format.

- Sequencing Controls. Controls used for sequencing logic shall be provided in Boolean or ladder-type format.

Logic diagrams shall be drawing in accordance with IEC 61131-3.

1.3.15.2 *Software*

Software updates or enhancements shall be supplied to the Employer at no charge within two (2) years after the last delivery of the equipment. After this period, updates shall be made available to the Employer at a negotiated fee.

1.3.16 **Erection Schedule**

A detailed erection schedule shall be prepared and submitted to the Engineer showing the estimated time needed for installation and listing the type and number of personnel and tools required by the Contractor. The schedule shall be submitted not later than two (2) months prior to delivery of the first piece of equipment. The schedule shall include the time required for field erection, installation, check-out, start-up, initial operation, testing and test run.

1.3.17 **Instructions**

1.3.17.1 *General*

The Contractor shall submit written detailed instructions for factory assembly and testing; handling and storage; installation, operating and maintenance and field commissioning procedures of check-out, start-up, initial operation, testing and test run for each item of equipment. The instructions shall be submitted as early as possible so that final reviewed copies can be made available to the field for use in planning their work well in advance of actual installation and operation. After review, ten (10) complete, durable bound copies of the final instructions shall be furnished.

1.3.17.2 *Shop Assembly and Testing Procedure*

A step-by-step procedure shall be submitted outlining the details of the checks to be made before and after factory assembly and testing of the equipment to demonstrate that the requirements of these Employer's Requirements and other parts of the Contract have been fulfilled. The factory assembly and testing procedure shall be submitted in a tabular form itemizing each test, indicating the results expected in accordance with the design and leaving space for the actual observation during assembly and testing. The test procedures shall include test values to be used, maximum/minimum acceptable test results and reference to accepted industry standards. The limitations, if any, of the factory tests shall be fully explained and shall be approved by the Engineer.

1.3.17.3 *Handling and Storage Instructions*

Detailed instructions, with illustrations, diagrams and weights, for handling, storage and care of equipment at the site shall be submitted. The instructions shall include:

- Identification of parts requiring special outdoor, indoor or temperature or humidity-controlled storage for both long- and short-term storage;
- Space requirements for outdoor, indoor and temperature- or humidity-controlled storage for both long-term and short-term storage;
- The procedures to be observed in unloading, placing, stacking and blocking of equipment;
- Rigging and lifting procedures;
- Maintenance procedures for both long- and short-term storage including maximum recommended storage period for items stored outdoors;
- Periodic rotation of components, where required;
- Application of protective coatings; and
- Cleaning of protective coatings and/or corrosion prior to installation.

1.3.17.4 *Installation Instructions*

Detailed instructions for the installation of the equipment shall be submitted together with reduced-size copies of applicable Drawings showing the erection sequence. The instructions and Drawings shall include information on handling and slinging the major pieces of equipment including weights, erection tolerances and special precautions to be observed during installation.

1.3.18 **Operating and Maintenance Instructions**

2.1.1.1.1 **General**

The Contractor shall provide sets of well structured, comprehensive and coordinated manuals to fully describe all aspects of design, operating and maintenance of all plant, equipment and systems provided under the Contract.

The Contractor shall arrange his manuals in three separate parts, namely Design, Operation and Maintenance. The layout of each part should, as far as possible, be consistent throughout each of the three parts, with systems, plant and plant described in the same order in each section. Each section shall be divided into as many volumes as necessary for convenient handling and reference.

Comprehensive indexing and cross-referencing shall be included to ensure easy access to information as required. A master index covering all three parts of the manuals shall be included in each volume, in addition to the detailed index for the particular section. PDF manuals shall include bookmarks and hyperlinks to facilitate navigation through the manual.

The manual format shall be on standard metric A4 sheets. Drawings and schedules, which are to be bound into the manual, shall be either A4 or A3 folded to A4.

Manuals from all sub-contractors shall be written in the same format.

The manuals shall include instructions only for the actual plant supplied and not for alternative or optional plant. For instance, a pump may have several different shaft sealing systems, but reference shall be made only to the system supplied.

All plant identification shall be by means of description and numbering systems specific to the Project as approved by the Employer.

Three hardcopy, and one pdf electronic copy of each manual shall be provided.

2.1.1.1.2 Scope of Manuals

The information to be provided in the manuals shall include, but not be limited to, the material listed in the following sections. They shall provide all necessary information for plant and procedures.

Design Manuals

The volume(s) comprising the design part of the manual should be laid out as follows:-

- Preliminary pages including index, preface, amendment record sheet and illustration of the complete plant.
- General description of the system including:-
 - System diagrams and block diagrams showing sub-systems and interconnection with other systems.
 - System description, including design basis, function, location and modes of operation.
 - Design data including calculations, performance curves, materials specification and running clearances and settings.
 - Instrument and valve lists itemising function, type, number, range and alarms.

Operation Manuals

The volume(s) comprising the operation part of the manual should be laid out as follows:-

Part A: Preliminary pages including index and amendment sheets.

Part B: Operating procedures and instructions for commissioning, start-up, normal operation, shut-down, standby, emergency action, on load and off load testing procedures.

- Normal range of system variables.
- Normal periodic servicing requirements.
- Operating limits and hazards.
- Procedures detailed under the heading of "Emergency Action" should include:-
 - i. *Action Upon Receipt of Alarm*
 - Alarm condition
 - Appropriate action
 - ii. *Emergency Procedures (for each major fault situation)*
 - Fault condition
 - Diagnostic procedure
 - Initial actions
 - Follow up action and operation

Part C: Testing and checking requirements.

Part D: Effect of loss of normal power.

Part E: System schematics and special diagrams should be included as necessary to enable operators to follow and understand the operating sequences; to perform safe isolations; and to become fully conversant with the plant without recourse to large-scale drawings.

Maintenance Manuals

The volume(s) comprising the maintenance part of the manual should be laid out as follows:-

Part A: Preliminary pages including index and amendment record sheets.

Part B: Maintenance data including the following:-

- i.* A schedule detailing the frequency of maintenance activities and the checks/servicing that are to be undertaken on a daily/weekly/monthly/annually basis.
- ii.* Permissible limits of wear of components and clearance, together with maximum and minimum 'as fitted' clearances, shall be shown for both preventive and overhaul procedures on specially prepared sectional diagrams. All points of measurement of radial and lateral clearances, and dimensions of components subject to wear under normal running conditions, should be identified by a lettered key. The key should provide in tabular form separate references for individual wearing dimensions and permissible clearances.
- iii.* Details and location of all springs.
- iv.* Details and location of all ball and roller bearings.
- v.* Details and location of all jointing materials, seals and 'O' rings.
- vi.* Details of weld preparations; types of electrodes; and preheating and stress relieving procedures for all joints which have to be broken and remade for normal overhaul and repairs. This information shall also be provided for other selected items, such as welded in valves.

Part C: Preventive Maintenance including list of tools required and list of component replacements normally required. All instructions should be submitted in a concise, tabular, check list form.

Sufficient sketches or drawings shall be included, where necessary, to enable the craftsman to comply with the instructions without recourse to full size engineering drawings.

Part D: Overhaul Maintenance including:-

- i.* A list of necessary engineering drawing numbers.
- ii.* A list of special tools required.
- iii.* A list of component spares normally required.
- iv.* A list of component weights of 500 kg and above.

All procedures shall be arranged in a logical sequence generally in the following order:-

- i.* Check list of operations prior to dismantling.
- ii.* Dismantling sequence, with details of any special methods to be adopted.
- iii.* Check list of inspections, which should include checks of permissible tolerances.
- iv.* Reconditioning, replacements and adjustments normally anticipated.
- v.* Re-assembly sequence, with details of any special methods to be adopted.
- vi.* Final checks pre-operational tests and special calibration tests.

Engineering drawings need not be included, but should be referred to as applicable. However, assembly drawings shall be included. Small illustrations and exploded views should, however, be inserted adjacent to the text concerned.

Part E: Instrument and Control System Maintenance. A broad outline of the plant shall be included in the Design Manual. The detailed description together with data sheets, shall be included in the Maintenance Section for:-

- i.* System and component fault finding.
- ii.* Component replacement and/or repair.
- iii.* Instrument calibration requirements and procedures.
- iv.* The requirements, as appropriate, specified for Mechanical and Electrical plant maintenance.
- v.* Test plant shall be listed in the manner specified for special tools.

Part F: Special Diagrams and Illustrations shall be provided for as follows:-

- i.* Logic diagrams are required to illustrate both the major sequences and the detailed step by step operation logic and to aid comprehension of complicated systems.
- ii.* Complementary functional diagrams shall be included as necessary to show in more detail the operation of a system or systems. The layout of the functional diagrams shall simplify the understanding of the operation of the systems, and need not bear any relationship to the physical size or location of the items.
- iii.* Electronic and electrical circuit diagrams shall conform with the layout of best engineering practice, component values and references being also given on the illustration. For testing and fault finding purposes, circuits shall include typical waveforms and voltages at points throughout the circuit and state the test plant used to obtain the waveforms and voltages.
- iv.* A component layout or wiring diagram shall also accompany a circuit diagram to assist the location of test points and components. This layout illustration should be a line drawing showing the sub-units and components in outline with relative sizes and locations shown in correct proportion.

Part G: Part Lists. The lists shall be presented in a logical engineering sequence (ie, Main Assembly, Sub-assembly and Components), the components being listed under their respective subassemblies. The lists shall include all items which are subject to replacement or repair.

Each Main Assembly, Sub-assembly and Component shall be designated with its complete ordering description and its detail drawing number or basic part number.

- i.* Where a "set" of items is listed, the items comprising the set and the detail drawing number or basic part number of each component shall be stated.
- ii.* Applicable material specification references shall be provided.
- iii.* The manufacturer's name, detail drawing number or basic part number shall be stated.

Exploded views shall be included where available, all parts being identified by item numbers.

Part H: Lubrication Schedule showing requirements and specifications for all plant covered by this Specification.

Part I: Cleaning and conservation procedures.

1.3.19 Field Commissioning Procedures of Check-Out, Start-Up, Initial Operation, Testing and Test Run

Manuals for the detailed procedures with applicable illustrations and diagrams for the sequential check-out, start-up, initial operation, testing and test run of the equipment after field installation shall be submitted. The instructions shall include:

- Components to be cleaned, checked and adjusted, with methods and precautions given;
- Methods of checking all clearances and
- Preliminary detailed operating and testing procedures for field check-out, start-up, initial operation, testing and test-run of the equipment.
- The procedures shall be submitted in a tabular form itemizing each operation and test, indicating the results expected in accordance with the design and leaving space for the actual observation during commissioning.

1.3.20 Reports

The Contractor shall furnish six (6) bound copies of all final reports related to the equipment including testing, initial operation, load rejection and load acceptance tests and the index and capacity tests. The reports shall be bound for permanent reference use.

1.3.21 Photographs

The Contractor shall furnish progress photographs of the factory and field erection work done. Photographs shall be taken at approximately quarterly intervals. Photographs shall be approximately 200 mm by 250 mm in size including a margin on one 250 mm side for binding. Approximately twenty-five (25) views each of the turbines and generators and five (5) views each of the inlet valves, governing systems and excitation systems will be required. Each photograph shall contain upon its face the date, the name of the manufacturer and the title of the view taken.

1.4 Quality Control & Testing Plans

Within 10 days after the Commencement Date, the Contractor shall provide a Quality Control Plan applicable to this Project.

The Contractor's Quality Control Plan shall comprise procedures for Quality Control and Quality Assurance. The plans shall include both design requirements and construction materials and workmanship requirements.

The Quality Control Plan shall define and document the Contractor's commitment to and policy for quality. The Contractor shall ensure that the policy and the associated procedures are understood, implemented and maintained at all levels in his organization, including all subcontractors. The Contractor's Quality Control Plan shall be based on well-established principles and proven performance.

The Quality Control Plan shall be supplemented as work proceeds with specific work and inspection procedures for all major activity. The work and inspection procedures shall include:

- Acceptance criteria, witness points and hold points specified in the construction requirements or in any standard or code adopted by the Contractor.
- Witness points for all the stages in the construction process where subsequent activities will disguise the quality and/or quantity of the previous activity thus making inspection and testing unfeasible, and/or where the subsequent activities will prevent correction of non-conformities.
- The Contractor shall issue relevant work procedures and inspection plans for the Engineer's review prior to the commencement of each main activity, unless stricter demands are specified in special cases.

The Contractor's Quality Control Plan shall be submitted to the Engineer for review. The Contractor shall monitor and approve his own work using the Quality Control Plan. The Engineer will monitor the Contractor's ability to follow approved plans and procedures throughout the entire project. The Contractor shall provide copies of review reports and test reports to the Engineer on a monthly basis.

The Engineer may audit the Contractor's records at any time to verify that sufficient reviews, checks, and tests are being performed. The Engineer reserves the right to:

- Include further stages as witness or hold points if these are considered to have been omitted by the Contractor;
- Change the designation of any stage from a witness point to a hold point should this be deemed necessary.
- Require all materials to be identifiable and traceable, unless otherwise stated.

1.4.1 Witnessing of Shop Assembly and Tests

The factory assemblies and tests specified for the various items of equipment will be witnessed by a representative of the Engineer, and the completed factory inspection and test forms showing the results will be signed by him. Copies of all factory inspection and test records shall be furnished to the Engineer. No equipment shall be shipped from the factory until it has been inspected and tested, or the inspection has been waived in writing by the Engineer. However, the waiver of any test or the witnessing of factory assemblies and tests by the Engineer shall not constitute a release of the Contractor's responsibility to meet fully the

requirements of this Contract. Prior to major factory assemblies and tests, the Contractor shall submit an outline of the procedures and tests it plans, to demonstrate fulfilment of the requirements specified in subsequent Parts of the Employer's Requirements under the heading "Shop Assembly and Tests" for the equipment.

1.4.2 Factory Tests

Factory tests shall be performed for main components and systems including but not limited to 11kV Switchgear. The Contractor shall inform the Engineer of all Factory Tests to be carried out and the Engineer shall have the right to inspect such factory tests.

Certified test results for tests previously performed on similar equipment may be submitted in lieu of performing dedicated factory tests, subject to review and approval of the Engineer.

1.4.3 Test and Commissioning Plan

Contractor shall provide a plan to perform Testing and Commissioning of the Works.

1.4.4 Training Program

The Contractor shall provide a plan to train the Employer's O&M personnel.

1.4.5 Materials

Current certificates of tests by manufacturers shall be available for inspection by the Engineer. Such certificates shall relate to the materials delivered to the Site and Contractor's work areas. Certified true copies of certificates may be submitted if the original certificates cannot be obtained from the manufacturer. A letter from the supplier certifying that the certificates are related to the delivered materials shall be submitted with the certificates. Parts and/or materials which are to be assembled on the sites and Contractor's work areas, shall be marked to identify the component parts.

Materials which are specified by means of trade or proprietary names may be substituted by the equivalent materials from a different manufacturer provided that the materials are of the same or better quality and comply with the specified requirements.

All materials and goods shall be stored strictly in accordance with the manufacturers instructions so as to insure no deterioration occurs prior to incorporation in the Works.

Materials and goods shall be stored to prevent harm to people's health or the environment.

1.4.6 Supplier Information

Contractor shall submit two (2) copies of technical data for major materials and equipment procured, including factory drawings, erection drawings, and supplier manuals.

1.4.7 Purchase Orders

Unpriced purchase orders, shall be submitted by the Contractor for all purchased materials and equipment and any subcontracted services. Every 30 days Contractor shall update and submit two (2) copies of the purchase order log.

1.4.8 Spare Parts Lists

Contractor shall provide a recommended priced spare parts list no later than 30 days after its placement of orders for materials and equipment.

1.4.9 Notice(s) of Equipment Inspections

Engineer will review purchase orders and advise Contractor of any tests or inspection hold points specified in the purchase orders that Engineer desires to witness. Contractor shall provide Engineer reasonable notice to witness these inspections and tests designated to be witnessed at suppliers' Works.

1.4.10 Shop Inspection and Test Reports

All factory inspection and test reports for Materials and Equipment shall be submitted to Engineer for review.

1.4.11 Quality Control Reports

The Contractor shall submit two (2) copies of quality control records such as, concrete test reports, structural steel bolting, weld inspections (visual, magnetic particle, X-ray), stress relieving, pump alignment, motor meggering, continuity wiring checks, etc.

1.4.12 Manufacturer Field Service Reports

All manufacturers' field representatives shall provide field inspection reports upon completion of each Site visit. Contractor shall submit these reports to Engineer.

1.4.13 As-Built Drawings

Contractor shall provide three (3) copies and one (1) reproducible of final plans for the civil works, P&ID's, electrical single-line drawings, and control logic diagrams, prior to issuance of the Taking-Over Certificate.

1.5 Drawings Furnished by the Employer

Any drawings furnished by the Employer, are not to be considered as defining the design of the plant to be furnished but are merely illustrative to show the general layout of the plant and for clarifying the Employer's Requirements. The Contractor shall provide standard proven designs, modified only to the extent required to comply with the Employer's Requirements.

1.6 Units of Measurement

The units of measurement to be used throughout this Contract shall be metric in accordance with ISO 1000:1992 "SI units, etc." On drawings or printed pamphlets where other units have been used, the equivalent metric measures shall also be shown.

1.7 Site Conditions

1.7.1 General Conditions

The equipment shall be suitable for operation at, and ratings shall be based on, the following conditions:

- Maximum outdoor ambient temperature for design purposes 40°C
- Minimum ambient air temperature 5°C
- Maximum average of 24 hours 32°C
- Relative Humidity 50 - 90%
- Average annual rainfall 4800 mm
- Thunder storm days per year (estimate) 50

1.7.2 Transport Limitations

The contractor shall be free to select the route for delivery of plant to site and shall be responsible for determining any limitations on route selections imposed by weight and/or size limits on roads, bridges, etc.

1.7.3 Water Conditions and Corrosion

1.7.3.1 *Water Analyses*

The Contractor shall perform his own analyses and evaluation of the water in determining that suitable materials are used for the equipment.

1.7.3.2 *Design Provisions Against Corrosion*

The Contractor shall design the equipment and provide materials that will give satisfactory service based upon his evaluation of the water characteristics.

1.7.3.3 *Corrosion Resisting Bolts and Nuts*

Corrosion resisting stainless steel or bronze shall be used for bolts and nuts when either or both are subject to contact with river water and/or frequent adjustment or frequent removal, such as adjusting bolts for packing glands on removable screens or strainers, on adjustable bearings, etc.

1.8 Spare Parts

1.8.1 Specified Spare Parts

The Contractor shall be responsible for providing all spare parts as specified by the Employer in the Specifications.

1.8.2 Optional Spare Parts and Maintenance Equipment

As part of the Basic Design, the Contractor shall provide a list of any recommended, Optional spare parts and maintenance equipment, including prices, and shall indicate the time required for delivery of each item to the site. Prices shall be valid for 1 (one) year after submission of the Basic Design which time the Engineer will decide which, if any, of recommended spare parts and maintenance equipment will be purchased from the Contractor.

1.9 Tools and Appliances

The Contractor shall provide one set of all special tools and appliances, including lifting gear, required for the proper maintenance of all the plant to be supplied and installed.

The term Special Tools shall include:-

- Sockets and spanners over 25 mm
- All tools requiring 20 mm (3/4 inch) square or hexagonal drives
- All fabric or steel slings and shackles over 2 tonnes capacity
- All torque, stretch or heat tightening equipment
- All lifting gear
- All special devices, jigs and instruments

Each tool and appliance is to be clearly marked with its size and/or purpose, and shall be handed over in new condition. The tools and appliances with the appropriate boxes or display boards shall be handed to the Engineer store in good condition not less than one month prior to commencement of the Tests at Completion.

1.10 Labels and Plates

The Contractor shall supply all name plates, caution plates and labels for the safe and efficient operation of the plant.

Each item of plant shall have permanently attached to it in a conspicuous position a nameplate or label of approved size and pattern. Before the manufacture of any nameplates or labels, the Contractor shall submit to

the Engineer a copy of the nameplate and label design standard for approval. All data, name plates and instruction plates on plant and cubicles shall be in the English language.

1.11 Standards

All design and construction work, including the materials used and methods applied, shall be in accordance with one or more internationally recognized standards of practice. By definition, such standards comprise organizations such as the IEC (International Electro-Technical Commission), ASTM (American Society for Testing and Materials), ISO (International Organization for Standardization), DIN (German Code), BS (British Standard), SS (Swedish Standard), EN (European Standard), or equivalent.

Should the Contractor request alternatives to the above standards, other relevant standards may be used subject to Employer's approval. Differences between the standards specified and the proposed alternative standards must be fully described in writing by the Contractor and submitted to the Employer for review and approval.

The latest editions on the Base Date of the standards and codes, including amendments, shall be used by the Contractor, unless expressly stated otherwise.

An English translation shall be submitted if the standards and codes proposed by the Contractor are in a language other than English.

All specific references to standards and codes throughout these Employer's Requirements are governed by this Part.

The Works shall be constructed in accordance with the laws of Fiji and associated Acts and Regulations. These include:-

- The National Building Code of Fiji -1990
- The Electricity Act (Chapter 180) – 1985
- Health and Safety at Work Act – 1996
- Environment Management Act

In order to achieve Regulatory compliance under the Fiji Electricity Act, the Works shall comply with the Electricity Regulations and AS/NZS 3000:2000 "Wiring Rules".

The standards under which the work is to be performed or tested are specified throughout these Employer's Requirements. Where such standards are in conflict with the provisions of these Employer's Requirements, the Employer's Requirements shall govern. In case of conflicting requirements that are not specified definitely in these Employer's Requirements between the standards of above authorities, such disagreements shall be resolved by the Engineer, and the Engineer's decision shall be final. It is understood that the latest revision or edition of such standards at the time of Tender shall apply.

In the absence of specific standards being nominated in the specifications, the following Standards shall apply:-

1.11.1 Australian/New Zealand Standards

AS/NZS	1170	Structural Design Actions
AS/NZS	1359.5	Rotating electrical machines—General requirements. Part 5: Three-phase cage induction motors—High efficiency and minimum energy performance standards requirements.
AS/NZS	1429.1	Electric cables - Polymeric insulated - For working voltages 1.9/3.3 (3.6) kV up to and including 19/33 (36) kV
AS	1824	Insulation coordination – Definitions, principles and rules
AS	1940	The storage and handling of flammable and combustible liquids
AS	2067	Switchgear Assemblies and Ancillary Equipment for Alternating Voltages above 1kV
AS/NZS	2312	Guide to the protection of structural steel against corrosion by the use of protective coatings
AS/NZS	2373	Electric cables – Twisted pair for control and protection circuits
AS	2676.2	Guide to the installation, maintenance, testing and replacement of secondary batteries in buildings: Sealed cells
AS/NZS	3000	Wiring Rules
AS/NZS	3008	Electrical installations – Selection of cables – Cables for alternating voltages up to and including 0.6/1 (1.2) kV.
AS/NZS	3010	Electrical Installations – Generating Sets
AS	3011.2	Electrical installations – Secondary batteries installed in buildings, Part 2: Sealed cells
AS/NZS	3080	Telecommunications installations - Generic cabling for commercial premises
AS/NZS	3155	Approval and test specification - Electric cables - Neutral screened - For working voltages up to and including 0.6/1 kV
AS/NZS	3439	Low voltage switchgear and control gear assemblies
AS	4024	Safety of machinery, (all relevant parts)
AS	4044	Battery chargers for stationary batteries
AS/NZS	5000	Electric cables – Polymeric insulated – For working voltages up to and including 0.6/1 (1.2) kV.
AS/NZS	60265	High-voltage switches
AS	60529	Degrees of protection provided by enclosures (IP Code)
AS	60870	Telecontrol equipment and systems (All parts)
AS/NZS IEC	60947	Low voltage switchgear and controlgear

1.11.2 International Electrotechnical Commission (IEC)

IEC	60034	Rotating Electrical Machines – all relevant parts
IEC	60038	IEC Standard Voltages
IEC	60041	Field acceptance tests to determine the hydraulic performance of hydraulic turbines, storage pumps and pump-turbines
IEC	60044	Instrument Transformers
IEC	60051	Direct acting indicating analogue electrical measuring instruments and their accessories
IEC	60060	High Voltage Test Techniques
IEC	60071	Insulation Co-ordination
IEC	60072	Dimensions and output series for rotating electrical machines

IEC	60076	Power Transformers
IEC	60085	Thermal Evaluation And Classification of Electrical Insulation.
IEC	60086	Primary Batteries
IEC	60099	Surge Arrestors
IEC	60193	Hydraulic turbines, storage pumps and pump-turbines - Model acceptance tests
IEC	60228	Conductors of Insulated Cables
IEC	60255	Measuring relays and protection equipment
IEC	60269	Low-voltage fuses
IEC	60304	Standard colours for insulation for low frequency cables and wires
IEC	60308	Hydraulic turbines - Testing of control systems
IEC	60354	Loading Guide For Oil Immersed Transformers
IEC	60364	Low-voltage electrical installations
IEC	60446	Basic and safety principles for man-machine interface, marking and identification - Identification of conductors by colours or alphanumeric
IEC	60502	Power cables with extruded insulation and their accessories for rated voltages from 1 kV ($U_m = 1,2$ kV) up to 30 kV ($U_m = 36$ kV)
IEC	60534-4	Industrial Process Control Valve - Part 4: Inspection and routine testing
IEC	60545	Guide for commissioning, operation and maintenance of hydraulic turbines
IEC	60551	Determination Of Transformer And Reactor Sound Levels
IEC	60609-1	Hydraulic turbines, storage pumps and pump-turbines - Cavitation pitting evaluation - Part 1: Evaluation in reaction turbines, storage pumps and pump-turbines
IEC	60617	Graphical Symbols for Diagrams
IEC	60654	Industrial-process measurement and control equipment - Operating conditions
IEC	60664	Insulation coordination for equipment within low-voltage systems (All Parts)
IEC	60715	Dimensions of low voltage switchgear and control gear
IEC	60793	Optical fibres
IEC	60794	Optical fibre cables
IEC	60870	Telecontrol equipment and systems - All Relevant Systems
IEC	60896	Stationary Lead-Acid Batteries
IEC	60934	Circuit breakers for equipment
IEC	60994	Guide for field measurement of vibrations and pulsations in hydraulic machines (turbines, storage pumps and pump-turbines)
IEC	61000	Electromagnetic Compatibility
IEC	61116	Electromechanical equipment guide for small hydroelectric installations
IEC	61131-2	Programmable controllers
IEC	61131-3	Programming languages
IEC	61362	Guide to specification of hydraulic turbine governing systems
IEC	61439	Low-voltage switchgear and controlgear assemblies
IEC	61634	High-voltage switchgear and controlgear - Use and handling of sulphur hexafluoride (SF ₆) in high-voltage switchgear and controlgear
IEC	61660	Short-circuit currents in DC auxiliary installations in power plants and substations
IEC	61850	Power Utility Automation
IEC	61869	Instrument Transformers
IEC	61936	Power installations exceeding 1 kV a.c

IEC	62006	Hydraulic Machines - Acceptance tests of small hydroelectric installations
IEC	62040	Uninterruptible power systems (UPS)
IEC	62097	Hydraulic machines, radial and axial - Performance conversion method from model to prototype
IEC	62270	Guide for computer-based control for hydroelectric power plant automation
IEC	62271	High voltage switchgear and controlgear
IEC	62271-37-013	Alternating current generator circuit breakers

1.11.3 American National Standards Institute (ANSI)

ANSI/ISA	S5.1	Instrumentation Symbols and Identification
ANSI	B49.1	Shaft Couplings, Integrally Forged Flange Type for Hydroelectric Units
ANSI	S82.03	Safety Standard for Electronic Test, Measuring Controlling and Related Plant
ANSI	B16.104	ANSI/FCI 70-2 Control Valve Seat Leakage

1.11.4 Institute of Electrical and Electronic Engineers (IEEE)

IEEE	80	IEEE Guide for Safety in AC Substation Grounding
IEEE	485	Recommended Practice for Sizing Lead-Acid Batteries for Stationary Applications
IEEE	802.1 AB	Station and Media Access Control Connectivity Discovery
IEEE	802.1 D	Media Access Control Bridges
IEEE	802.1 Q	Virtual Bridged Local Area Networks
IEEE	802.3	Ethernet
IEEE	807	Recommended Practice for Unique Identification in Hydroelectric Facilities
IEEE	810	Standard for Hydraulic Turbine and Generator Integrally Forged Shaft Couplings and Shaft Runout Tolerances
IEEE	1095	Guide for Installation of Vertical Generators and Generator/Motors for Hydroelectric Applications
IEEE	1207	Guide for the Application of Turbine Governing Systems for Hydroelectric Generating Units
IEEE	1613	Standard Environment and Testing Requirements for Communication Networking Devices in Electric Power Substations

1.11.5 British Standards (BS)

BS	148	Unused Mineral Insulating Oils For Transformers And Switchgear
BS EN ISO	1461	Hot dip galvanized coatings on fabricated iron and steel articles
BS	6231	Specification for PVC-insulated cables for switchgear and controlgear wiring
BS	6651	Protection of structures against lightning.
BS	7354	Code of Practice for Design of high-voltage open-terminals stations, Section 7: Earthing.
BS	7430	Code of Practice for Earthing.

1.11.6 **ASTM**

ASTM	A27	Specification for Mild to Medium-Strength Carbon-Steel Castings for General Application
ASTM	A36	Specification for Structural Steel
ASTM	A487	Specification for Steel Castings Suitable for Pressure Service.
ASTM	A240	Specification for Chromium and Chromium-Nickel Stainless Steel Plate, Sheet, and Strip for Pressure Vessels and for General Applications
ASTM	A275	Standard Method for Magnetic Particle Examination of Steel Forgings
ASTM	A282	Forged Stainless Steel Fittings, Socket-Welding and Threaded
ASTM	A285	Specification for Low and Intermediate Tensile Strength Carbon Steel Plates for Pressure Vessels (Plates 50 mm and Under in thickness)
ASTM	A312	Specification for Seamless and Welded Austenitic Stainless Steel Pipe
ASTM	A345	Specification for Flat Rolled Electrical Steel
ASTM	A388	Standard Practice for Ultrasonic Examination of Heavy Steel Forgings
ASTM	A403	Specification for Wrought Austenitic Stainless Steel Pipe Fittings
ASTM	A420	Specification for Stainless and Heat-Resisting Chromium and Chromium-Nickel Steel Plate, Sheet, and Strip for Fusion-Welded Unfired Pressure Vessels
ASTM	A516	Specification for Carbon Steel Plates for Pressure Vessels for Moderate and Lower Temperature Service
ASTM	A517	Specification for High Strength Alloy Steel Plates, Quenched and Tempered, for Pressure Vessels
ASTM	A582	Specification for Free-Machining Stainless and Heat-Resisting Steel Bars, Hot-Rolled or Cold-Finished
ASTM	A666	Specification for Annealed or Cold-Worked Austenitic Stainless Steel Sheet, Strip, Plate, and Flat Bar
ASTM	A668	Specification for Steel Forgings, Carbon and Alloy for General Industrial Use
ASTM	A743	Specification for Casting, Iron-Chromium, Iron-Chromium-Nickel, and Nickel Base (Corrosion-Resistant) Alloy Castings for General Application
ASTM	B21	Specification for Naval Brass Rod, Bar, and Shapes
ASTM	B31.1	Power Piping
ASTM	B42	Specification for Seamless Copper Pipe, Standard Sizes
ASTM	B88	Specification for Seamless Copper Water Tube
ASTM	B127	Specification for Nickel-Copper Alloy Plate, Sheet, and Strip
ASTM	R0027	Standards Related to Nondestructive Testing Developed by ASTM Committees Other Than Committee E-7
ASTM	Vol 03.03	Nondestructive Testing

1.11.7 **Other**

ASME		American Society of Mechanical Engineers, "Boiler and Pressure Vessel Code," Division 2.
ASME	PTC Code 18	Hydraulic Turbines
CCH	70-3	Specification for inspection of steel castings of hydraulic machines.

All other equipment furnished under this section shall conform to the requirements of applicable Standards.

In addition to the Standards listed in the specification, and the Standards listed above all other aspects of the powerhouse and switchyard equipment shall be designed, manufactured and tested in accordance with the

pertinent provisions of the codes and standards of the following listed institutes, associations and other organizations:

Name	Abbreviation
American National Standards Institute	ANSI
American Society of Mechanical Engineers	ASME
American Society for Testing and Materials	ASTM
Australian Standards	AS
Australia/New Zealand Standards	AS/NZS
Institute of Electrical and Electronics Engineers	IEEE
International Electrotechnical Commission	IEC
Fijian Standards	FJS
New Zealand Standards	NZS

2 Mechanical Requirements

2.1 Workmanship

All materials shall be new, of a first-class nature. All materials shall comply with the latest relevant authorised standards for Testing Materials unless otherwise specified or permitted by the Engineer.

All workmanship shall be of highest class throughout to ensure smooth and vibration free operation under all possible operating conditions, and the design, dimensions and materials of all parts shall be such that the stresses to which they may be subjected shall not render them liable to distortion, undue wear, or damage under the most severe conditions encountered in service.

All parts shall conform to the dimensions shown, and shall be built in accordance with, the approved drawings. All joints, datum surfaces and mating components shall be machined and all castings shall be spot faced for bolts and/or nuts. All machined finishes shall be shown on the approved drawings.

All screws, bolts, studs and nuts and threads for pipe shall conform to the latest standards of the International Organization for Standardization (ISO) covering these components and shall all conform to the standards for metric sizes. The Contractor shall use exclusively the standard and size system presented in his Tender and accepted and incorporated in this Contract.

2.2 Handrails

Adequate safety handrails and guards shall be provided around the plant, where necessary, to afford protection from all moving and electrical parts. Such items shall be designed to facilitate easy removal to permit free access to various parts of the unit.

2.3 Materials

Materials shall be new and of first-class quality, suitable for the purpose, free from defects and imperfections, and of the classifications and grades listed herein or their equivalents. Materials not listed herein may be used subject to the Engineer's review of their acceptability, application, and the maximum allowable design stresses established by the Contractor. Material specifications, including grade or class, shall be shown on the appropriate detail Drawings submitted to the Engineer.

Material	Specification
Carbon Steel Castings	ASTM-A27, Specification for Mild to Medium-Strength Carbon-Steel Castings for General Application, Grade 65-35, Grade 70-36, and Grade 70-40.

Material	Specification
Low-Alloy Steel Castings	ASTM-A148, Specification for High-Strength Steel Castings for Structural Purposes, Grade 80-50.
Corrosion-Resistant Steel Castings	ASTM-A743/A 743M, Specification for Casting, Iron-Chromium, Iron-Chromium-Nickel, and Nickel Base (Corrosion-Resistant) Alloy Castings for General Application, Grade CA-15, Grade CF-8 and Grade CA-6NM.
Corrosion-Resistant Steel Plate	ASTM-A167, Specification for Stainless and Heat-Resisting Chromium-Nickel Steel Plate, Sheet, and Strip. ASTM-A176, Specification for Stainless and Heat-Resisting Chromium Steel Plate, Sheet, and Strip. ASTM-A240, Specification for Stainless and Heat-Resisting Chromium and Chromium-Nickel Steel Plate, Sheet, and Strip for Fusion-Welded Unfired Pressure Vessels, Type 405 and Type 410.
Corrosion-Resistant Steel Bars	ASTM-A582, Specification for Free-Machining Stainless and Heat-Resisting Steel Bars, Hot-Rolled or Cold-Finished, Type 303 and Type 416.
Electrical Steel	ASTM-A345, Specification for Flat Rolled Electrical Steel.
Nickel-Copper Alloy Plate (Monel)	ASTM-B127, Specification for Nickel-Copper Alloy Plate, Sheet, and Strip.
Carbon and Alloy Steel Forgings	ASTM-A668, Specification for Steel Forgings, Carbon and Alloy for General Industrial Use, Class D.
Carbon Steel Forgings (for pipe flanges, fittings, etc.)	ASTM-A181, Specification for Forged or Rolled Steel Pipe Flanges, Forged Fittings, and Valves and Parts for General Service, Grade I and Grade II.
Carbon and Alloy Steel Forgings	ASTM-A36, Specification for Structural Steel.
Carbon Steel Plates (for important stress-carrying parts)	ASTM-A285, Specification for Low and Intermediate Tensile Strength Carbon Steel Plates for Pressure Vessels (Plates 50 mm and Under in thickness), Grade B and Grade C.
Intermediate Strength Steel Plates (for important stress-carrying parts)	ASTM-A516, Specification for Carbon Steel Plates for Pressure Vessels for Moderate and Lower Temperature Service, Grade 60 or better, except that all plates thicker than 25 mm (one inch) shall be normalized to produce grain refinement.
High Strength Steel Plates (for highly stressed parts)	ASTM-A517, Specification for High Strength Alloy Steel Plates, Quenched and Tempered, for Pressure Vessels.
Bronze Castings, Bronze (for bearings, wearing plates, etc.) Intermediate Strength Steel Plates (for important stress-carrying parts)	ASTM-B584, Specification for Copper Alloy Sand Castings for General Applications.
Bronze (for bolting) High Strength Steel Plates (for highly stressed parts)	ASTM-B21, Specification for Naval Brass Rod, Bar, and Shapes, Alloy No. 464.
Copper Tubing	ASTM-B88, Specification for Seamless Copper Water Tube,

Material	Specification
Bronze Castings, Bronze (for bearings, wearing plates, etc.)	Type K.ASTM-B584, Specification for Copper Alloy Sand Castings for General Applications.
Copper Pipe	ASTM-B42, Specification for Seamless Copper Pipe, Standard Sizes.
Steel Pipe	ASTM-A53, Specification for Welded and Seamless Steel Pipe.
Stainless Steel Pipe	ASTM A312, Type 316L Specification for Seamless and Welded Austenitic Stainless Steel Pipe..
Stainless Steel Pipe Fittings	ASTM A182, Type 316L Forged Stainless Steel Fittings, Socket-Welding and Threaded. ASTM A403, Type 316L Specification for Wrought Austenitic Stainless Steel Pipe Fittings.
Stainless Steel Tubing	ASTM A269 or ASTM A213, Grade TP316L Specification for Soft Annealed Stainless Steel Tubing.
Stainless Steel Tube Fittings	Compression type stainless steel flareless tube fittings, suitable for 1200 psi working pressure. To SAE J514.
Steel Pipe Flanges and Flanged Fittings	ANSI-B16.5, Steel Pipe Flanges and Flanged Fittings.

2.4 Test of Materials

2.4.1 General

All materials or parts used in the equipment shall be new and shall be tested, in conformity with applicable methods prescribed by the ASTM, or such other equivalent authorized organizations.

2.4.2 Impact and Bend Tests

Materials for all principal parts shall be tested for impact resistance using the Charpy “V” notch specimen and shall have an impact resistance of not less than 2.1 kg-m at 10°C. Testing shall conform to the requirements of ASTM A370 and E23. Both longitudinal and transverse impact tests shall be performed for each heat on plate steel. Bend tests shall be performed on specimens of all major steel castings and forgings, in accordance with the applicable ASTM designation. The nil ductility transition temperature shall be the temperature at which the impact resistance is 2.1 kg-m as specified above. Where plate material used for the principal parts is of a type which experience has shown will consistently meet the impact-nil ductility requirements specified herein, impact testing of plates may be eliminated, subject to the Contractors submitting data demonstrating satisfactory evidence.

2.4.3 Test Certificates

Certified material test reports shall be submitted as soon as possible after the tests are made. The test certificates shall identify the component for which the material is to be used and shall contain all information necessary to verify compliance with these Employer’s Requirements.

2.5 Safety Factors and Design Stresses

2.5.1 General

The maximum allowable stresses in certain types of materials used in the equipment are specified herein. However, the Contractor shall be responsible for an adequate design based on factors proven safe in practice and shall use lower working stresses wherever it deems this necessary or desirable or where it deems deflection to be the controlling design criterion.

2.5.2 Maximum Allowable Stresses

Generous factors of safety shall be used throughout the design. Due consideration shall be given in the design of parts subject to alternating stresses, seismic stresses, fatigue, vibration, impact, or shock. Under the most severe conditions of loading expected in normal operation, stresses in the materials shall not exceed the values listed below. Maximum shear stresses in cast iron shall not exceed 21 MPa. Maximum shear stresses in other ferrous materials shall not exceed 60% of the allowable stresses in tension, except that the maximum torsional shear stresses in the shafting, including turbine and generator shafts and needles, shall not exceed 50% of the allowable stress in tension. For temporary overloads exceeding the maximum turbine output under the maximum net head, unit stresses shall not exceed one-half the yield strength. The design stresses for materials not listed herein shall be selected by the Contractor, but the maximum stresses in tension or compression shall not exceed one-third of the yield strength nor one-fifth of ultimate tensile strength. Under the maximum runaway speed conditions, or under hydrostatic test conditions, or generator maximum unbalanced transient forces caused by short-circuits, the stresses shall not exceed two-thirds of the yield strength.

Material	Maximum Allowable Stress	
	In Tension	In Compression
Gray Cast Iron	1/10 U.T.S.	70 MPA
Carbon Cast Steel and Alloy Cast Steel	The lesser of 1/5 U.T.S. or 1/3 Y.S.	The lesser of 1/5 U.T.S. or 1/3 Y.S.
Carbon Steel Forgings	1/3 Y.S.	1/3 Y.S.
Carbon-Steel Plate for Important Stress-Carrying Parts	1/4 U.T.S.	1/4 U.T.S.
High-Strength Plate Steel for Highly Stressed Parts	1/3 Y.S.	1/3 Y.S.

U.T.S. = Ultimate Tensile Strength
Y.S. = Yield Strength

2.6 Tolerances

Machining tolerances for all mating fits shall be suitable for the intended service and shall be in accordance with ISO Standards.

2.7 Workmanship

All work shall be performed and completed in a thorough workmanlike manner and shall follow the best modern practices in the design and manufacture of the types of equipment specified herein. All Work shall be done by personnel skilled in the related professions and trades. All parts shall be made accurately to a standard gage, so as to facilitate replacement and repairs. All bolts, nuts, screws, rivets, threads, pipe, gauges, gears, and measurements or dimensions shown on the Drawings shall conform to customary standards. The Contractor shall provide and maintain in storage for at least 10 years, free of cost to the Employer, sufficient templates, gauges, patterns, and other records to enable the Contractor to make repair and replacement parts. All special gages and templates necessary for field erection shall be furnished and shall become the property of the Employer. Patterns will remain the property of the Contractor.

2.8 Welding

2.8.1 General

All welding shall be performed by the electric-arc method, by a process that excludes the atmosphere from the molten metal, and, where practicable, by automatic machines. After being deposited, all welds shall be cleaned of slag by shot blasting, unless otherwise approved, and shall be uniform, smooth, showing good fusion with the base metal, and free of voids, crack, and clinkers. Machined surfaces of parts affected by welding shall be machined to final dimensions after welding. Machined surfaces of parts requiring stress relief shall be machined to final dimensions after the parts have been stress relieved. Localized stress relieving will not be permitted for factory welded parts. All principal load carrying welds shall be full penetration type welds. Strength of welded joints shall be based upon the allowable stress of the parent materials specified in 2D.10, Safety Factors and Design Stresses.

2.8.2 Edge Preparation

Members to be joined by welding may be cut to shape and size by mechanical means such as shearing, machining, grinding, or by gas or arc cutting, to suit the conditions. Design of welded joints and selection of weld filler metal shall allow thorough penetration and good fusion of the weld with the base metal. The edges of surfaces to be welded shall be sound metal free of visible defects, such as laminations or defects caused by cutting operations, and free from rust, oil, grease and other foreign matter.

2.8.3 Welding Qualifications

The qualification of welding procedures, welders, and welding operators for all welding of pressure-containing components, including weld repairs and other high stressed components, shall conform to standards at least equal to Section IX of the ASME "Boiler and Pressure Vessel Code". For welding of structural parts, the qualifications shall conform to standards at least equal to the AWS "Standard Qualification Procedure." The Contractor shall furnish the facilities and all equipment, materials, and other articles required to perform qualification tests of its welders and welding operators. Certificates of welders' qualifications shall be furnished when requested. The procedure for qualification testing of the field welders shall be prepared by the Contractor, and the qualification tests shall be witnessed and accepted by the Contractor.

2.8.4 Field-Weld-Filler Metal

The calculated quantity of weld-filler electrodes or wire required for field-welded joints plus 20% additional shall be furnished. The Contractor shall select the proper filler material for all field-welded connections and shall specify it on the applicable Drawings submitted for the Engineer's approval, together with the detailed design of the field-weld joint.

2.8.5 Documentation

The Contractor shall maintain a strict quality control program for the welding work performed in the factory. Weld procedure specifications (WPS) shall be submitted for review prior to starting the fabrication work. All welds shall be identified on the Contractor's Drawings by numbers. All welding work shall be performed by qualified welders and welding operators and shall be properly documented.

2.9 Fabrication

All weld-fabricated pressure-containing parts shall be designed, fabricated, inspected, and tested, unless otherwise specified, in accordance with standards at least equal to Section VIII, Division I, of the ASME "Boiler and Pressure Vessel Code" and shall be stress relieved as a unit prior to final machining. Steel plates shall be annealed at a temperature between 600°C and 650°C before rolling or pressing to final shape, except that high-strength type quenched and tempered alloy steel plates shall not be annealed.

2.10 Non-destructive Testing

2.10.1 General

Unless otherwise indicated, all non-destructive tests shall be in accordance with the applicable section of ASTM Standards, Part 11, "Metallography Non-destructive Tests" or approved equivalent. The Contractor's Drawings submitted for review shall define the areas, extent, and type of non-destructive examination employed.

2.10.2 Examination of Welds

All welds on weld-fabricated parts, except minor parts or low stressed parts, shall be given complete non-destructive examination. Weld examination shall be by ultrasonic, dye penetrant and magnetic particle methods, supplemented by radiographic examination. Supplemental radiographic examination shall include examination of critical high-stressed areas where interpretations of other methods are unclear, or where the integrity of the weld is doubtful. All butt welded joints exposed to head water pressure, or to significant stress levels shall be given a 100% radiographic or ultrasonic inspection accompanied by a 100% magnetic particle or liquid penetrant inspection. The Engineer shall have the right to request random spot-check examination of welds, including radiographic examination, as part of his inspection of the equipment. The non-destructive examination scope, procedures and acceptance standards of welds shall be clearly indicated on the Drawings. The detailed program for non-destructive examination of welds shall be submitted for review. Radiographic examination of welds shall be in accordance with the technique and acceptance standards of Paragraph UW-51 of Section VIII, Division 1, of ASME "Boiler and Pressure Vessel Code." Ultrasonic examination of welds shall

be in accordance with the methods and acceptance standards of the ASME Code, Section VIII, Division 1, Appendix 12. Magnetic particle examination of welds shall be in accordance with the methods and acceptance standards of the ASME Code, Section VIII, Division 1, Appendix 6. Liquid penetrant examination of welds shall be in accordance with the methods and acceptance standards of the ASME Code, Section VIII, Division 1, Appendix 8.

2.10.3 Examination of Castings

Major castings incorporated in the equipment or their components that are castings, shall be given complete non-destructive examination by ultrasonic, dye penetrant, and magnetic particle methods supplemented by radiographic examination. Supplemental radiographic examination shall include examination of critical high-stressed areas where interpretation of other methods is unclear or where the integrity of the casting is doubtful. Non-destructive examination of other castings shall be in accordance with accepted good practice to assure sound castings and shall be indicated on the Drawings. The non-destructive examination of steel castings shall be in accordance with the following methods and acceptance standards:

Examination Method	Standard for Method	Standard for Acceptance
Radiographic	ASME Sec. VIII, Div. 1, Appendix 7	ASME Sec. VIII, Div. 1, Appendix 7
Ultrasonic	ASME Sec. V, Art. 5	ASME Sec. V, Art. 23, SA609
Magnetic Particle	ASME Sec. VIII, Div. 1, Appendix 7	ASME Sec. VIII, Div. 1, Appendix 7
Liquid Penetrant	ASME Sec. VIII, Div. 1, Appendix 7	ASME Sec. VIII, Div. 1, Appendix 7

2.10.4 Examination of Forgings

Forgings for the shafts, needles (if made of forgings), and shaft coupling bolts shall be given complete ultrasonic examination with liberal overlap and other approved non-destructive tests, to determine that they are sound. Non-destructive examination of other forgings shall be in accordance with accepted good practice to assure their soundness and shall be indicated on the Drawings. The structure of forgings shall be homogeneous and free from excessive non-metallic inclusions. An excessive concentration of impurities or separation of alloying elements at critical points in a forging will be cause for its rejection. Examination of steel forgings shall be in accordance with the methods and acceptance standards of ASTM A388, "Standard Practice for Ultrasonic Examination of Heavy Steel Forgings," and of ASTM A275, "Standard Method for Magnetic Particle Examination of Steel Forgings."

2.11 Steel Castings

2.11.1 General

Castings shall be free from injurious defects and shall be satisfactorily cleaned for their intended use. Surfaces of castings which do not undergo machining and which are exposed to view in the installation shall be dressed for good appearance and for painting. The locations of existing defects shall be determined, and all defects,

which impair the strength or utility of the casting, shall be removed to sound metal. The structure of the castings shall be homogeneous and free from excessive non-metallic inclusions. An excessive concentration of impurities or separation of alloying elements at critical points in a casting will be cause for its rejection. Bend tests shall be performed on all major castings as specified under 2D.9, Test of Materials.

2.11.2 Inspection

Castings shall be inspected visually at the foundry after they are cleaned, while test pieces are removed, and while defects are being removed. Castings shall also be inspected after repairs and after heat treatment. Radiographic or other non-destructive tests will be required as specified under 2D.15, Non-destructive Testing, and as otherwise approved by the Engineer when granting permission to repair major defects. The Engineer reserves the right to require non-destructive tests at the Contractor's expense to determine a) the full extent of defects, b) that the area is properly prepared for welding, and c) that the repairs are satisfactory.

2.11.3 Repair Welding

Before proceeding with repairs the Contractor shall submit a descriptive report on the casting defects, including Drawings showing the location and size of major and minor defects, supplemented with photos, sketches and metallurgical test reports, results of non-destructive examinations, dimensional stability, metal wall thickness, shrinkage, perforations, etc. The report shall define the type of defect, probable causes and the changes recommended in the design of the component or in the casting technique to prevent similar defects in consecutive castings. Similarly, the detailed repair procedure shall be submitted, including the non-destructive tests to be applied and the finished repair. Minor defects or imperfections that will not impair the strength or serviceability of the castings may be repaired by welding in accordance with accepted foundry practice without approval but in any case shall be reported to the Engineer. Defects shall be considered minor when the cavity properly prepared for welding is not greater than 25% of the actual wall thickness but in no case greater than 25 mm and when the area to be welded is not greater than 160 cm². An accumulation or concentration of minor defects shall be considered as a major defect. The accumulation of major defects and/or concentration of minor defects which in the opinion of the Engineer casts doubt as to the quality of the casting may be cause for its rejection. If removal of the defects reduces the stress-resisting cross section of the casting by more than 30% or if the calculated stress in the remaining metal exceeds the allowable stress by more than 30%, the casting shall be rejected. All castings having major defects repaired or accumulation of minor defects after heat treatment, or any defects which will impair the strength of the stress-resisting cross section or the dimensional stability of the finished part repaired after heat treatment, shall be reheat treated.

2.11.4 Dimensions

Dimensions of castings shall not be reduced by factory or foundry practices by an amount sufficient either to impair by more than 10% the strength of castings (calculated from Drawing dimensions) or to cause the stresses to exceed those allowed under these Employer's Requirements. Dimensions shall not be oversized to the extent that the castings interfere with processing operations or proper fit with other parts. Warped or otherwise distorted castings shall not be used in the Work without presenting complete details for review.

2.12 Surface Finish of Equipment Parts and Welds

2.12.1 Weld Finish

Welds shall in general be treated so that they will display good appearance and a surface suitable for painting. Structural welds shall be ground and blended, to avoid stress raisers. All welds which require radiographic or other non-destructive examination shall be dressed by chipping and grinding as required for good interpretation of radiographic film or interpretation by other weld examination methods. Welds exposed in water passages shall be ground to provide smooth-contoured hydraulic surfaces. The welded joints of the air receivers and oil pressure tanks shall not be ground to the extent that the tank is weakened structurally. Details of weld dressing and finishing and non-destructive testing (NDT) shall be shown on the Drawings submitted for approval.

2.12.2 Hydraulic Packing

Packing for seals shall be a high-grade commercial product and where feasible, with polytetrafluorethylene (PTFE) content suitable for the application and for long seal life. Packing grooves, which are exposed to river water, shall be protected from corrosion, by the use of corrosion-resistant materials.

2.12.3 Auxiliary Equipment and Data

Items of equipment such as pumps, motors, valves, and similar small pieces of equipment and accessories shall be, to the greatest extent practicable, of a type that is readily available or can be readily imported. The names of manufacturers of mechanical and electrical auxiliary equipment to be incorporated in the work, together with performance characteristics and other significant information, shall be submitted to the Engineer for review. Equipment incorporated in the work without prior review and approval shall be subject to rejection.

2.12.4 Nameplates

Each major and auxiliary item of equipment shall have a nameplate permanently affixed thereto showing in a legible and durable manner the serial number, name and address of the manufacturer, ratings, characteristics, weight, manufacturing date and other significant information, as applicable. Nameplates of distributing agents only shall not be acceptable.

Additional nameplates shall be provided to indicate main operating instructions, caution or warning for personnel and operational safety. In addition, each panel-mounted instrument, position indicator, pushbutton, switch, light, or other similar device shall be identified by a permanently affixed nameplate describing the control functions. Electrical wiring and instruments including relays shall also be labelled to correspond to the numbers assigned on the electrical control schematics.

The above general nameplate requirements shall be used in preparing nameplate lists and Drawings to be submitted to the Engineer for review. Drawings for nameplates, as they will appear on the finished equipment, shall be submitted for review.

All nameplates shall be in English and shall be suitably engraved and shall be weather-resistant. All nameplates shall be permanently attached to the respective parts, components, or equipment items in clearly visible locations. Nameplates for control equipment shall be screw mounted laminated plastic, white with black cores, with engraved capital letters 6 mm minimum height.

2.13 Piping

2.13.1 General

Piping, pipe materials, pipe supports, and hangers shall be in accordance with standards at least equal to ANSI B31.1.0, "Power Piping." The arrangement of piping and locations of valves and joints shall be such that there will be minimum disturbance of the piping and interference with other equipment and systems when the turbine, generator, or other equipment is dismantled or parts are removed for inspection or repairs. Bolted flange connections or unions shall be provided at points where a piping system must be disconnected for dismantling.

2.13.2 Water Piping

Water piping shall be of welded grade 316L stainless steel pipe. Piping connection shall be of welded joints for embedded water piping and welded joints and flanged fittings for exposed water piping. Valves 75 mm and smaller shall be of stainless steel; valves 100 mm and larger shall be cast steel flanged valves with stainless steel trim, epoxy-coated inside.

Sanitary water pipe downstream of the storage tank may be copper or polybutylene.

Insulation

Insulate all hot surfaces, pipe, valves, fittings to ensure surface temperature is low enough to be safe to touch and to prevent excessive heat loss. Insulate all cold surfaces to prevent condensation being formed on the surface and to prevent excessive heat gain. Insulation on cold surfaces shall be vapour sealed type to prevent migration of vapour from the warm side into the insulation. No insulation is to be applied to pipework until they have been proven to be water, air and gas tight as applicable.

All thermal insulation and cladding systems shall be in accordance with the requirements of BS 5970 - Code of Practice for the Thermal Insulation of Pipework and Equipment.

Thermal insulation shall be in-situ foamed polyurethane type with aluminium cladding. Foam glass ferrules shall be used at pipe support locations. Water lines shall be insulated and clad such that no condensation forms on the surfaces of the pipe, cladding or pipe supports under normally expected operating conditions and temperatures.

All pipework and equipment insulation is to be neatly trimmed around valve bonnets, drain cocks, vents, etc. to enable normal operation and maintenance without the need to remove the insulating material.

2.13.3 Oil Piping

Pressure piping for jacks and servomotors shall be grade 316L stainless steel, of appropriate strength, with steel fittings and steel bodied valves. Valves shall have bronze seats and stems. Lubricating oil piping shall be seamless drawn copper or red brass with brass or bronze fittings and valves.

2.13.4 Piping Integral with Turbine Water Passages

Piping for the distributor drains turbine pit drain, and any other lines connected to the penstock, turbine, or distributor shall be welded steel pipe, epoxy-coated inside, with flanged fittings. Valves 75 mm and smaller shall be of grade 316L stainless steel; valves 100 mm and larger shall be cast steel, flanged, wedge disc gate valves with stainless steel trim, epoxy-coated inside.

2.13.5 Piezometer and Pressure Tap Piping

Piezometer and pressure tap piping on the turbine shall be 20 mm grade 316L stainless steel tubing and fittings, as specified in 2D.8, Materials. All piezometer taps shall be individually piped to valve panels provided at suitable locations. Each piezometer line shall be valved and labelled at the valve panel. Provisions for blowing out the lines with compressed air, for venting air from the lines and for connection to pressure measuring devices shall be included.

2.13.6 Compressed Air Piping

Compressed air piping for pressures up to 9 bar shall be ASTM-A53 Schedule 40 black steel pipe, welded grade, with screwed fittings for sizes up to 60 mm and with butt weld fittings for larger sizes. ASTM-A53 Schedule 80 black steel, seamless pipe shall be used for higher pressures with screwed or socket-weld forged steel fittings.

2.13.7 Instrument Piping

Piping exposed to river water shall be grade 316L stainless steel tubing with stainless steel compression type fittings and shut-off valves. All other piping shall be brass or copper with brass or bronze screwed fittings or of copper tubing. Shut-off valves shall be provided at pressure gauges and at points where the gauge piping connects to the main equipment, together with suitable blow-off valves and drain connections. Flexible tubing for the dial thermometers shall be armoured.

2.13.8 Governor and Inlet Valve Oil Pressure Piping

The governor and inlet valve shall be provided with interconnecting piping and valves between the various parts of the oil pressure systems and their respective operating servomotors. The piping shall be sized for a maximum oil velocity of 5.0 m/s for servomotor travel at the maximum rate. The main pressure oil piping shall be grade 316L stainless steel pipe with welded joints and bolted steel flanges, or threaded connections for any connections required to permit assembly and disassembly of the piping system. Threaded pipe connections shall use stainless steel connections complying with SAE J514. All piping shall be thoroughly cleaned by

pickling in the factory (removing all mill scale, loose or tight), oiled inside, painted on the outside and protected for shipment by wooden protectors on all flanges and protective closures on pipe ends. All valves, except valves built-in and forming an integral part of the governor pumping unit, shall be of the rising-stem, steel body type. Gate valves in the pressure lines shall be cast-steel, solid-wedge type, with close guide clearances to minimize vibration of the gates when operating at partial opening. Where feasible, long-radius pipe bends shall be used in place of pipe fittings. Piping shall be factory fabricated to the maximum extent possible, consistent with erecting, handling, and shipping requirements.

2.13.9 Carbon Dioxide Piping

Carbon dioxide system piping up to and including 20 mm shall be standard weight galvanized steel; carbon dioxide piping larger than 20 mm shall be extra heavy galvanized steel.

2.13.10 Pipe Supports and Piping Materials

Adequate pipe supports shall be provided for all piping included in the supply. Supports, pipe hangers, wall brackets, pipe clamps, fastening devices and all necessary studs, bolts, nuts, washers, oil-resistant gaskets, packing, etc., required for the piping systems shall be furnished. These items shall be supplied as finished products requiring no field fabrication such as welding, cutting and drilling.

2.13.11 Piping Connections

On connections for all equipment, pipes may be threaded or flanged with the flanges faced and drilled in accordance with standards selected by the Contractor. All flanged external connections shall be provided with bolts, nuts and gaskets for connection to piping furnished by others. All governor and inlet valve oil piping, generator oil lubricating piping, high pressure oil lift piping, generator brakes and jack piping, generator oil mist piping, generator CO₂ piping, generator brake dust collection piping, etc. shall be furnished as a part of a complete system.

2.14 Pumps

2.14.1.1 General

Pumps shall be installed strictly according to the pump manufacturer's requirements. Every effort shall be made to ensure that the minimum number of pump vendors are used as suppliers, and that pumps with identical duties are interchangeable in every respect.

The pump and motor combination shall be selected so that non-overloading operation is ensured under all flow conditions.

2.14.1.2 *General Requirements for Pumps*

Pumps shall be of a design and capacity capable of maintaining the fluid flow rate at the actual system resistance. The material and construction of the pump shall be suitable for the type, temperature and pressure of the fluid to be handled.

All moving parts of the pump shall be statically and dynamically balanced.

All pumps shall either be fitted with mechanical seals or be of canned construction so there is no liquid path past a moving surface. Mechanical seals shall be used wherever possible. The preferred sealing face combination is carbon on silicon carbide. Seals shall be water flushed wherever practicable.

2.14.1.3 *Centrifugal Type Pumps for General Use*

Pump installations shall consist of pump casing, impeller, suction and discharge connections, driven shaft, couplings and motor as stated. Pumps shall be complete with all necessary water seals. Pump installations shall comprise suction and discharge pipe reducers and expansion pieces directly connected to the pump connections, vibration isolation equipment, and motor terminal box suitable for connection to a flexible conduit system.

Generally, pump base plates shall be constructed from cast iron, however unit constructed close coupled pumps may be mounted on mild steel rails or a fabricated mild steel flat bed plate if full corrosion resistant surface treatment is provided.

Pump flanges shall be tapped and plugged to receive gauge connections.

Volute casings shall be drilled, tapped and plugged at the bottom to enable complete drainage to be carried out.

Spherical roller bearings, or in light load applications deep groove ball bearings, are required on all pumps using rolling element bearings and shall be arranged to operate either within an oil reservoir or with grease lubrication. Parallel roller bearings are not permitted. Bearing lubricators shall be fitted with drain plugs and oil content indication.

Impellers and couplings shall be keyed to the drive shaft, the impeller being retained by a hexagonal nut. Shafts shall be fitted with water deflectors.

Unless specifically indicated elsewhere in this document, motor enclosures shall be totally enclosed fan cooled.

Belt driven pumps shall not be permitted, except in the case of gear pumps.

Unit-constructed close coupled pumps shall be of the back pull-out type, enabling the motor, drive and impeller to be withdrawn from service without disturbing the volute casing connections, piping, etc.

Where pumps are to be coupled to their prime mover on site, the motor and pump shall be carefully levelled on shims and packing to achieve a close order of alignment. Dial gauges shall be used to achieve this end and the maximum permitted eccentricity shall be 0.05 mm.

Care shall be taken that the connecting pipe is so arranged as to ensure that no stresses are transmitted through the connections to the pump casing.

2.14.1.4 *Performance*

The Contractor shall provide pump characteristics, power and efficiency curves certified by an internationally recognised authority to the Engineer for approval.

All pumps shall operate with no cavitation. In the case of pumps operating at elevated temperatures, the Contractor shall demonstrate to the Engineers satisfaction, the no cavitation will occur under all normal operation conditions. Detailed NPSH calculations shall be submitted for approval by the Engineer.

2.15 **Foundation Materials**

2.15.1 **General**

All permanent foundation materials including all anchor bolts, jacks, tie rods, turnbuckles, anchor loops, levelling screws, supporting columns made of pipe or structural steel, soleplates, embedded anchor plates, bracing, and all other foundation materials required for anchoring and/or supporting the parts during concreting, shall be furnished with the equipment.

2.15.2 **Design**

Tie-down rods and bracing for the distributor shall be designed to firmly hold it in place while it being embedded. Tie rods for the wheel pit liner and pit liner shall be similarly designed. The necessary bars required to transfer the uplift or downpull on the turbine components into the surrounding concrete shall be designed and furnished. All jacks shall have steel bases and steel caps so that they can be welded to the parts which they support and to the jack supports.

2.15.3 **Anchor Bolts**

All anchor bolts and anchoring materials, including pipe sleeves, nuts, and plate washers required for anchoring the equipment and accessories, shall be furnished. Calculations showing the stresses in the anchor bolts for the needle servomotors and their operating cylinders shall be submitted for review.

2.16 **Handling Devices**

The rotor lifting device for attaching to the powerhouse crane shall be provided. Lifting brackets for attaching to the top of the turbine shaft, and the generator shaft shall also be provided. In addition, upending shoes required to upend the shafts from the horizontal to the vertical position shall be furnished. The Contractor shall coordinate the rotor and shaft handling details with the Engineer.

Lifting lugs, brackets, eyes etc., as required for attaching lifting devices shall be provided on all of the major components of the equipment. All slings and lifting devices required for attachment to the components and assemblies and to the powerhouse crane-hook for handling during erection and disassembly shall be furnished.

2.17 Protection, Cleaning and Painting

2.17.1 General

All ferrous parts shall be protected, cleaned and painted in accordance with AS/NZS2312 "Guide to the protection of structural steel against corrosion by the use of protective coatings". Where the requirements of this Standard differ from the requirements of the specification, the more onerous requirement shall apply.

All parts which will ultimately be embedded in concrete shall be cleaned and protected by a cement wash or other approved method before forwarding from the Contractor's factory. Before being installed, they shall be thoroughly de-scaled and cleaned of all rust and adherent matter. Such cleaning must not affect the strength or final operation or function of the plant.

All machined parts or bearing surfaces shall be cleaned and protected from corrosion by the application of an approved rust preventive lacquer or a peelable plastic film before forwarding from the Contractor's factory. Where the latter is impractical, such parts shall be heavily covered with high melting point grease. After erection, such parts shall be cleaned with solvent and wiped or polished bright.

All parts, other than machined parts that will be exposed after erection, shall be thoroughly cleaned and given two coats of best quality approved primer and one coat of best quality approved finish paint before being forwarded from the Contractor's factory. One further coat of paint of an approved quality and colour shall be applied after erection and touching up on the Site (except such apparatus as panels and instruments which shall be finish painted in the factory). Paint colours shall be submitted to the Engineer for approval by presentation of RAL 'Classic' or equivalent colour samples or colour chips

Primer shall be applied to surfaces prepared in accordance with the paint Contractor's instructions. The surface shall be wiped clean immediately prior to applying the paint. The primer and finish coats of paint shall be applied using the methods and plant recommended by the manufacturer.

The internal surface of all pipelines shall be cleaned out by approved methods before installation and again prior to commissioning, to ensure freedom from dirt, rust, scale, welding slag, etc. All exposed pipes shall be coloured for identification after erection is completed. The colour for each classified pipeline shall be approved by the Engineer.

The final colour of all plant shall be approved by the Engineer. The Contractor shall comply with this colour scheme for the plant.

All plant shall be painted as specified herein. The painting of plant shall include the preparation of the metal surfaces, paint application, protection and drying of the paint coatings, as well as the supplying of all tools, labour and materials necessary for the entire painting work.

Paint shall be the product of reputable manufacturers and its selection shall be approved by the Engineer. Sufficient paint shall be provided for site painting.

2.17.2 Employers Colour Scheme

The Employers Colour Scheme for the Wailoa powerhouse and appurtenant facilities is as follows:-

<i>Item</i>	<i>Colour</i>	<i>RAL</i>
<i>Powerhouse</i>		
Building Cladding	Mist Green/Pale Eucalypt	
Steel Frame	Caulfield Green/Cottage Green	
Handrails	Signal Yellow	RAL1003
Stairway Bearers	Signal Yellow	RAL1003
Ladders	Signal Yellow	RAL1003
Doors and frames	Karaka Green	
Roller Door	Mist Green/Pale Eucalypt	
Powerhouse & Laydown floor	Signal Grey	RAL7004
Powerhouse & Laydown floor "walkway markings"	Signal Yellow	RAL1003
Control Building Interior Walls	Papyrus White	RAL9018
Control Building Interior Ceilings	Cream	RAL9001
Control Panels	Grey	RAL 7032
11kV Switchgear	Grey	RAL 7032
Distribution Boards	Grey	RAL 7032
Turbine	Light Blue	RAL5012
Generator	Mellon Yellow	RAL1028
HPU	Patina Green	RAL6000
Main Inlet valve	Patina Green	RAL6000
Dewatering Valve	Patina Green	RAL6000
Lube Oil	Patina Green	RAL6000
Penstock Stub Section	Patina Green	RAL6000
Fire Pipework	Signal Red	RAL3001
Transformers	Green Grey	RAL7009
Crane and rails	Signal Yellow	RAL1003
Flood Pump Piping	Patina Green	RAL6000

Switchyard

Building Cladding	Mist Green/Pale Eucalypt	
Doors and frames	Karaka Green	
Roller Door	Mist Green/Pale Eucalypt	
Floor	Signal Grey	RAL7004
Interior Walls	Papyrus White	RAL9018

Interior Ceilings	Cream	RAL9001
Control Panels	Grey	RAL 7032
Transformers	Green Grey	RAL7009

2.17.3 Surface Preparation

All oil, paraffin, grease and dirt shall be removed from the surfaces to be painted using solvents. All weld spatters, slags, burrs, loose rusted mill scale and other foreign substances shall be removed by shot or sandblasting to "white" metal. The interior surface of the steel pipe shall be mechanically cleaned or sandblasted to a commercial standard.

Special attention shall be given to cleaning of corners and converging angles. If rust forms on the surfaces become contaminated in the interval between cleaning and painting, re-cleaning to the same degree appropriate is required. Effective means shall be provided for removing all free oil and moisture from the air supply lines of blasting plant. All surface preparations shall be subject to the approval of the Engineer before any paint is applied.

2.17.4 Application Procedure

All paint, when applied, shall provide a satisfactory film and a smooth, even surface. Paint shall be thoroughly stirred, strained, and kept at the uniform consistency during application. Paint shall not be applied when the temperature of the metal or of the surrounding air is below 10°C. Surfaces that will be coated shall be performed by brushing or spraying. Each coat shall be allowed to dry or harden thoroughly before the succeeding coat is applied.

2.17.5 Surfaces Not to be Painted

Bronze, brass, surfaces of gear teeth, finished ferrous surfaces, surfaces in rolling or sliding contact after field assembly and wire ropes shall not be painted.

All corrosion resisting steel surfaces for bearings and machinery parts shall not be painted.

On completion of cleaning, such surfaces shall be coated with an adhesive plastic film to protect the surfaces from minor mechanical damage and corrosion during shipment and storage at the site. The film shall be stripped off immediately prior to field erection of the plant.

2.17.6 Galvanising

Unless specifically mentioned to the contrary, iron and steel shall be effectively galvanised after all fabrication is completed.

The zinc coating shall be uniform, clean, smooth and as free from spangle as possible. Galvanising shall be applied by the hot dip process for all parts other than steel wires. All steel wires shall be galvanised by an approved method before stranding.

The minimum quantities of zinc coating shall be 350 g/m² for bolts and nuts and 550 g/m² for all other parts except steel wires. The uniformity of zinc coating, tested by dipping the sample into the solution of sulphate of copper, shall be such that no surface of iron or steel shall expose until four times of dipping for bolts and nuts and six times for all other parts.

The preparation for galvanising and the galvanising itself shall not distort or adversely affect the mechanical properties of the materials. After galvanising, holes shall be free from nodules of splatter.

Galvanised parts are subject to the formation of white rust during shipment or storage on the Site, and special treatment shall be made during the galvanising process to prevent the formation of white rust.

2.17.7 Paint Schedule

The painting shall be performed as follows:-

Epoxy resin paint, total thickness of 0.15 - 0.25 mm shall be applied to the following items:-

- Interior & external surfaces of steel conduits and valves
- Interior & exterior surfaces of turbine housings

All unfinished surfaces of ferrous metal except those specified in the above shall be given phthalic acid resin paint of alkyl resin enamel or other approved paints. Total thickness of these paints including primer coat shall be 0.12 - 0.15 mm. Commercial plant shall be painted in accordance with the manufacturer's standard practice.

All finished surfaces of ferrous metals including screw threads that will be exposed during transportation or while awaiting installation shall be cleaned and given a heavy uniform coating of gasoline soluble, rust preventive compound.

2.18 Lubricants and Hydraulic Fluid

Oil for the hydraulic power units, for the governing systems, inlet valves, and the thrust and guide bearings shall be of the same type. Grease, lubricating oil and hydraulic fluid required for initial filling of all of the equipment plus 10% shall be furnished. Upon completion of the design, a tabulation confirming the quantities of lubricating oil, grease, and hydraulic fluid required for initial application for each item of equipment shall be furnished. Final selection of the grease, lubricating oil, and hydraulic fluid shall be coordinated with the Engineer to rationalize the oil inventory and to ensure that the selected brands are available locally.

2.19 Ventilation and Air Conditioning Systems

2.19.1 Ductwork

2.19.1.1 *General*

Fabricate all ductwork in accordance with the appropriate Duct Manual produced by the Sheet Metal and Air Conditioning Contractor's National Association (SMACNA). Install all ductwork in accordance with the recommendation of SMACNA and the American Society of Heating, Refrigerating and Air Conditioning Engineers (ASHRAE).

Unless otherwise specified, ductwork shall be designed for a minimum operating static pressure of 500 Pa.

2.19.1.2 *Duct Materials*

Rigid Rectangular Duct - unless otherwise specified, duct material shall be galvanised sheet steel for indoor ductwork. Duct material shall be aluminium, or where specifically called for, stainless steel, for ductwork outside the building exposed to weather, or sheltered but not enclosed.

Flexible Connections - flexible connections shall be barium or lead loaded fabric, suitably rated for the specific application to limit noise breakout.

Flexible connection shall be secured as follows:-

- On circular ducts : "Jubilee" type fasteners.
- On rectangular ducts : Secure with approved "Soft" sealing compound and metal strip, fastened at not less than 80mm centres by self taping screws.

Flexible Ductwork - Ensure that the radii of bends in these ducts does not exceed the manufacturer's recommendations.

Flexible ductwork shall only be used for a maximum total length of 3 m of in any branch.

2.19.1.3 *Duct Construction & Installation*

Ducts shall be constructed to the requirement of SMACNA. Pressure rating of ductwork shall exceed maximum operating pressure of the duct work system.

All rectangular ductwork shall be suitably stiffened in accordance with SMACNA recommendation. Flat panels of ducts shall be cross-broken. Unless otherwise stated, ductwork shall be constructed with galvanised sheet steel.

Duct supports shall be at centres needed for rigidity and absence of noise, but in no case more than 2.5 m apart for ducts up to 600 mm wide, and 3 m apart for ducts over 600 mm size. Duct supports shall be of galvanised steel construction.

Suitable spacer shall be provided at support insulated duct to maintain insulation thickness and integrity of vapour seal. Duct supports shall incorporate vibration isolation pads.

Comply with the details shown on the drawings for bends, branches etc. where detail is insufficient and in other cases, bends and branches shall be made of "easy sweep" wherever possible to a curve-ratio of not less than 0.5.

Contractor shall thoroughly clean the supply ducting by rubbing down internally, and vacuuming cleaning out all dust, debris and other foreign materials immediately before balancing and commissioning of the system.

Arrangements for installation of ductwork shall be made in good time before ceiling lining etc. are fixed, and all dimensions, length etc., shall be checked against actual site conditions before fabrication.

Ductwork installed outside the building shall be sealed to water tight. Insulated ductwork outside the building shall be internally insulated.

2.19.1.4 *Ductwork Accessories General*

Unless specified elsewhere in this specification to the otherwise, the following ductwork accessories shall be provided by the Contractor at locations as specified in the following, irrespective of whether such accessories have been shown on the drawing or not.

- a. Fire Dampers - provide fire dampers or fire collars at all duct penetrations through fire rated partitions, floors, and ceilings. Fire dampers shall be of the same or higher than the fire rating as the compartmentation on which damper is installed.
- b. Regulating Dampers - provide regulating dampers at the following locations:-
 - i Branch duct take-off from main distribution duct or distribution plenum.
 - ii Exhaust outlet, fresh air intake and return air connection of each air handling system
 - iii Air supply and exhaust grille
 - iv Duct branch serving one grille; in this case, the grille damper should be omitted
 - v At all direct driven fan discharge or suction ductwork
- c. Test Openings - provide test openings at the following locations:
 - i Upstream or downstream of regulating dampers. Where possible flow measurement opening shall be located at the shorter side of the straight ductwork and shall be at a distance of not less than five times the shorter dimension of the duct downstream of the damper and any fitting to ensure that the air velocity profile is uniform across the duct section.

In the absence of such a location in the duct system due of physical constraint, a flow laminator shall be provided upstream of the flow measurement opening.

- ii At all fan discharge or suction ductwork
- iii Upstream or downstream of all coils.

Provide test openings at no more than 300 mm intervals across the shortest dimension of the duct. Locate opening(s) as close to the mid section of the duct as possible.

d. Access Openings - provide access opening through duct wall at the following locations.

i. Adjacent to all fire dampers so that:-

- Fusible link can be checked or replaced
- The operation of the fire damper can be tested periodically
- Damper can be reopened after closing

ii Adjacent to all duct mounted coils, regulating damper and filter, at no more than 3 metre intervals along the length of duct or between duct obstructions or fittings, for cleaning purposes.

Access openings shall be located at accessible side of the ductwork. Mountings of access doors shall be suitable for externally insulated duct work. Access doors shall be big enough for proper access.

e. Turning Vane and Splitter Damper - provide short chord turning vanes at all square elbows.

Provide splitter damper at all right angles branches from duct to grille.

Provide long chord air turns at round elbow when the turning radius is less than 1½ times the width of the elbow.

All turning vanes at high velocity greater than 10 m/s shall be of aerofoil design.

f. Backdraught dampers - provide backdraught dampers at all duct entry into common exhaust plenum. Air velocity over the backdraught damper shall not be higher than 3 m/s.

g. Air tight dampers - air tight dampers shall be multi-blade type with interlocking trim fitted with silicon gasket.

h. Fire Dampers - fire dampers shall be constructed with galvanised sheet steel of certified fire resistance period of not less than two hours, and certified air leakage rate not more than 2% of the designed air flow rate when subject to air pressure of not less than 1.24 kPa.

Curtain type fire dampers shall be gravity closed when closed vertically and shall be spring closed when closed horizontally.

Blade type fire damper shall be gravity closed.

Damper shall be held in open position by fusible link set for 71°C to 79°C.

Fusible link shall be so arranged that the link shall always be exposed in the air stream. The link holding mechanism MUST NOT interfere with the closing of the damper.

Allow in the tender price for all costs incurred for the Employer to test all fire dampers by actually setting off the fusible link. Provide hot air blower and all ancillaries for the testing.

Unless otherwise specified the type of fire damper to be used shall be Curtain type. Where possible, the clear opening of the fire damper shall equal the air way dimension of the connecting ductwork.

i. Regulating Damper

- i.* Manual Regulating Damper - manual regulating damper shall be provided with an externally mounted quadrant type locking device. Damper with spindle type multi-turn adjusting rod shall have removable handle at spindle so that adjustment can not be tampered with by an unauthorised persons.

All regulating dampers shall be of rigid construction and shall be installed free from vibration and noise generation during normal operation.

All regulating dampers shall be proprietary units, site fabricated dampers will not be acceptable.

- ii.* Automatic Regulating Damper - automatic dampers shall be of the balanced type, tight closing with interlocking edges. Where the dampers are used for smoke dampers they shall be the motorised type with spring return. Solenoid type requiring manual reset are not acceptable.

Multi-blade automatic regulating damper shall be opposed blade type.

Multi-blade automatic mixing damper shall be of parallel blade type.

Damper blades in high velocity system shall be of aerofoil design.

2.19.2 Fans

2.19.2.1 General

Fans shall be of a design and capacity capable of maintaining the required air flow volume at the actual system resistance with filters dirty.

Provide certified fan characteristic, power and efficiency curves to Engineer for approval.

Provide fans having noise levels under design output not exceeding those specified. Test certificates of noise level are to be provided before fans are installed.

Provide fans with anti-vibration mounts. All moving parts of the fan shall be statically and dynamically balanced.

Provide fan complete with motor and drive.

Finish all fan castings either hot dip galvanised or two coats red lead primer, undercoat and gloss enamel top coat. A rotation direction arrow shall be painted on the housing fan.

Where mounted on outside wall or roof, fan shall be provided with approved weatherproofing and bird mesh.

2.19.2.2 Centrifugal Fans

Casting shall be of heavy gauge mild steel plate with angle stiffeners and base angles.

Fans are to be quiet in operation and free from drumming. Inspection panels are required only if access to the impeller cannot be obtained through a panel in the ductwork. All impellers and/or shafts shall be capable of convenient removal after installation, and split-casing type fans shall be provided if necessary.

Impellers shall be of mild steel construction with a streamline cast hub of robust design. The blades shall be securely attached to a shroud ring and back plate. The fan impeller and shaft shall be dynamically balanced.

Centrifugal fans shall have motor suitable for variable speed drive operation.

2.19.2.3 Roof Supply/Extract Fans

Supply all roof mounted fans complete with bird protection mesh. Supply all roof extract fans with integral anti-backdraught shutter. Provide speed regulator where specified. All roof extractors shall be curb mounted type. Provide steel ring guard at underside of fan when fan is not duct connected.

2.19.2.4 Vibration Control

Provide all moving equipment with minimum out-of-balance forces. Control vibration amplitude by increasing static mass of vibrating equipment. Isolate vibration by provision of vibration energy absorbing resilient mounting or separation.

Provide constraint to prevent excessive movement of equipment resulting from earthquake or fault conditions.

a. Equipment Isolation from Duct or Pipe

Provide vibration eliminators in the suction and delivery connections to pumps and fans to effectively prevent transmission of vibrations from the equipment to the pipework. Vibration eliminator shall consist of suitably rated flanged cord reinforced rubber or equal approved stainless steel bellows. When possible eliminators shall be installed normal to the direction of vibration.

Pipework shall be rigidly supported on the side of the bellows remote from the vibrating equipment.

Where an in-line pump is directly supported by the connecting pipework, the piping system shall be supported with anti-vibration hangers until no perceptible noise and vibration is transmitted through the pipework.

Provide approved flexible connection between the suction and delivery outlets of fans and their associated ductwork. Support ductwork rigidly on the side of the neoprene coated canvas connector remote from the fan. Allow at least 50 mm axial length between ductwork and fan flanges with the flexible connection 50% longer.

b. Equipment vibration isolation

Isolate moving equipment such as fans, pumps, chillers, cooling towers and condensing units from building structure by anti-vibration devices. The anti-vibration devices shall be selected in accordance with the Selection Guide for Vibration Isolation as published on the ASHRAE Application Handbook.

3 Electrical Requirements

3.1 General

Unless otherwise specified, auxiliary electrical equipment shall conform to all applicable standards of the authorities as specified in 2D.6 Standards. Note that in the Fiji Islands the requirements of the Australian wiring regulations AS/NZ3000:2000 and referenced standards are the paramount requirements.

3.2 System Conditions

System Particulars for 132kV, 33kV & 11kV system applicable in Fiji Islands are stated in the table below:

Normal system voltage	132kV	33 kV	11 kV
System Highest voltage	145kV	36 kV	12 kV
Frequency	50 Hz	50 Hz	50 Hz
Earthing of Neutral point	Directly earthed	Earthed through earthing Transformer	Directly earthed with or without resistor
Design Symmetrical fault level	1000MVA	1125MVA	250MVA
	31.5 kA	31.5 kA	31.5 kA

3.3 Phase Rotation

Generator and motor phase rotation will be designated as R for the 1st phase (U-X), S the 2nd phase (V-Y), and T for the 3rd phase (W-Z). Power phase rotation will be designated as R-S-T. R-S-T type bus arrangements, left-to-right, top-to-bottom and front-to-rear, will be used throughout to assure convenient and safe testing and maintenance.

3.4 Control Equipment Electrical Ratings

3.4.1 Voltage Ratings

Control equipment shall be designed for operation at the following voltages:

- Nominal rating 24-V DC with an operating range of 19.2-V DC to 28.8-V DC, ungrounded.
- Nominal rating 110-V DC with an operating range of 88 to 110 V DC, ungrounded from the station battery.
- Nominal rating 415/240-V AC, 50-Hz, grounded, with an operating range of $\pm 10\%$.

3.4.2 Electrical Contact Ratings

- Contacts shall be suitable for the application and have current and voltage ratings that will not be exceeded when applied in the control circuits.
- Contacts intended for use in the control circuits shall be electrically-independent, ungrounded, dry contacts, field changeable from “normally-open” to “normally-closed” and have the following ratings:
- Maximum Design Voltage. 415/240-V AC and 110-V DC.
- Continuous Current. 5-A AC or DC.
- Maximum Interrupting Current. Inductive (when $L/R \geq 5000$), 1.5-A at 240-V AC and 1.1-A at 110-V DC.
- Maximum Making Current. Inductive (when $L/R \geq 5000$), 15-A at 240-V AC and 1.1-A at 110-V DC.

3.5 Motors

3.5.1 Standards

Motors shall comply with IEC 60034 as regards performance and testing. Motors shall comply with AS/NZS1359.5 as regards energy efficiency.

3.5.2 Ratings and Characteristics

- Frequency (AC motors): 50 Hz.
- Voltage (AC motors): 0.75 kW and above, 3-phase, 415V; less than 0.75 kW, 1-phase, 240V
- Insulation: Class B, nonhygroscopic.
- Enclosure: totally-enclosed, fan-cooled, (TEFC) unless otherwise specified.
- Accessories. The following accessories shall be provided:
- Non-ferrous, metal guard screens on all ventilating openings.
- Lifting eyes (eye bolts) on all motors weighing more than 50 kg.
- Space heaters for motors above 50 kW shall be factory mounted in an accessible location under the stator frames and rated to maintain internal temperature approximately 10°C above ambient temperature specified. Heater leads shall be wired to a separate terminal box mounted on the motor. Heaters shall be low watt-density and connected to the motor starter control circuit. Heaters shall be automatically energized when the motor is shut down.
- Ground pads with tapped bolt holes on 2-hole standard centres for motors rated 15 kW and above. Pad locations shall be near the base and shall be shown on manufacturer's motor or assembly outline Drawings.
- Soleplates and hold down bolts, where required.
- Gasketed motor terminal boxes, sized to accommodate external cable and lugs, and suitable for conduit connections. They shall be suitable for rotating in 90° steps.

3.5.3 Service Factor

All motors shall be sized to permit the driven equipment to develop its specified capacity continuously without exceeding the rated temperature and using no more than 85% of rated motor kW capacity (1.15 Service

Factor). The intent of this requirement is that the motor kW capacity be sized above the maximum continuous duty required by the driven equipment.

3.5.4 Bearings

- Bearings shall be liberal in size, suitable for continuous service under the conditions specified, sealed against the entrance of dirt and the escapement of the lubricant.
- Fitted openings shall be provided on the bearing housing for applying and draining the lubricant. Filler and drain extensions shall be furnished where necessary to give ready accessibility.
- Wherever necessary, the bearings shall be insulated to prevent the passage of shaft currents through the bearings.
- The thrust bearing for vertical motors shall be of the antifriction type, capable of supporting the weight of the motor and driven equipment rotating parts plus hydraulic thrust due to load. Bearings shall be grease lubricated with provisions for greasing. Provisions shall be made to prevent over-greasing where excess lubrication may cause damage.

3.5.5 Starting

- Except where specifically indicated otherwise, motors shall be suitable for full-voltage, across-the-line starting.
- Motors shall accelerate the driven equipment to rated speed with 80% of the motor nameplate voltage applied at the terminals. Unless otherwise approved, the maximum starting current shall not exceed 6 times the rated full-load current.
- Motors shall withstand without adverse effects, a full voltage, dead-bus transfer from one source to another. The minimum "dead time" for this transfer shall be considered to be 1 second.
- Where repetitive starting is necessary, the permissible number of starts shall be clearly indicated on the nameplate.

3.5.6 Finish

Motors for use indoors shall have the manufacturer's standard finish unless otherwise specified. Motors for outdoor use shall have corrosion-resisting hardware and corrosion-resisting finish on the rotor and shaft.

3.6 Cabling Installation Practice

3.6.1 General

All cables shall be run parallel to walls and either truly vertical or horizontal as appropriate. Agree all exposed cable routes with the Engineer prior to commencing work. All holes through structural members shall be approved by the Engineer before drilling commences.

Ensure that all cables are supported to avoid undue strain on cables or on terminations. All cabling shall be neatly dressed, run in single layers and identified as to function at terminating points. All cabling shall be installed in a manner which permits its convenient withdrawal and replacement. No cable shall be cast directly into concrete.

Sharp edges to steel or sheet metal shall be removed and such work shall be arranged to avoid accidental injury to personnel, or damage to insulation. Provide insulated bushes at all points where cables enter metal enclosures.

3.6.2 Cable Identification

Each cable shall be labelled with a permanent identification number as indicated on the Contractors cable schedules. All cable cores shall be numbered.

3.6.3 Underground Cables

All underground cables are to be buried in a trench at a minimum depth of 600mm, bedded on not less than 100mm of fine washed sand and covered by a further 100mm of sand. The cables are to be laid free of kinks and twists and laid in flat formation without interlacing.

The trench shall be backfilled with 150mm of soil, consolidated and a protective layer of 150 x 25 RS ground retention tanalith treated timber, or approved proprietary cable protection covering is to be placed over the full length of the trench.

Cabling is to be completed covered by timber or equal protection.

Lay on Orange PVC signal strip 100mm wide with "Electric cable below" or equal labelling, above cables over fully length of route, at a depth of 250mm. Locations of underground cables are to be accurately marked on the Contract drawings. Where underground cables enter building a warning sign indicating "danger buried cable" is to be fastened to the building 200mm above ground level.

3.6.4 Cable Ladder

Provide all necessary cable ladder to support cables. All cable ladder width shall be sufficient for the work plus 30% spare capacity.

Cable ladder shall be manufactured from aluminium and shall be of NEMA 12A type. Cable ladder shall be stood off the wall on galvanised spacers or brackets or suspended from the ceiling on purpose made angle iron brackets galvanised after fabrication. Maximum spacing of supports, brackets and hangers shall be 2 meter. Cable ladder shall be capable of supporting 12.5 kg/m per 100mm, i.e. a 600mm wide cable ladder must be capable of supporting 75 kg/m.

All runs of ladders shall be continuously bonded and earthed.

For all HV cabling, proprietary cable clamps must be used.

Ladders shall not be mounted directly onto flat surfaces. Install on suitable brackets clear of the surface to allow for cleaning and sufficient space for air circulation around and through the ladders.

3.6.5 Cable Installation Practice (HV Cables)

i General

Single core cables shall be laid in trefoil formation using approved trefoil clamps at intervals of no more than 1m. All cables shall be pulled, supported and terminated in accordance with manufacturer's instructions.

All copper wire screens and steel wire armour shall be bonded and earthed at both ends.

Joints in cable runs shall not be permitted (except for the aerial bundled conductor line).

All exposed cables shall be run parallel to walls and either truly vertical or horizontal as appropriate.

Cables to transformers may be supported as necessary using galvanised saddles fixed to the equipment frame but on no account shall penetrations be made in tanks containing oil.

ii Terminations

At termination boxes cables shall be glanded. All terminations shall use compression terminals.

The Contractor shall ensure that:

- a. All cables shall be glanded using stainless steel glands incorporating a waterproofing seal. All terminations shall use pressure crimp lugs, compressed using the correct tool.
- b. Glanding and termination of cable is carried out strictly in accordance with manufacturer's instructions.
- c. All bolts used in termination shall be stainless steel fitted with plain washer and two nuts. The torque of all bolted connections for cables over 70mm² shall be recorded.
- d. PVC shrouds are fitted to outdoor cables and/or that any future creepage will not leave armouring exposed.
- e. Two locknuts are fitted to each gland and that each gland is fitted to a gland plate or bracket.
- f. Bushes are fitted on each gland.
- g. Cable glands and cable sheaths are effectively connected to the earthing system. Earth connections must have a cross section not less than 50% of the cross section of a core of the associated cable.
- h. Under no circumstances shall copper and aluminium conductors be directly connected.

3.6.6 Cabling Installation Practice (LV Cables)

i General

All exposed cables shall be run parallel to walls and either truly vertical or horizontal as appropriate. Cables shall be run on either cable ladder or floor ducts as appropriate.

Cables shall be sized to achieve a voltage drop of less than 2.5% of the nominal voltage between the distribution board and fitting. The maximum voltage drop from the station services transformers to the final sub circuit shall be no more than 5%.

Ensure that all cables are supported to avoid undue strain on cables or on terminations. All cabling shall be neatly dressed, run in single layers and identified as to function at terminating points. All cabling shall be installed in a manner which permits its convenient withdrawal and replacement. No cable shall be cast directly into concrete. In such areas install cables in conduit or ducting. Draw wires shall be installed in conduits or pipes where necessary for later cable installation.

Sharp edges to steel or sheet metal shall be removed and such work shall be arranged to avoid accidental injury to personnel, or damage to insulation. Provide insulated bushes at all points where cables enter metal enclosures.

After installation but before connection, all power cables shall be tested for insulation resistance.

Cabling shall be cleated at centres not exceeding:-

- : 450 mm horizontally
- : 900 mm vertically

On no account shall plastic sheathed cables be run in any situation where timbers have been treated or likely to be treated with tar-oil, creosote or allied products.

No ordinary grade PVC insulated cables shall be run in any location where the temperature is likely to exceed 45°C. No high temperature grade PVC shall be run in locations where the temperature is likely to exceed 75°C. Mineral insulated cable shall be used where the temperature may exceed 75°C.

Wiring which supplies equipment liable to overheat and cause rapid deterioration of the wiring, shall have the tails made off with heat resisting sleeves to protect the permanent wiring in a conduit box. The conduit box shall be fitted with terminals and mounted adjacent to the fitting or equipment with a run of heat resistant cabling from the box.

3.6.7 Cable Installation Practice (Instrumentation Cables)

The following installation practice shall be used:

Cable shields shall be electrically continuous. When two lengths of shielded cable are connected together at a terminal block, an insulated point on the terminal block shall be used for connecting the shields.

Shields shall be isolated and insulated except at their selected grounding point to prevent stray and multiple grounds to the shield.

At the point of termination, the shield shall not be stripped back any further than necessary from the terminal block.

For signal circuits, the shield must not be part of the signal circuit.

Signal circuits shall be grounded at only one point.

Digital signal circuits shall be grounded only at the power supply.

Analogue signal circuits shall be grounded only at the control panel and on a clean earth.

Analogue signal cables shall be physically segregated from all power and control cables and from unshielded cables carrying digital or pulse type signals.

3.7 Cable Selection

3.7.1 240/415V Cables

Cables shall be a minimum of 600/1,000 volt rating for 415 line voltage use.

All low voltage power cables shall have stranded copper conductors, shall be installed in accordance with AS/NZS 3000 and shall be rated in accordance with AS/NZS 3008.1.2..

Cables shall comply with the following standards:-

PVC insulated : NZS 6401
: AS/NZS 4961
: AS/NZS 5000.1

XLPE insulated : AS/NZS 5000.1
: AS/NZS 4026
: AS/NZS 4961

Neutral Screened : AS/NZS 3155

3.7.2 Instrumentation Cabling

Type.	Twisted pairs or triads (RTD's) with an overall shield.
Conductor	Stranded, tinned copper, 0.5 mm ² or larger.
Insulation Type	PVC
Rated Voltage (not less than)	150V DC
Continuous operating temperature	105°C (dry)

The insulated conductors shall have an overall aluminium foil shield bonded to a mylar or polyester film with a stranded, tinned copper, continuous drain wire outside of the shield.

Each pair/triple wire shall be marked with indelible numbering.

3.7.3 Control Cabling

Type	Unarmoured, circular, multicore with an integral earth conductor.
Conductor	Stranded, copper, 1.5 mm ² or larger.
Insulation Type	PVC
Rated Voltage (not less than)	1000-V AC
Continuous operating temperature	90°C

Each core shall be marked with indelible numbering.

3.8 Earthing and Equipotential Bonding

Effective protective earthing and equipotential bonding shall be provided, in accordance with the Fijian Electricity Act and AS/NZS 3000, for all electrical equipment installed under this contract. The Contractor must ensure all metal work encasing electrical work is bonded to earth. This shall include bonding all trays, ladders, trunking and electrical equipment.

3.8.1 Building Structure

The building structural reinforcing, metal cladding, metal roofing, metal doors, hand railing and supporting steel work shall be securely bonded. Connections to the building reinforcing are to be made at 5m intervals. Connections to the foundation reinforcing must be made via a copper strip brazed to the reinforcing.

3.8.2 External Foundation Pads

Earthing of reinforcing of small external foundation pads of size less than or equal to 2 x 2m is not required. However, steel reinforcing of larger pads shall be bonded with the earth mat at two points to provide equipotential bonding.

3.8.3 External Fencing

All metallic fence supports and wire mesh shall be securely bonded. Each section of the fence shall be earthed using 16 x 2.5mm copper strap and long sections of the fence shall be earthed at intervals not greater than 20m. Earthing terminals shall be provided on metal fence posts by welding a lug with 2 x 14mm dia. holes at 50mm vertical centres. The lug shall be located on the inside of the fence.

3.9 Panel Construction

3.9.1 Metalwork

All enclosures used to house electrical equipment shall be gasketed, vermin proof and protected to the class specified in accordance with AS/NZS IEC 60947-1. The maximum height above floor level of all instruments, control switches and relays shall allow for easy operation of the plant and shall not exceed 1.80 m.

Enclosures shall consist of rigid, self-supporting, steel panels with a minimum thickness of 1.5 mm steel that have full-length, hinged and gasketed doors, located to provide easy access to the equipment. A tamper-proof lock shall be provided on each door of the enclosure. Interior panels shall be provided inside the enclosures for mounting items of electrical equipment.

All panels shall be located on a 75mm high plinth made of steel or concrete, as applicable to the general construction.

Panels inside a switchroom or other outdoor enclosure that affords the same protection as a switchroom may be made of coated mild steel sheet construction. Steel shall be passivated, powder coated finished with baked enamel paint.

Panels housed within an outdoor weatherproof enclosure shall be multi-compartmented with a compartment for each functional unit.

All fastenings shall be integral with the panel or door and provision made for locking. Doors shall be rigid and fitted with weatherproof sealing material suitable for the climatic conditions specified. No door shall be wider than 1200mm without the permission of the Engineer. Panel positions in general and door sizes and positions when open, shall not impinge on the safety and operability requirements of these clauses.

Outdoor panels shall be well ventilated through vermin-proof louvres comprising a filter screen attached to a frame and secured to the inside of the panel. Divisions between compartments within the panel shall be perforated to assist air circulation. If required, ventilation fans shall be used.

3.9.2 Terminals

Panel, including all terminations and other current carrying parts shall have a minimum IP rating of 2X with the panel doors open.

All terminals shall be mounted in accessible positions. Adjacent terminals shall be adequately spaced to each other and to the incoming cable gland plate. Separate terminations shall be provided on each terminal strip for the cores of incoming and outgoing cables including all spare cores.

All terminals having a circuit voltage of 240V or higher shall be separated from lower voltages by a space created with partitions or end plates combined with end brackets and shall be shielded with an insulated cover marked with a warning notice "Danger Volts". Where necessary, the different 240V / 415V phases shall be shielded from each other with partitions (i.e. where the in-service or under-maintenance breaking of a phase-wire can result in a phase to phase short circuit due to the type of terminal used).

Terminal blocks shall not be located less than 200mm from cable gland plates.

Only one conductor shall be terminated in each side of the terminal block.

Shorting straps shall be used between terminal blocks to bridge identical conductor terminals.

Cubicles shall have at least 10% spare terminals and enough extra space on mounting bars for another 20% terminals.

3.9.3 Neutral & Earth Bars

These shall be a generous size to enable convenient termination of all neutral and earth conductors.

Neutral and earth bars shall be provided with purpose made terminations sufficient for all connections with 25% spare. The bars shall be brass, tunnel type with slotted grub screw termination fixing and shall be rated at not less than the full current carrying capacity of the main supply. Terminations are to be provided for incoming neutral and earth cables of sizes shown on the drawings or as required by AS/NZS 3000.

Busbars and connected circuits shall be capable of carrying continuously a total load equal to the rated capacity of the incoming switch isolator without the temperature rise of any component mounted with or on a board exceeding 20°C.

The earth and neutral bar shall be located well clear of incoming cables and other connections.

3.9.4 Busbars & Connections

Busbars and connections thereto shall be fully insulated and shall comply with AS/NZS 3439.2.

Busbars shall be capable of carrying the continuous rated current with a maximum temperature rise of 30°C above an ambient temperature of 40°C.

Clearances are to be maintained when a current equal to the specified short circuit rating is flowing in the busbars and connections and shall be capable of withstanding the specified test voltages. Busbars shall be rated at not less than the maximum current rating as indicated on the drawings and braced to withstand fault levels, which can be safely cleared by the section isolators.

3.9.5 Fuses

Fuses shall be high rupturing capacity and type gG as defined in IEC 60269-1, IEC 60269-2-1 and have minimum breaking capacities equal to 80kA or greater. Fuses to be used for motor protection may be type aM.

In any case fuses shall have a minimum interrupting volt-ampere capacity at least equal to the fault rating at the switchboard specified herein.

Fuse ratings and the phase to which they are connected are to be legibly marked on holder and base. Provide (6) spare fuse links of each size and type used on the switchboard and locate in a purpose made compartment. Provide all spare fuse bases as indicated.

3.9.6 Miniature Circuit Breakers (MCBs)

Miniature circuit breakers (MCBs) shall be the trip-free type category "C" with instantaneous release under heavy fault conditions. They shall comply fully with AS/NZS 60898.1 and be mounted to be removable without removing adjacent circuit breakers.

Circuit breakers shall have a fault rating of not less than the fault level of the distribution system at the point of connection in the switchboard but not less than 10kA.

A minimum of 25% spare ways shall be provided to allow for the future MCBs.

3.9.7 Moulded Case Circuit Breakers (MCCBs)

Moulded case circuit breakers shall comply with AS/NZS IEC 60947-2.

The ultimate breaking capacity of the circuit breakers shall be at least equal to the prospective fault level at the point of the distribution system where the breakers are installed.

The service breaking capacity shall be 100% of the ultimate breaking capacity.

The breakers shall be operated by a toggle, which shall clearly indicate the three fundamental positions ON and OFF and TRIPPED.

For breakers up to 250A, each MCCB shall be fitted with an interchangeable trip unit incorporating a bi-metallic element for overload protection and magnetic protection for short-circuit. MCCBs above 250A shall be provided with an interchangeable electronic trip unit. In all cases a range of adjustable settings shall be provided on the trip unit.

3.9.8 Relays

All relays are to be of best quality with contacts rated for a continuous duty of not less than 10A. They shall be encased in hermetically sealed enclosures and shall be free from discernible noise when energised. Auxiliary contacts are to be self-cleaning.

3.9.9 Contactors

All contactors are to be of best quality with contacts rated for a continuous duty of not less than 16A. They shall be free from discernible noise when energised.

3.9.10 Isolators

Every functional unit shall be provided with effective means of isolation.

All live side terminals of these isolators shall be shrouded to prevent accidental contact.

Isolators shall be rated for the continuous load current and for the maximum fault duty, which may be reached. Isolators shall not be smaller than sizes shown on the drawings.

Isolators shall be capable of being locked in the open or closed position. Isolators shall comply with AS/NZS IEC 60947-3 for AC 23 duty.

3.9.11 Pushbuttons and Pushbutton Switches

i. Type

Pushbuttons and pushbutton switches shall be heavy-duty, oil-tight, complete with engraved legend plates, operators, and contact blocks. Legend plate engravings shall be selected by the Contractor and will be subject to the Engineer's approval.

ii. Contact Ratings

- Maximum Design Voltage. 500/300-V AC and 110-V DC.
- Continuous Current. 10-A AC or DC.
- Maximum Interrupting Current, Inductive. 3-A at 240-V AC and 2.2-A at 110-V DC.
- Maximum Making Current, Inductive. 30-A at 240-V AC and 2.2-A at 110-V DC.

3.9.12 Control and Selector Switches

i. General

Manually-operated switches provided and mounted on the front of switchboards and control cubicles shall be as specified herein.

ii. Type

Switches shall be heavy-duty, rotary type complying with the requirements of AS/NZS IEC 60947-5-1 for AC 11 duty.

Ratings

- Maximum Design Voltage. 500/300-V AC and 240-V DC.
- Continuous Current. 10-A AC or DC.
- Maximum Interrupting Current, Inductive. 3-A at 240-V AC and 2.2-A at 110-V DC.
- Maximum Making Current, Inductive. 30-A at 240-V AC and 2.2-A at 110-V DC.

iii. Escutcheon Plates

Each switch shall be provided with an escutcheon plate clearly marked to show each operating position. Escutcheon plate markings shall be selected by the Contractor and will be subject to the Engineer's approval.

iv. Handles

The type and colour of the switch handle shall be selected by the Contractor and will be subject to the Engineer's approval.

3.9.13 Electrical Digital and Analogue Indicating Instruments*3.9.13.1 Type and Construction*

Instruments shall be of the flush mounting type with non-reflecting glass. They shall be calibrated and suitable for the application. Electrical measuring instruments generally shall be 96 x 96 mm but may be 72 x 72 mm if approved by the Engineer. Analogue instruments shall be of the 270° full-scale deflection type.

Digital instruments shall have the following features:

- Bright orange LED display.
- Minimum 4-digit, 12 mm-high, readout.
- Black bezel with hardware and accessories for front-of-panel mounting.
- 1% accuracy

i. Standards

Indicating instruments shall conform to IEC 60051, class index 1.5.

ii. Scale Markings

Scale markings shall be selected by the Contractor and will be subject to the Engineer's approval. Where instruments are connected to instrument transformer secondaries, the scale markings shall be selected to read the electrical quantities on the transformer primary.

3.9.13.2 Transducers and Transmitters

Transducers and transmitters shall be suitable for accurately measuring the specified quantities. Outputs shall be a dc current signal ranging from 4 to 20-mA full scale, suitable for termination in a load resistance up to 750Ω.

Unless specified otherwise, the maximum allowable error shall not exceed $\pm 0.25\%$ of full scale at 25°C, and the error resulting from a temperature variation between -20°C and 60°C shall not exceed $\pm 0.5\%$ of full scale. AC output ripple shall not exceed 1%. The units shall be provided with a 10% full scale calibration adjustment, and the response time shall be 400 ms or better from 0 to 99%. There shall be electrical isolation between input, output, external power supply if used, and the case ground connection. All transducers and transmitters shall have a dielectric test voltage rating conforming to IEC SWC test requirements.

3.9.13.3 Indicating Lamps

i. Type

Lamps shall be light emitting diode (led) type, 22.5mm diameter with press to test facility.

ii. Ratings

The indicating lamps and resistors shall be rated to operate at 240-V AC or 24-V DC.

3.9.14 Motor Starters

Low voltage motor starters shall be of the combination type as defined in AS/NZS IEC 60947 - Part 4 and shall comprise:

- Fused combination unit (disconnecter and fuse switch) or moulded case circuit breaker (AC23 minimum utilisation category).
- AC contactor (AC3 minimum utilisation category).

The operating mechanism of the isolating device shall be mounted on the front of the cubicle, operated by a pistol grip type handle. The mechanism shall be interlocked with the door to prevent opening when in the on position. The mechanism shall be padlockable in the off position.

The rated operational current of the starter (I_e) shall be not less than the full-load current of the motor. The starter shall be rated for uninterruptible duty.

Thermal overload relays shall be Type 3c as defined AS/NZS IEC 60947-4-1. Time/current characteristics shall be supplied, by the manufacturer, on 28mm x 56mm logarithmic decades. These curves shall have a tolerance not exceeding + 10%.

Co-ordination of short circuit and overload protective devices shall be type 2 fully co-ordinated as defined in AS/NZS IEC 60947-4-1 for a prospective short-circuit current not less than the value determined by the electrical system design. For this purpose the short circuit protection device shall be fitted with the maximum rating of motor circuit fuse.

Motor starters shall be suitable for both automatic and non-automatic methods of control.

Unless otherwise specified, motor starter control circuits shall be operated from a 24V AC supply, derived from an individual, integral starter control transformer.

Power factor correction capacitors shall be provided in motor starters to correct the motor power factor to a minimum of 0.93. Separate contactors shall be used to switch the motor circuit and power factor correction equipment.

Where assisted start motor starters are required in order to reduce motor starting currents, electronic soft start units shall be used. Electronic soft start units shall be provided complete with bypass contactor. Assisted start operation shall be automatic changeover with adjustable time delays to suit the motor conditions.

Contactors shall be provided with auxiliary contacts to provide all required control and signalling functions and shall be provided with two additional spare normally open and two spare normally closed contacts.

Each starter shall be provided with the following controls and indications as a minimum:-

- Door interlocked isolator.

- Running lamp.
- Stopped lamp.
- Fault lamp.
- Run/off/auto selector switch,
- Auto-control interposing relay 24V DC operated from plant control system.
- Plant trips relay 24V DC operated from plant control system.
- Ammeter.
- Hours run meter.
- Number of starts counter.
- Emergency stop pushbutton.
- Trips reset pushbutton.
- Lamp test pushbutton.

Each starter shall be provided with the following volt free contacts to provide interface with the plant control system:-

- Running/stopped.
- Machine available for auto control.
- Fault.

Each starter shall be provided with a test facility, which shall energise the control circuit when operated. The test switch shall be arranged to automatically release when the starter door is closed. The test facility shall enable the control circuits to be operated for testing purposes with the main motor circuit isolated.

Each starter shall be provided with the facility to disconnect the controls via a remote emergency stop pushbutton. Where a pushbutton is not installed the connection facility shall still be provided, but linked out. All emergency stop operations shall require resetting by the starter/drive reset pushbutton to restart the machine.

Each starter shall be provided with the facility to disconnect the controls via a remote early break contact on an isolator located adjacent to the motor.

Where a motor is supplied with auxiliary protective devices (e.g. thermistor protection or moisture protection), the protective relays and associated controls shall be incorporated into the design of the starter.

Control circuits shall be provided with a power on delay timer which shall make the starter available for automatic or manual control on restoration of the power supply without requiring operation of the reset pushbutton, unless another fault condition exists.

Where a motor is supplied with an anti-condensation heater, an on/off switch shall be provided on the front of the starter to isolate the heater. The heater shall be switched via an auxiliary contact on the main contactor, operating so that the heater is energised whenever the motor is off.

3.9.15 Heaters

Enclosures containing electrical control and switching equipment shall be equipped with electric space heaters for moisture control. The construction of the enclosures and the placement of the heaters shall assure effective circulation of air and prevent damage to equipment by overheating. Heaters shall be rated 240-V AC, single-

phase. They shall be provided with thermostatically operated controls with “on-off” switches mounted inside the enclosure.

3.9.16 Lighting and Receptacles

Enclosures larger than 1.0 m² (vertical, front-of-panel surface area) shall be provided with a light and receptacle inside the enclosure to facilitate operation and maintenance. The light shall be incandescent type, with wire-guard and “on-off” switch. The receptacle shall be a duplex type, 2-pole, 3-wire. Power supply to the light and receptacle will be from a single-phase, 240-V AC, circuit.

3.9.17 Panel Wiring

All panel wiring shall be carried out in a neat and systematic manner with cable supported clear of the panels and other surfaces at all points to obtain free circulation of air.

All PVC insulated panel wiring shall comply with the requirements of BS 6231 Type BK. Conductors shall generally have a minimum cross section equivalent to 3/0.77mm (1.5mm²), 7/0.67mm (2.5mm²) but single stranded conductors should only be employed for rigid connections which are not subject to movement or vibration during shipment, operation or maintenance.

Wire colours shall be as follows:

415V AC	Red	A-phase connections in current and voltage transformer circuit only
415V AC	White	B-phase connections in current and voltage transformer circuits only.
415V AC	Blue	C-phase connections in current and voltage transformer circuits only
415/240V AC	Green with Yellow stripes	Connections to earth.
415/240V AC	Black	AC neutral connections, earthed or unearthed, connected to the secondary circuits of current and voltage transformers
240V AC	Red	Single phase AC connections other than those above

	Positive	Negative
24V DC	Grey	Pink
12V DC	Purple	Pink
Current Loops	Purple	Pink

24V AC	Brown	Phase wires
24V AC	Orange	Neutral wires

Provide segregation between LV and ELV outgoing terminals.

Wiring to doors shall be anchored at the panel side and sufficient length shall be provided to enable the door to swing fully open without strain on cabling.

All wiring shall be identified with slip on ferrules with indelibly printed letters and numbers.

All outgoing control / controlled field wiring shall be brought out to terminals to facilitate ease of termination. Termination of all wiring at these terminals shall be effected using pre-insulated crimped ferrules or lugs of the correct size to suit cable and terminal capacity.

No wires may be teed or jointed between terminal points.

Electrical wiring and instruments shall be so located that leakage of oil or water cannot affect them.

Bus wiring between panels, cubicles, etc, shall be fully insulated and be completely segregated from the main panel wiring.

All metallic cases of instruments, control switches, relays, etc, mounted in panels, steel or otherwise, shall be connected by means of green with yellow stripes PVC insulated copper conductors of not less than 2.5mm² cross section to the nearest earth bar.

3.9.18 Panel Earthing

All metallic cases of instruments, control switches, relays, etc, mounted in panels, steel or otherwise, shall be connected by means of green with yellow stripes PVC insulated copper conductors of not less than 2.5mm² cross section to the nearest earth bar.

All metalwork shall be bonded to the main earth bar. All hinged panels shall be bonded with flexible copper.

All cable sheaths and earthing conductors shall be bonded to the earth bar. Use compression type conductor lugs for all earth connections with bolted joints. Ensure that all connections are tightened.

Earth continuity shall not depend upon metal joints. For panel earthing use starred washers between screw and panel.

3.9.19 Panel Labelling

All panels shall be fitted with an identification/rating plate displaying the following information: site name; rated voltage, phasing, frequency, current, etc; panel/equipment manufacturer; and contract number.

All items, including exterior items, shall be identified with a white engraved laminate label with black lettering. All panel labels shall be fixed by two cadmium plated or stainless steel screws.

The requirement for labels includes, but is not limited to, the following:

- All panels, boxes, cabinets, cubicles or enclosures.

- Equipment mounted in or on the above items including relays, contactors, starters, sounders, motors, switches, sockets, controllers and luminaires.

3.10 Small Power requirements

3.10.1 Outlet Boxes

Each fixture or continuous row of fixtures and all switches, receptacles, and other wiring devices shall be provided with suitable outlet boxes. Boxes for use in dry locations shall be constructed of galvanized sheet steel. Covers shall be held in place with stainless steel screws. Boxes located outdoors shall be cast metal or alloy, fitted with screw-fastened covers and gaskets and with threaded conduit connections. Outlet box extension rings shall be provided for exposed conduit extensions from embedded outlet boxes. Extension rings shall match the embedded boxes. Where extension rings are mounted on cast type boxes, neoprene gaskets shall be used.

3.10.2 Receptacles and Switches

Duplex receptacles shall be 3-wire, grounding type, rated 20-A, 240-V AC, with ground connection wired to separate ground conductor in raceway.

Switches used for the control of lighting fixtures shall be rated 20-A, 240-V AC, single-pole, two-pole, 3-way, or 4-way, as required.

Wall switches and receptacles shall be covered with device plates suitable for the type and number of devices enclosed. Covers mounted on boxes containing 2 or more devices shall be of the combination type. Device plates shall be stainless steel in all indoor, dry locations. Device plates for duplex receptacles installed outdoors shall be provided with spring-type gasketed covers.

Power outlets shall consist of one single gang receptacle integrally mounted with a safety switch. The safety switch and receptacle shall be interlocked so as to prevent the insertion or removal of a plug from the receptacle with the switch in the "ON" position. Both the switch and the receptacle shall be rated 415-V AC, 100 A. The safety switch shall be a heavy duty 3-pole switch with visible blades and a quick make-and-break mechanism. The receptacle shall be 3 phase, 4 wire grounded through the extra pole and shell.

Power receptacle plugs shall be for 100-A service.

3.10.3 Fixtures

Fixtures shall be furnished complete with mounting brackets, fixture mounting stems, poles, or hangers, together with steel supports and/or channels as required, and fixture wires. All fixtures shall be subject to approval by the Engineer.

3.10.4 Ballasts

Ballasts shall be provided with fixtures as required and have a high power factor and shall be of required voltage and frequency.

3.10.5 Lamps

Lamps shall be furnished for all lighting fixtures. Lamps shall be of the required type, length, and wattage.

3.10.6 Lighting Panel Boards

Lighting panel boards shall be rated 415/240-V, 3-phase, 4-wire, 50 Hz, with 200-A (minimum) main bus and shall be provided with 3-pole main circuit breaker and 42 single-pole, 20-A branch circuit breakers.

Each lighting cabinet shall consist of a panel board, box, and cover together with main circuit breaker, branch circuit breakers, buses, and other accessories as specified herein. They shall be of dead front construction. All lighting panel boards shall be the product of the same manufacturer and shall be completely built, assembled, and tested in the factory.

3.10.7 Lighting Contactor Cabinets

Lighting contactor cabinets shall be provided for manual/automatic control of outside lighting. The cabinets shall be furnished with all required equipment to make the installation complete.

3.10.8 Photocells

Photocells shall be furnished as required.

3.11 Switchboards

The Contractor shall submit layout and manufacturing drawings for all switchboards for review by the Engineer. The Contractor shall receive the Engineer's comments before manufacture commences. The Contractor shall include all reasonable alterations required by the Engineer.

3.11.1 General

Switchboards are that part of the electrical installation as defined by AS/NZS3000. Switchboards may include control panel sections and distribution board sections. Control panel sections and distribution board sections shall be built to the same panel standard as the switchboard in which they are mounted. Distribution boards within switchboards shall otherwise agree with the Distribution Board section that follows.

Assemblies shall be designed and built to comply with the following standards:

AS/NZS IEC 60947: Low-voltage switchgear and controlgear assemblies.

3.11.2 Metalwork

Panels shall be of rigid sheet metal construction and the minimum thickness of the sheets employed shall be 1.5 mm. The front of the panels shall have a smooth well-finished surface.

Panels mounted indoors shall, as a minimum, be manufactured from coated mild sheet steel. The steel shall be passivated, powder coated and finished with baked enamel paint. Colour to be confirmed by Engineer.

3.11.3 Construction

Switchboards shall be cubicle types, flush front switchboard accommodating all equipment shown on the drawings and described herein.

- Switchboards shall be Form 3a as a minimum.
- Switchboards shall be IP 42 as a minimum.

Switchboards shall be built up out of welded mild steel framework, fitted with removable sheet metal covers. Alternatives based on proprietary bolt-together frame-systems are subject to the approval of the Engineer.

Steel covers shall be made from minimum 1.2mm material. All metal work shall be bonded to the earth bar.

All connections shall be capable of being terminated without disconnecting other items and shall provide sufficient room for all required cable turns without exceeding cable minimum "during installation" and "set" radiuses as appropriate in each case. The switchboard shall have a separate steel-channel mounting base in a continuous length drilled for fixing to the floor with 10 mm diameter bolts.

No door shall be wider than 800mm without the permission of the Engineer. Also refer to AS/NZS 3000 clause 2.9.8 "Location of Switchboards" and clauses 2.9.9 and 2.9.10. Panel positions in general and door sizes and positions when open, shall not impinge on the safety and operability requirements of these clauses.

Starred washers shall be used to provide earth continuity between adjacent steel surfaces.

Provide all necessary ventilation to ensure that heat build-up does not occur. Panels shall be well ventilated through vermin-proof louvers comprising a filter screen attached to a frame and secured to the inside of the panel. Divisions between compartments within the panel shall be perforated to assist air circulation, but not if this negates the section isolation requirements of AS/NZS 3439. If required to achieve satisfactory operating temperatures, thermostatically controlled ventilation fans shall be used.

3.11.4 Busbars and Connections

The main busbars shall be rated as required and braced to withstand fault levels as specified or 22kA rms for 1s, whichever is the larger. The busbar system shall be capable of withstanding thermal and magnetic stresses consistent with AS/NZS 3439.

Busbars and connections thereto shall be fully insulated. Clearances shall be maintained when a current equal to the specified short circuit rating is flowing in the busbars and connections, and must be capable of withstanding the specified test voltages.

Bolted links shall be provided to allow for easy replacement of all current transformers.

The design of busbars shall permit convenient future extension of the switchboard. Busbars shall be drilled, shall be copper and shall be fully tinned.

3.11.5 Neutral & Earth Bars

Neutral and earth bars shall be generously sized to enable convenient termination of all neutral and earth conductors. Busbars and connected circuits shall be capable of carrying continuously a total load equal to the rated capacity of the incoming switch isolator (or circuit breaker) without the temperature rise of any component mounted within or on a board exceeding 20°C.

Neutral and earth bars shall be provided with purpose made terminations sufficient for all connections with 25% spare. The bars shall be brass, tunnel type with slotted grub screw termination fixing. Terminations shall be provided for incoming neutral and earth cables of sizes shown on the drawings or as required by the Regulations.

3.11.6 Moulded Case Circuit Breakers (MCCBs)

Moulded case circuit breakers shall comply with AS/NZS IEC 60947-2.

The service breaking capacity (Ics) shall be 100% of the ultimate breaking capacity (Icu). The rated ultimate breaking capacity (Icu) of each moulded-case circuit breaker shall be equal to at least the value of the short-circuit current (Isc) at the point of installation on the electric circuit, unless the upstream circuit breaker makes it possible to ensure coordination as defined in Appendix A of AS/NZS IEC 60947-2.

All MCCBs shall be designed for horizontal or vertical mounting without any adverse effect on electrical performance. It shall be possible to reverse feed the breaker without reduction in its performance.

MCCBs shall be available in fixed, plug-in or withdrawable models and in 3 pole or 4 pole versions.

MCCBs shall be of circuit breaker disconnecter type.

The breakers shall have a rated operational voltage of 690V AC (50/60Hz).

The rated insulation voltage of the circuit breakers shall be 750V AC (50/60Hz).

The MCCBs shall provide class II insulation (to IEC 664) between the front and internal power circuits.

The operating mechanism shall be of the quick make quick break type, with the speed of operation independent of the operator, and shall be trip free.

The breakers shall be operated by a toggle or a handle as specified which shall clearly indicate the three fundamental positions ON, and OFF and TRIPPED. If required, rotary handles shall be fitted to the breaker.

MCCBs of the same range shall have a common depth.

The operating mechanism shall be designed in such a way that the position of the operating handle of the circuit breaker indicates the real position of the main contacts (i.e. positive contact indication), even if the circuit breaker is equipped with a rotary handle.

Isolation shall be provided by a double break on the main circuit.

It shall be possible to lock the circuit breaker in the isolated position only with the use of a locking device and padlocks.

MCCBs shall have clearly accessible from the front face:

- Markings of rating
- Marked as suitable for isolation
- Push-to-trip test button to test operation of poles
- Contact position indicator

The MCCB shall provide double insulation of the front face to allow on-site installation of auxiliaries without de-energising the installation or circuit. All electrical auxiliaries and accessories including voltage releases (shunt or under-voltage) and auxiliary contacts shall be designed for easy on-site installation. All electrical auxiliaries shall be equipped with terminal blocks and shall be of the snap-in type. All electrical auxiliaries shall be separated from power circuits and their addition shall not increase the MCCB volume.

It shall be possible to fit the MCCB with a motor mechanism without affecting the circuit breaker characteristics.

3.11.6.1 *Protection Function*

Each MCCB shall be provided with an integral trip unit that shall be easily interchanged with standard tools. The trip-setting area shall be able to be sealed off.

All MCCBs shall include the option of, or be fitted standard with, an electronic trip unit. These shall be true RMS sensing and shall withstand temperatures of up to 125°C.

For MCCBs up to and including 250A rating, standard trip units may be thermal-magnetic types, with at least 36 long-time current adjustments and pre-set short-time and instantaneous tripping. The optional electronic trip units shall provide as a minimum :

- Long-time protection with 48 current threshold adjustments
- Short-time protection with 8 current threshold adjustments
- Pre-set instantaneous protection
- 40A, 80A, 100A, 160A and 250A protection units.

For example, the 250A MCCB can be fitted with a 40A-body trip unit that provides 48 long-time current settings at and below 40A.

For MCCBs above 250A rating and up to 630A, standard electronic trips shall provide as a minimum :

- Long-time protection with 48 current threshold adjustments
- Short-time protection with 8 current threshold adjustments
- Pre-set instantaneous protection
- 150A, 250A, 400A, and 630A protection units.

For MCCBs above 250A rating and up to 630A, there shall also be an optional higher specified trip unit available that offers, in addition to the above :

- Long-time tripping delay adjustments
- Short-time tripping delay adjustments
- Instantaneous protection with 8 current threshold adjustments
- Instantaneous current threshold tripping delay adjustments
- Indication of fault types
- Optional communications capabilities with Modbus or other industry standard communications
- Optional digital true RMS ammeter display

For example, the 630A MCCB can be fitted with a 150A body trip unit that provides 48 long-time current settings at and below 150A.

3.11.6.2 *Discrimination Function*

Discrimination shall be provided to comply with AS/NZS IEC 60947-2 and shall be total discrimination. This means that for faults from overloads up to the full prospective short circuit level of the system, only the circuit breaker immediately upstream of the fault shall operate to clear the fault and all other circuit breakers shall remain closed.

The circuit breaker manufacturer may be asked by the Engineer to provide computer-generated calculations in the form of an easily read report that proves discrimination. In the short circuit region, the results shall be based on tests that the manufacturer has carried out that have been incorporated into computer model.

3.11.7 **Miniature Circuit Breakers (MCBs)**

Miniature circuit breakers (MCBs) shall comply fully with AS/NZS 4898. They shall be removable from the in-service position without removing adjacent circuit breakers and shall be of the trip-free type. The range available shall include breakers with B, C, D and MA tripping curves and shall be available in 6kA, 10kA and 15kA fault ratings. The breaker combinations of MCCB followed by MCB and further downstream MCBs shall provide full discrimination right through the circuit breaker installation.

MCBs shall have a fault rating of not less than the fault level of the distribution system at the point of connection in the switchboard but not less than 6KA. The use of cascading is permitted to provide an increase in a breaker's fault rating.

MCBs shall be capable of being padlocked open using suitable attachments.

Spare MCBs shall be fitted as shown on the DB schedules. Blanking covers shall be fitted to all empty ways.

3.11.8 Cable Details

Cable access shall be from the top and from the bottom of the switchboard. Non-ferrous gland plates shall be fitted to each compartment for cable access.

All cables shall be terminated via bolted compression type terminal lugs. Provide all necessary copper-work to facilitate this. Separation and insulation shall be provided between incoming and outgoing cable terminations.

3.11.9 Contactors

All contactors are to be of best quality with contacts rated for a continuous duty of not less than 16 amps (AC3).

3.11.10 Control Relays

All relays are to be of best quality with contacts rated for a continuous duty sufficient for the application. They shall be encased in sealed enclosures and shall be free from discernible noise when energised.

3.11.11 Control Wiring

All control panel wiring shall be carried out in a neat and systematic manner with cable supported clear of the panels and other surfaces at all points to obtain free circulation of air.

Conductors shall generally have a minimum cross section equivalent to 3/0.77mm (1.5mm²), 7/0.67mm (2.5mm²) but single stranded conductors should only be employed for rigid connections which are not subject to movement or vibration during shipment, operation or maintenance.

Wiring to doors shall be anchored at the panel side and sufficient length is to be provided to enable the door to swing fully open without strain on cabling. Full height doors shall be provided with door stays to prevent swinging when open. All panel doors shall be hinged and shall be provided with T'bar locks. At least one T'bar on each compartment shall be key lockable. The same key pattern shall be used for every lock on the whole assembly and a set of keys (minimum of 10) shall be provided with the assembly.

All wires shall be number ferruled using Grafoplast, Critchley type K or Memocab type cable markers or other exactly equivalent system. Do not use industry standard 'C' and 'D' type ferrules.

All outgoing control/controlled field wiring is to be brought out to terminals to facilitate ease of termination. All outgoing control / controlled field wiring is to be brought out to terminals to facilitate ease of termination.

Termination of all wiring at these terminals is to be effected using pre-insulated crimped ferrules or lugs of the correct size to suit cable and terminal capacity.

No wires may be teed or jointed between terminal points.

Bus wiring between panels, cubicles, etc, shall be fully insulated and be completely segregated from the main panel wiring. All wiring of different voltages shall be segregated.

All metallic cases of instruments, control switches, relays, etc, mounted in panels, steel or otherwise, shall be connected by means of green with yellow stripes PVC insulated copper conductors of not less than 2.5mm² cross section to the nearest earth bar.

3.11.12 Selector Switches

Rotary selector switches shall comply with the requirements of AS/NZS IEC 60947-5-1 for AC 11 duty.

3.11.13 Terminals – Control Wiring

All terminals shall be mounted in accessible positions. Adjacent terminals shall be adequately spaced to each other and to the incoming cable gland plate. Separate terminations shall be provided on each terminal strip for the cores of incoming and outgoing cables including all spare cores.

- Terminal blocks shall not be located less than 200 mm from cable gland plates.
- Provide segregation between LV and ELV terminals.
- Only one conductor shall be terminated in each side of the terminal block.
- Shorting straps shall be used between terminal blocks to bridge identical conductor terminals.
- AC supply connections shall be shielded at the terminal block by means of insulated covers.
- Cubicles shall have space on mounting bars for at least another 20% terminals.

3.11.14 Earthing

Bond all metalwork to main earth bar. Bond all hinged panels with braided flexible copper.

3.11.15 Labels

Panel labels shall be provided to describe the operations of all devices to the Engineer's approval.

Labels shall consist of white lettering engraved on black traffolyte. Lettering shall be 12 mm high for main panel labels and 5 mm high for circuit descriptive labels. All labels shall be fixed with chromium plated or stainless steel screws.

Each cubicle shall be provided with an engraved black and white designation label, and a typed or stencilled chart mounted inside the door giving full particulars of all circuits controlled. Cover chart with 1.6 mm clear Perspex fixed on a rigid frame. The chart shall show all circuit numbers and the location of circuit outlets.

Phases are to be identified by phase colours.

3.11.16 Manufacture

A recognised and approved manufacturer of switchboards, control panels and distribution boards shall be engaged to manufacture all panels.

3.12 Distribution Boards

The Contractor shall submit layout and manufacturing drawings for all distribution boards for review by the Engineer. The Contractor shall receive the Engineer's comments before manufacture commences. All reasonable alterations required by the Engineer shall be included.

3.12.1 General

Distribution boards (DBs) may be included in switchboards to feed local final circuits, in which case the panel construction techniques are to comply with the switchboard requirements.

Particular care is to be taken to ensure that adequate cable termination space is provided.

Circuit description cards are required for each distribution board. These shall be typed and laid out in a way that clearly corresponds to the actual layout of the board. A copy of the circuit card shall be installed in a plastic sleeve mounted on the inside of the cabinet door and additional copies shall be placed in each Maintenance and Operation Manual.

3.12.2 Cabinet Construction

Provide sheet metal, enclosed type, fitted with lockable side hinged doors. They shall be folded 1.6 mm quality baked enamel finish internally and externally. The metalwork on the complete distribution board shall be thoroughly cleaned of all rusting, degreased and primed with zinc chromate. Internal colour is to be white. External colour as specified by the Engineer.

Provide adequate terminal space on neutral and earth bars and adequate wiring space between DBs and ceiling and floor spaces to enable the addition of future sub-circuits up to the full capacity of the board.

All metalwork shall be bonded to the earth bar and starred washers shall be used to provide earth continuity between adjacent steel surfaces.

Boards shall be flush or surface mounted as indicated on the drawings.

No handles shall protrude beyond the front cover/door.

All mechanisms likely to rust shall be cadmium plated or otherwise rust proofed.

3.12.3 Busbars & Connections

Busbars shall be capable of carrying the continuous rated current with a temperature rise not exceeding 20°C above ambient.

Clearances shall be maintained when a current equal to the specified short circuit rating is flowing in the busbars and connections, and shall be capable of withstanding the specified test voltages. Busbars shall be rated at not less than 100 amps each phase.

3.12.4 Circuit Breakers

MCCBs and MCBs shall agree with the requirements above for Switchboards.

3.12.5 Isolators

Every DB shall be provided with effective means of switch-isolation. All live-side terminals of these switches are to be shrouded to prevent accidental contact.

Isolators shall be rated for the continuous load current and for the maximum fault level that may be reached. Isolators shall not be smaller than sizes shown on the drawings or schedules.

3.12.6 Manufacture

A recognised and approved manufacturer of switchboards, control panels and distribution boards shall be engaged to manufacture all panels.

3.13 Battery Charger Panel Construction

The Contractor shall supply a standard charger control panel that has been fully wired and tested at the manufacturer's works. The panel shall be altered as required to agree with this specification.

The control panels shall provide IP 42 or better in accordance with AS1939.

Control panels shall consist of a single panel of rigid sheet metal construction and a minimum steel thickness of 1.2 mm. A hinged and tool-locked or key-locked door shall afford access to the panel and shall have a smooth well-finished surface.

The panel shall be well ventilated through vermin-proof louvers comprising a filter screen attached to a frame and secured to the inside of the panel.

3.13.1 Control Panel Terminals

All terminals shall be mounted in accessible positions. Adjacent terminals shall be adequately spaced to each other and to the incoming cable gland plate. Separate terminations shall be provided on each terminal strip for the cores of incoming and outgoing cables.

All terminals having a circuit voltage of 240 V or higher shall be shielded with an insulated cover marked with a warning notice "Danger Volts".

Only one conductor shall be terminated in each side of the terminal block.

Shorting straps shall be used between terminal blocks to bridge identical conductor terminals.

AC supply connections shall be shielded at the terminal block by means of insulated covers.

Provide segregation between LV and ELV outgoing terminals.

3.13.2 Fuses

Fuses shall be high rupturing capacity type and have minimum capacities equal to that of class AC 80, Q1. They shall have a maximum fusing factor of 1.5 fusing. Fusing factors greater than 1.5 may be used for motor protection only with the approval of the Employer's Representative.

3.13.3 Relays

All relays shall be of best quality with contacts rated for a continuous duty of minimum 10 amps. Auxiliary contacts are to be self-cleaning.