

- NOTES**
1. ALL HOLES TO BE Ø22.
 2. ALL DIMENSIONS TO BE WITHIN THE TOLERANCE OF +3mm
 3. DEPTH MARKING TO BE 300mm ABOVE GROUND LEVEL

POLE TYPE 2 (10.2m)

No.	REVISION	DATE	BY	CHK	PSD	APP
0	ORIGINAL ISSUE FOR SI No.	15.03.17	RR			




DRAWN	RAULUI.R	15.03.17
CHECKED		
CHIEF DRAUGHTSMAN	<i>RM</i>	16/03/17
TEAM LEADER	<i>Ritesh</i>	17/03/17
PLANNING & DESIGN	<i>Lenoa</i>	17/03/17
ENGINEER		
HEAD OF DEPARTMENT	<i>[Signature]</i>	17/03/17



FIJI ELECTRICITY AUTHORITY

10.2m WOODEN POLE
SCARFING DETAILS
FOR 11kV & LV DISTRIBUTION

DRAWING NUMBER			
A3	01	E43	036
SCALE 1:25			

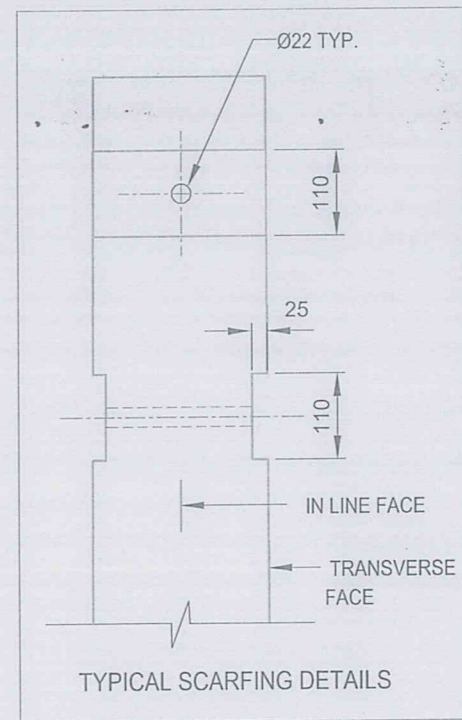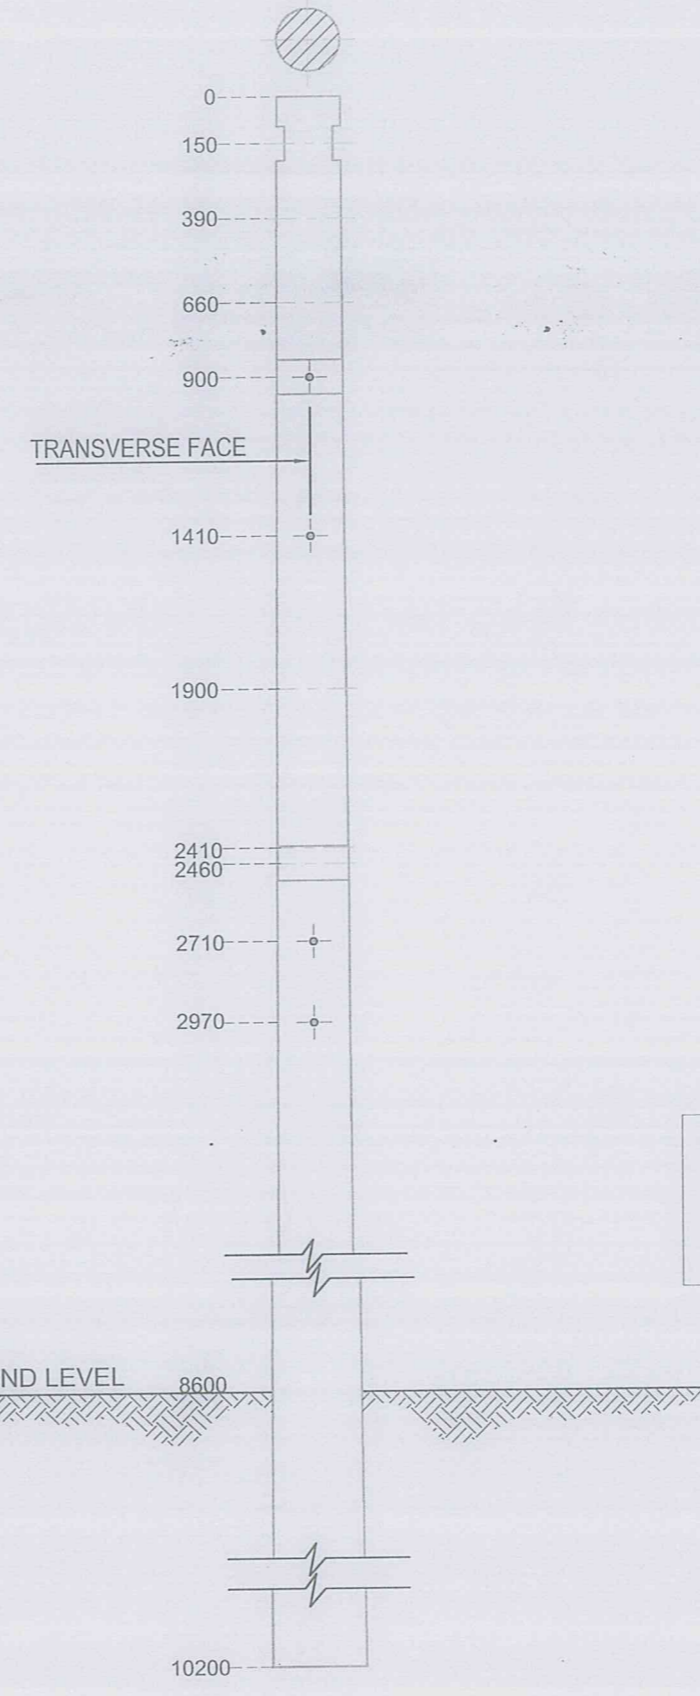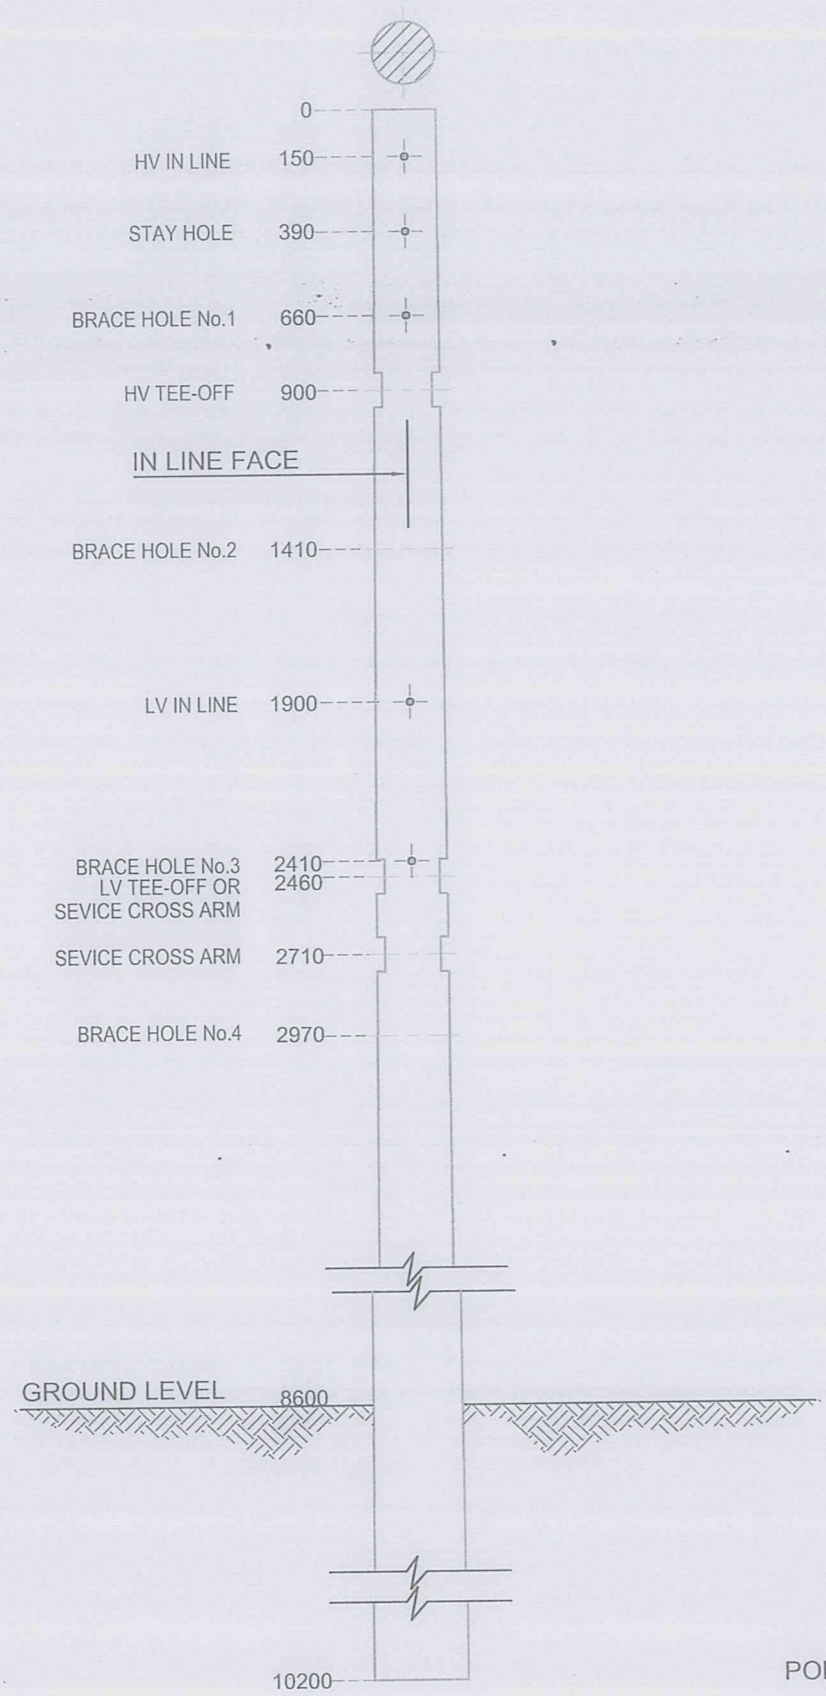

- NOTES**
1. ALL HOLES TO BE Ø22.
 2. ALL DIMENSIONS TO BE WITHIN THE TOLERANCE OF ±3mm
 3. DEPTH MARKING TO BE 300mm ABOVE GROUND LEVEL

POLE-TYPE 2 (10.2m)

No.	REVISION	DATE	BY	CHK	PSD	APP
0	ORIGINAL ISSUE FOR SI No.	15.03.17	RR			

	DRAWN	RAULUI.R	15.03.17
	CHECKED		
	CHIEF DRAUGHTSMAN	KELEVI	17.03.17
	TEAM LEADER	RITESH	17.03.17
	PLANNING&DESIGN	J LENOA	17.03.17
ENGINEER			
HEAD OF DEPARTMENT	B KUMAR	17.03.17	

FIJI ELECTRICITY AUTHORITY

10.2m WOODEN POLE SCARFING DETAILS FOR 11KV & LV DISTRIBUTION

DRAWING NUMBER			
A3	01	E43	036
SCALE 1:25			